


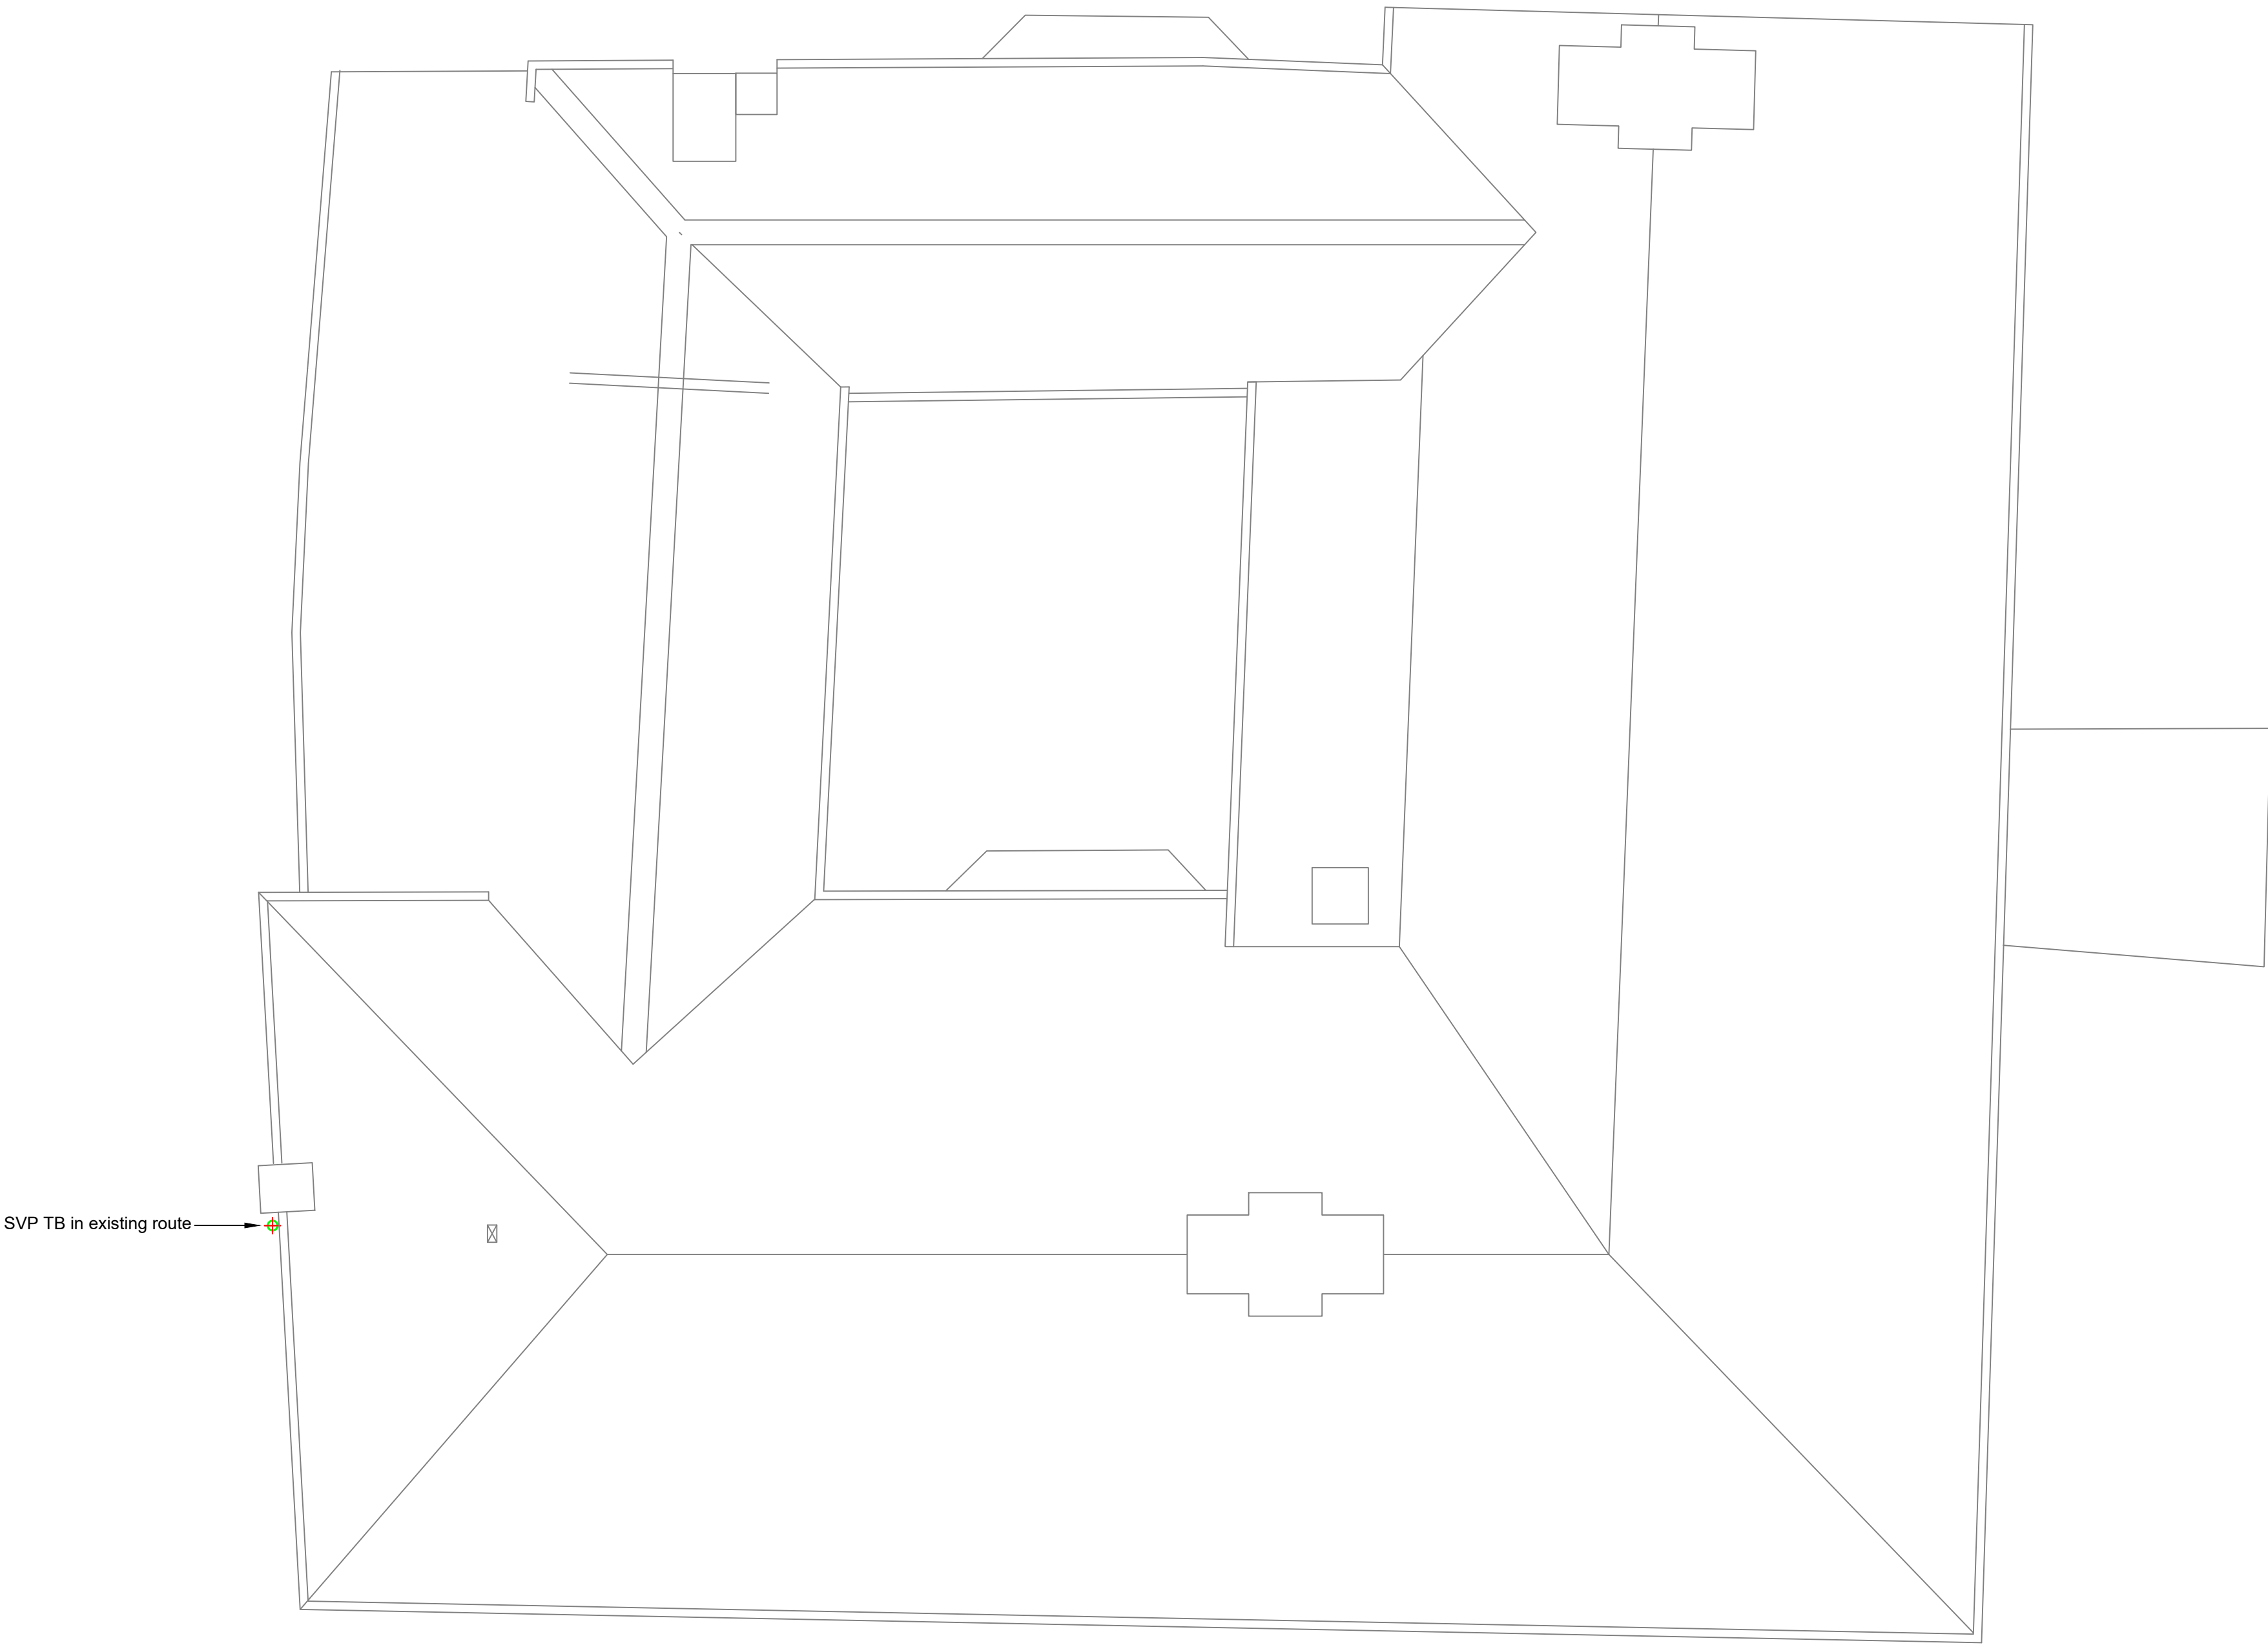

Fire Protection Notes:

- **Ductwork:** Where ductwork crossed a protected escape route or passes through a fire rated floor. Ducts shall be provided with fire dampers or for PVC flat duct, approved fire wrap.
- **Soil Pipework:** Where passing through fire rated floors shall be fitting with approved fire collars.
- **Small Services:** ie. Small bore pipework and cabling. All penetrations passing through fire rated structure shall be suitably fire stopped in accordance with approved details.

GENERAL NOTES:

1. This drawing is not an Architects drawing and must not be interpreted as such.
2. Do not scale off this drawing.
3. This drawing must not be used for construction or installation purposed unless stated.
4. All dimensions must be verified on site before completing shop drawings or setting out the work.
5. This drawing to be read in conjunction with the relevant technical specifications.
6. This drawing is to be read in conjunction with Architectural and Structural Engineers drawings.

HW - Hot Water	NRV - Non Return Valve
HL - High Level	S/C - Stop Cock
LL - Low Level	C/V - Control Valve
TA - To Above	DRV - Double Regulating Valve
TB - To Below	LSV - Lock Shield Valve
FA - From Above	IV - Isolation Valve
FB - From Below	STR - Strainer
SS - Stub Stack	HTG - Heating
AAV - Air Admittance Valve	CW - Cold Water
SVP - Soil Vent Pipe	TD - Tundish
DCV - Double Check Valve	F - Flow
SV - Solenoid Valve	R - Return
NRV - Non Return Valve	

Pipes Hidden H/L	----
Pipes Hidden L/L	-----
Pipes Exposed H/L	-----
Pipes Solid L/L	=====

TO	TENDER ISSUE	15/01/2020
P1	UPDATED TO ARCHITECT'S COMMENTS.	17/12/2019
P0	INFORMATION	02/12/2019
REV	MODIFICATIONS	DATE

CARNELL
WARREN

A S S O C I A T E S

DUKE HOUSE, DUKE STREET, WOKING, GU215BA
PROJECTS@CARNELLWARREN.CO.UK 01483 730995

PROJECT
The Almonry Battle

TITLE
Roof Drainage

CLIENT
Battle Town Council

SCALE @ A1 1:50	DATE Nov '19	DRN BM
--------------------	-----------------	-----------

DRAWING NO. 1509/P/203	REV. T0
---------------------------	------------