



GANTRY LEVEL - AS PROPOSED

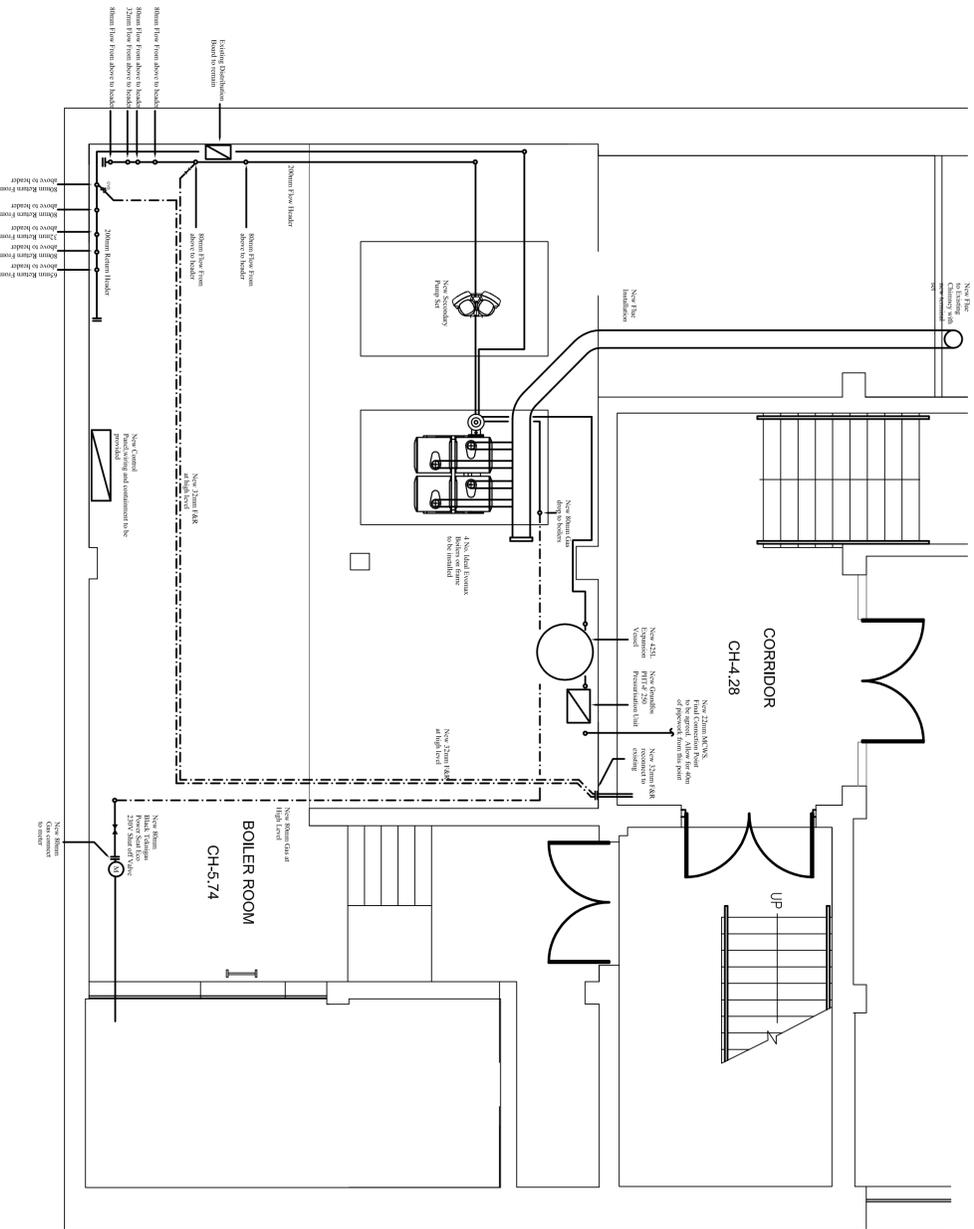

BOILER ROOM - AS PROPOSED

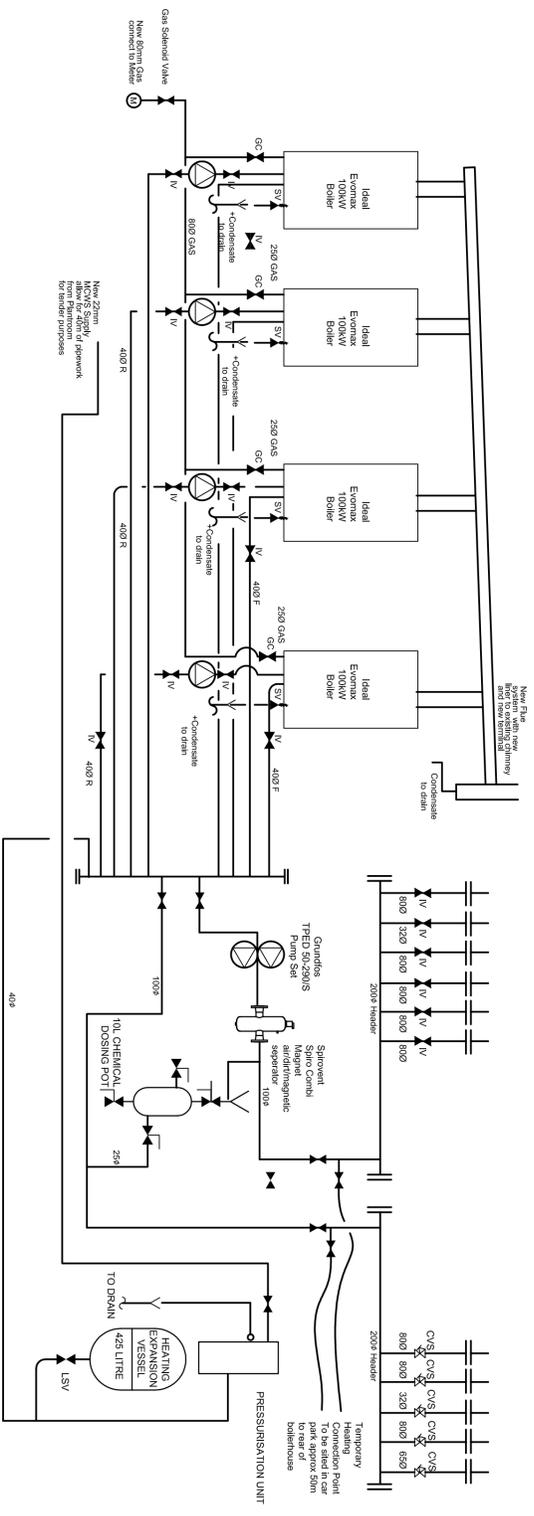

SCHEMATIC ARRANGEMENT - AS PROPOSED N.T.S.

 <p>Brian Mellor Associates CONSULTING ENGINEERS</p>		<p>2nd FLOOR BRIMMING BUILDING 2 UPPERFIELD ROW HUDDESFIELD HD1 2AL</p> <p>Tel: 01484 51973 Email: gm@bmaassociates.co.uk</p>	
<p>COM Regulations 2015 RSC: <input type="checkbox"/> Safety Note No. <input type="checkbox"/></p>	<p>Drawing Issue Status <input type="checkbox"/> PRELIMINARY <input checked="" type="checkbox"/> TENDER <input type="checkbox"/> CONSTRUCTION</p>	<p>PROJECT WAKEFIELD COLLEGE RADCLIFFE BUILDING REPLACEMENT OF BOILERPLANT</p>	<p>TITLE BOILERROOM AS PROPOSED</p>
<p>Scale: 1:50 approx @ A1 Date: October 2017 Drawn: CBM</p>	<p>Drawn: CBM</p>	<p>Dwg No. 2017-060/M/102</p>	<p>Rev</p>