

ARCHITECT'S DRAWING No.	DATE


NOTES

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ELECTRICAL SPECIFICATION AND ALL ASSOCIATED ARCHITECTS AND ENGINEERS DRAWINGS.
- ALL WORKS TO BE CARRIED OUT IN STRICT ACCORDANCE WITH ALL RELEVANT SAFETY REGULATIONS.
- THIS DRAWING IS FOR TENDER PURPOSES ONLY. FULLY DETAILED INSTALLATION, CO-ORDINATION AND BUILDERS WORK DRAWINGS SHALL BE PROVIDED BY THE ELECTRICAL SUB-CONTRACTOR IN ACCORDANCE WITH THE SPECIFICATION.
- THE HEATING SYSTEM IS TO BE FULLY FLUSHED AND PRESSURE TESTED PRIOR TO REINSTATEMENT. THE HEATING SYSTEM SHALL BE FULLY CHEMICALLY DOSED AND COMMISSIONED PRIOR TO HANDOVER.
- THE DOMESTIC WATER SERVICES PIPEWORK SHALL BE FULLY CHLORINATED AND A CERTIFICATE ISSUED ON COMPLETION. BALLOFIX VALVES ARE TO BE FITTED AT EACH OUTLET.
- SUPPLY AND INSTALL A NEST THERMOSTAT TO CONTROL THE HEATING AND HEATING TIMES OF THE BOILER. FINAL POSITION IS TO BE AGREED ON SITE.

EXTRACTION UNIT SCHEDULE

REF.	LOCATION	MANUFACTURER	MODEL REF.	dBA @ 3m	l/s	DESCRIPTION & ACCESSORIES.
XF1	DISABLED WC	AIRFLOW	QT100T	25	25	WALL MOUNTED FAN WITH OVERRUN TIMER. FAN CONTROLLED BY 230V-PIR MOVEMENT DETECTOR AND LIGHT SWITCH.

- CC CO2 DETECTOR
- TC NEST DIGITAL TIMECLOCK AND THERMOSTAT

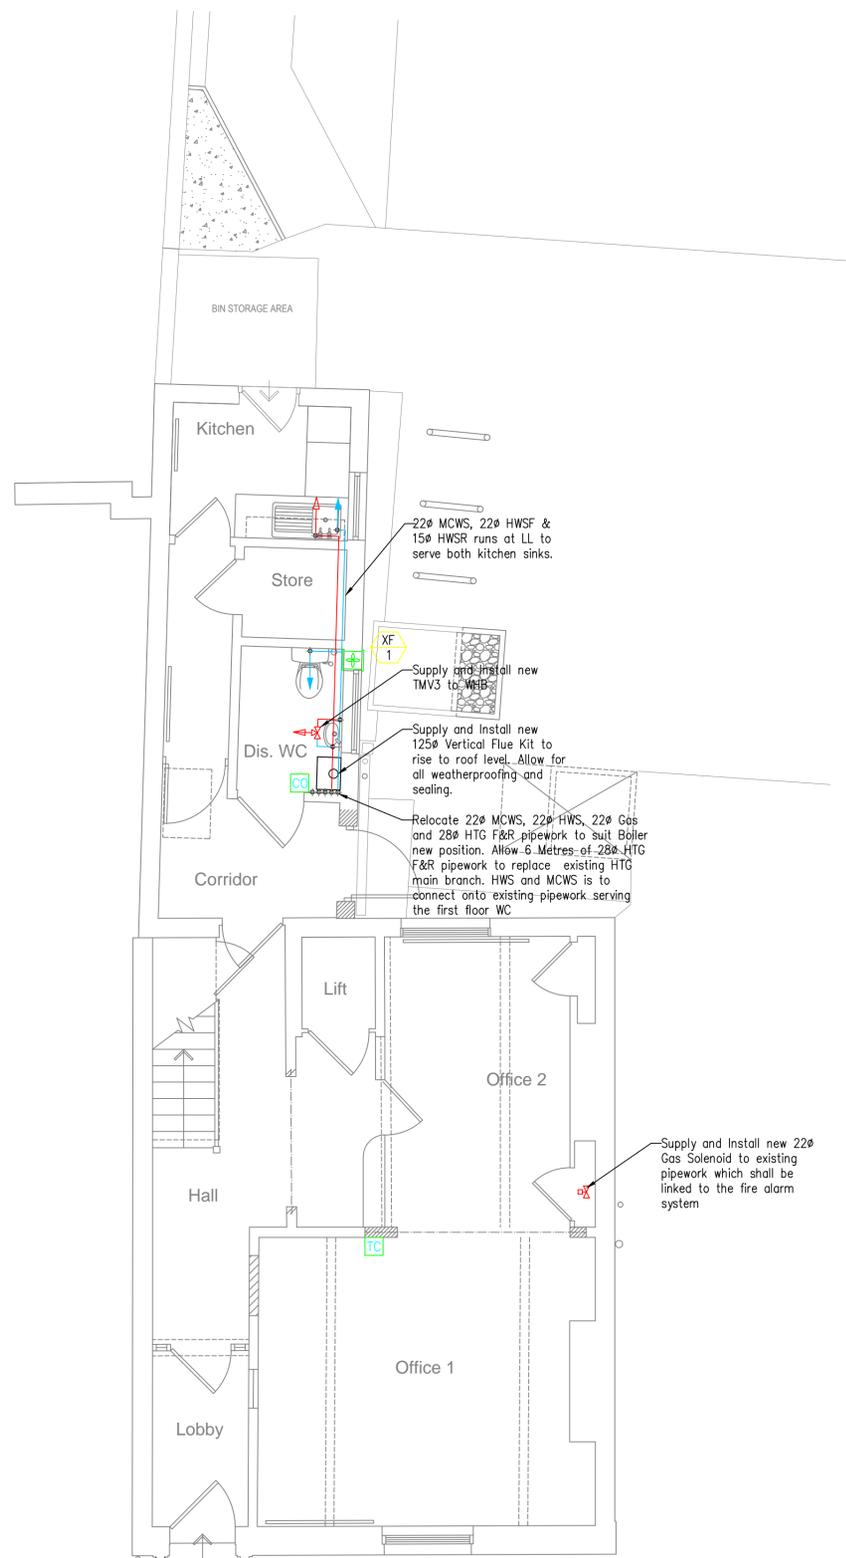

Ground Floor Plan

T1	11/05/17	TENDER ISSUE	MP	MP
REV	DATE	DESCRIPTION	BY	VE

Parsons Associates
CONSULTING ENGINEERS

River View, Great Addington Road, Little Addington,
Kettering, Northamptonshire, NN14 4BA
Tel. (01933) 652764 | Mobile. 07788 546550
Email. enquiries@parsons-consulting.co.uk

ISSUE STATUS	TENDER ISSUE		
CLIENT	NEWPORT PAGNELL TOWN COUNCIL		
PROJECT	TOWN HALL REFURBISHMENT		
DRAWING TITLE	PROPOSED MECHANICAL WORKS LAYOUT		
SCALE	DATE	BY	VE
1:50 @ A1	MAY 2017	MP	MP
DRAWING NUMBER	REV		
M001	T1		

This drawing is copyright and may not be reproduced either in part or full without written permission from Parsons Associates.
DO NOT SCALE OFF THIS DRAWING