


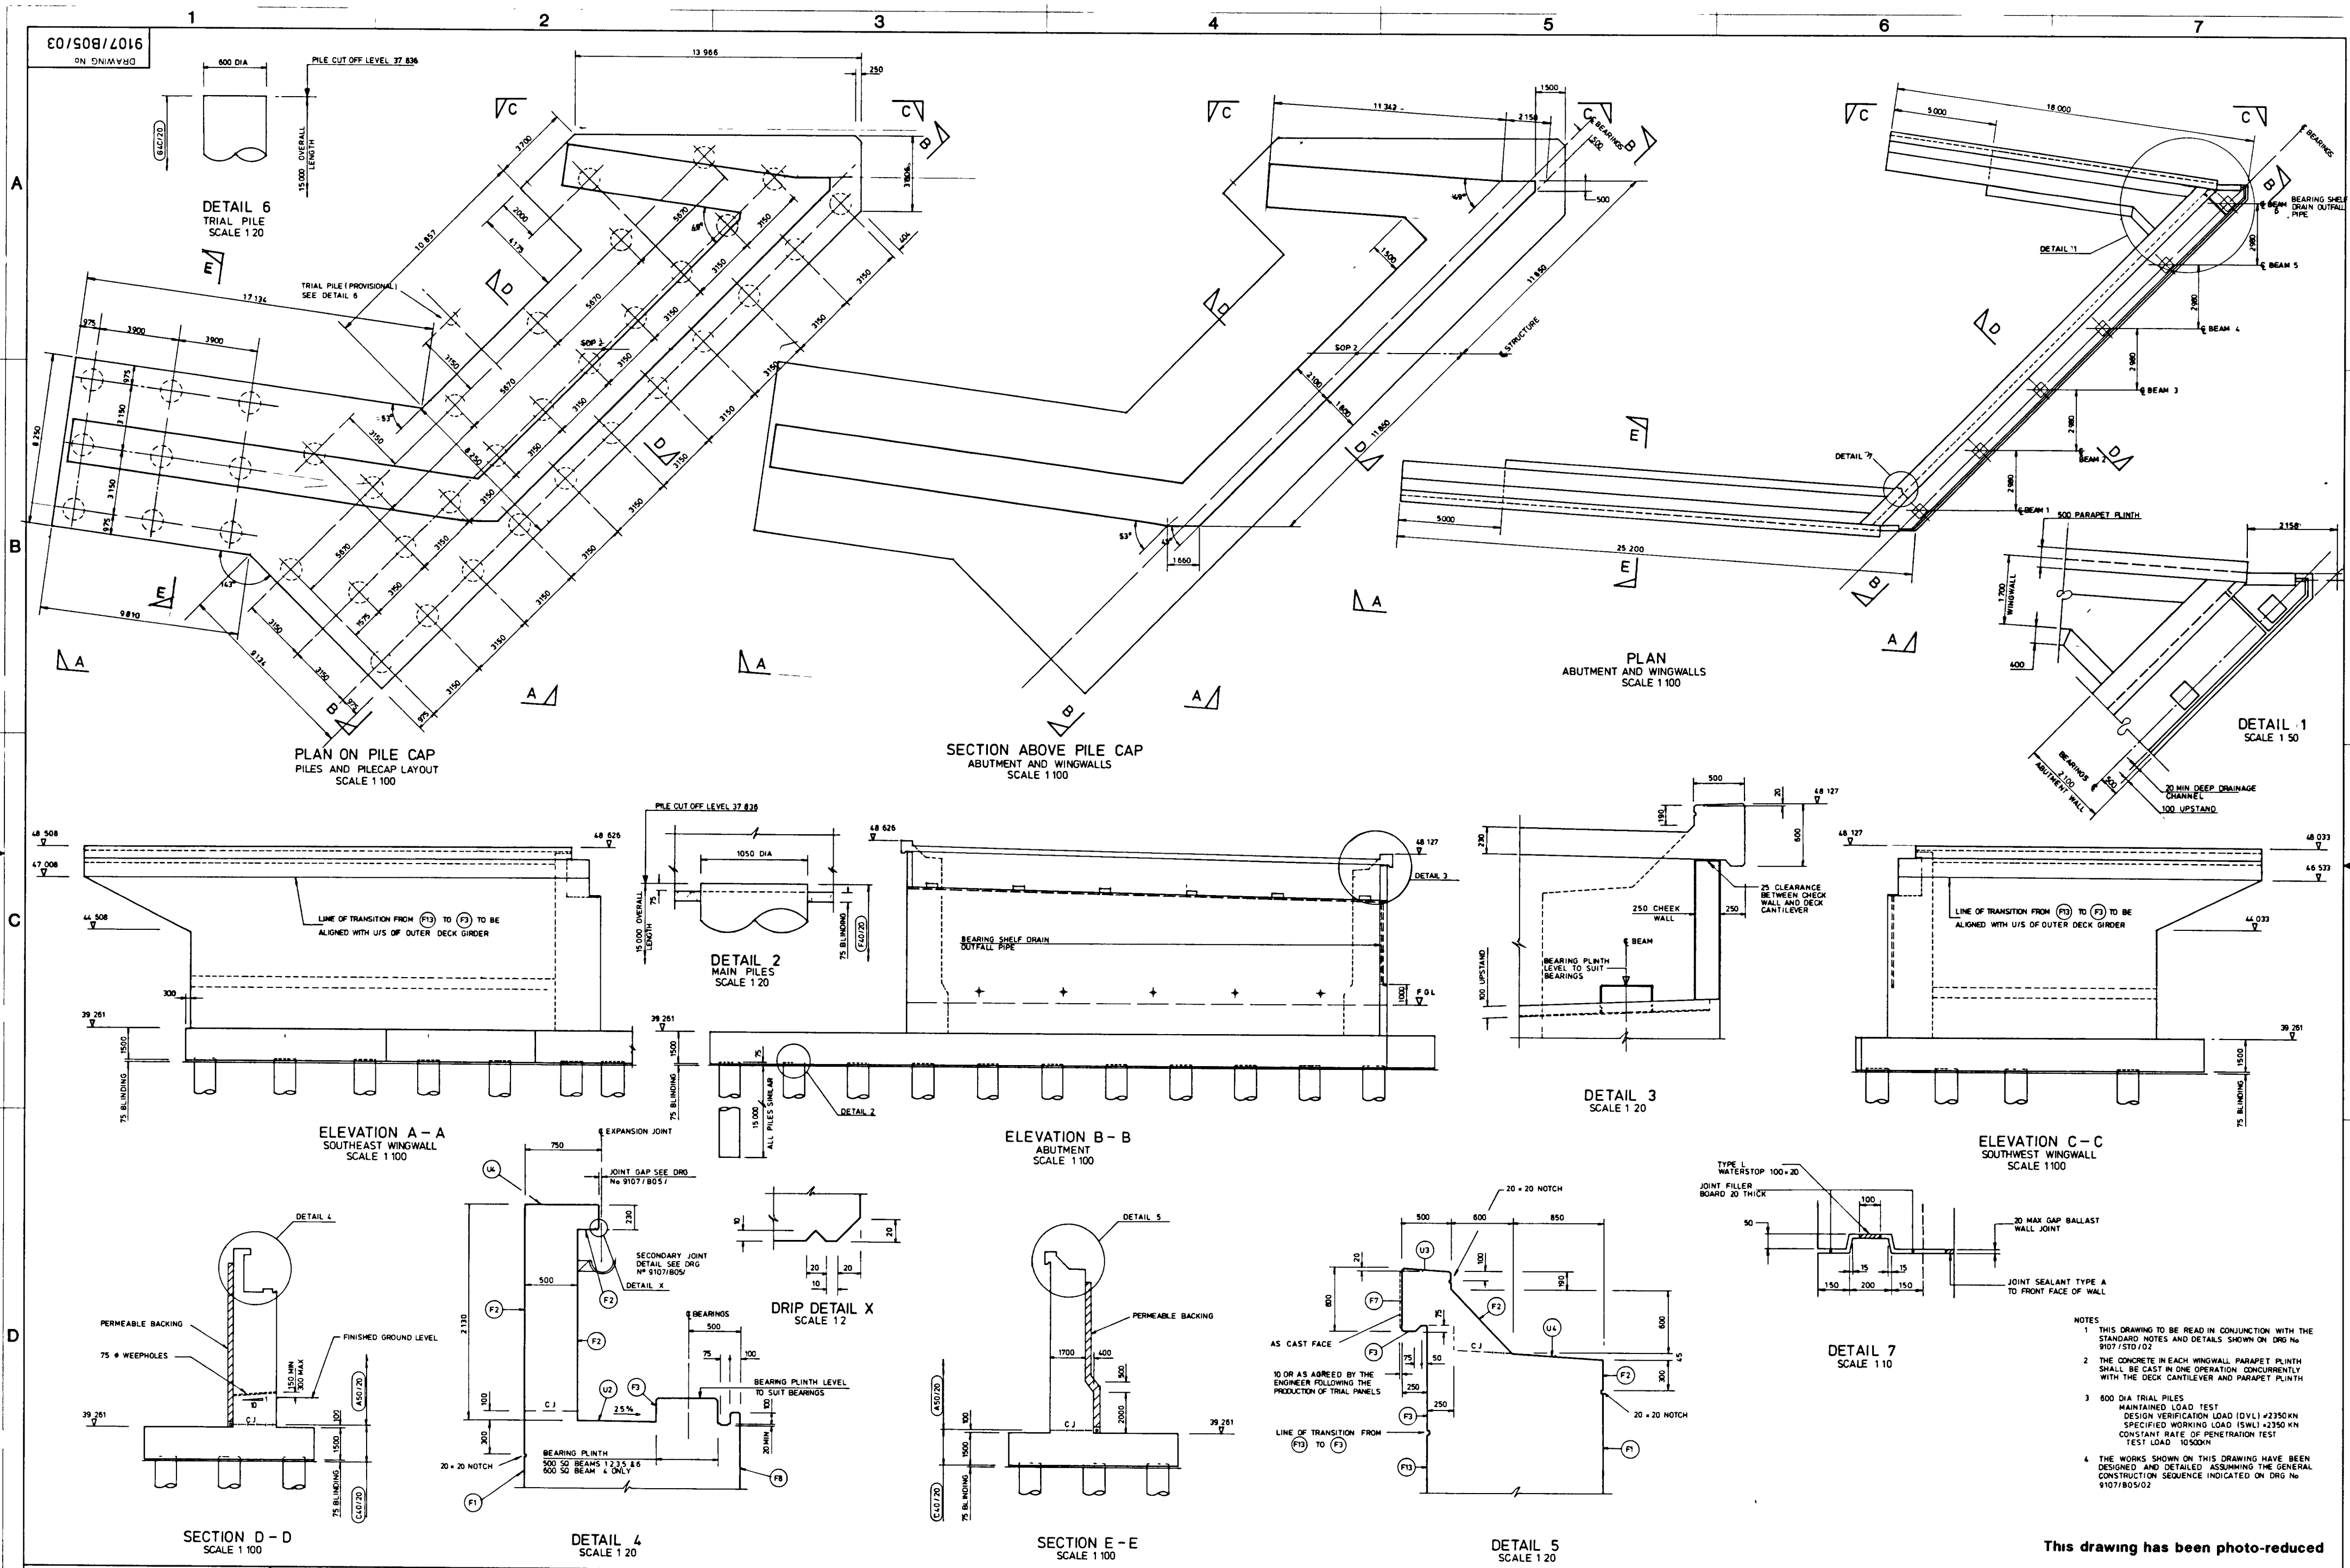

- NOTES**
- THIS DRAWING TO BE READ IN CONJUNCTION WITH THE STANDARD NOTES AND DETAILS SHOWN ON DRG No 9107/B05/02
 - THE CONCRETE IN EACH WINGWALL PARAPET PLINTH SHALL BE CAST IN ONE OPERATION CONCURRENTLY WITH THE DECK CANTILEVER AND PARAPET PLINTH
 - 600 DIA TRIAL PILES
MAINTAINED LOAD TEST
DESIGN VERIFICATION LOAD (DVL) #2350 KN
SPECIFIED WORKING LOAD (SWL) #2350 KN
CONSTANT RATE OF PENETRATION TEST
TEST LOAD 10500N
 - THE WORKS SHOWN ON THIS DRAWING HAVE BEEN DESIGNED AND DETAILED ASSUMING THE GENERAL CONSTRUCTION SEQUENCE INDICATED ON DRG No 9107/B05/02

This drawing has been photo-reduced