No:	Revision	Date	Inits
C	Wall status change in room 2-02	17.07.17	GRM
B	B. Control/ Tender Issue	21.05.17	GRM
A	Tender Issue	13.05.17	GRM

Job

NEW PARTITIONING AND ASSOCIATED WORK JUSTINIAN HOUSE, HUNTINGDON

Drawing

PLAN AS PROPOSED: GENERAL LAYOUT SECOND FLOOR

Client

ESTATES/ CAPITAL TEAM

Papworth Hospital NHS
NHS Foundation Trust

Papworth Hospital NHS Foundation Trust : Ermine Street : Papworth Everard
Cambridgeshire : CB23 3RE : Tel 01480 830541 Fax 01480 364337 www.papworthhospital.nhs.uk

Scale	Date	Drawn/Checked
AS INDICATED	06/2017	GRM
	CAD File: xxxxxx	

Job No	Dwg No	Rev
17–002	(15)	C

GENERAL SPECIFICATION:

Note that this drawing to be read in conjunction with:
17-002 (07): Ground Floor General Layout
17-002 (11): First Floor General Layout

1 - Contractor to provide 50mm dia. combined waste for new sink/ dishwasher. Investigate existing waste provision in adjacent WC's and connect accordingly. Contractor to ensure that sufficient gradient provided to satisfy local Building Control Officer and obtain approvals.

2 - Contractor to install countertop 'KUDOS' Calomax water heater (12ltr, 3KW KUD) with appropriate fused spur and water feed.

CDM RESIDUAL RISKS

ITEM	RISK
01	Risk 01. ....
02	Risk 02. ....
03	Risk 03. ....
04	Risk 04. ....
05	Risk 05. ....

GENERAL SPECIFICATION:

3 - Provide new kitchen installation, from Howden Range - Greenwich Gloss White:
1x 1000w sink base unit
1x 600w draw base unit with 3No draws
1x worktop sufficient to cover required area: Dark Granite effect
1x single bowl/ drainer ss sink with plug, waste, trap and monoblock mixer tap
1x 600h x 600w wall units

Install 150x150 ceramic tile splash back min 300mm tall, with silicone sealed abutment at worktop.

4 - Provide spur shelving uprights and brackets with 300 deep Conti Board shelves as indicated. Note that bottom shelf to be set at 1600mm ffll, with a 350mm space between the two shelves.

5 - All new partitions to be prepared ready to receive painted decorations. Apply 1x mist and 2x top coat vinyl matt paint to match main walls of building and provide 1x undercoat and 2x gloss finish to any new joinery (skirting boards, door frames, architraves etc).

Paintwork generally: Ensure that all new paintwork complies with colour contrast requirements as suggested in Approved Document Part M of the Building Regulations, with special emphasis on door openings and any change in surface.

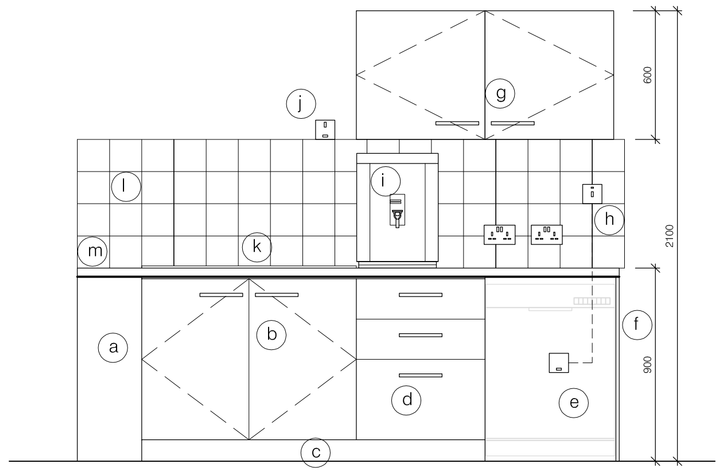

2 GENERIC KITCHENETTE ELEVATION
SCALE: 1:20

KITCHENETTE AREA:

Note: This may vary from floor to floor and require review to ensure the principles of the layout are installed.

a - Infill panel to suite individual location
b - 1000wide sink base unit
c - plinth board
d - three draw base unit
e - 610mm wide space for dishwasher
f - decor end panel
g - wall units with internal shelves
h - fused spur and isolator switch for dishwasher
i - Calomax hot water boiler
j - fused spur power supply for water boiler
k - stainless steel sink and tap
l - ceramic wall tiling
m - worktop

Water: Contractor to ensure compliance with HSG274/ L8 and undertake water testing on all new connections for TVC's, Legionella, Coliforms and Ecoli. All results to be handed to Trust compliance manager to prove system is free of contamination. Provide evidence of flushing records during the construction phase of the works.

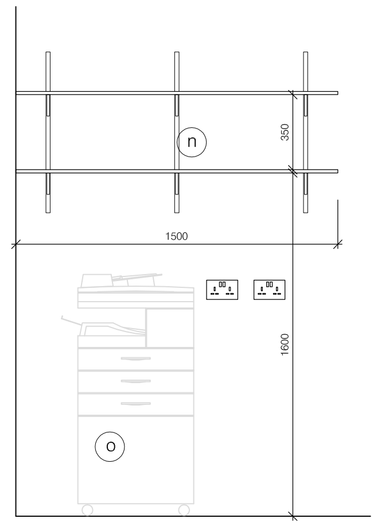

3 GENERIC COPIER ELEVATION
SCALE: 1:20

PHOTOCOPY AREA:

Note: This may vary from floor to floor and require review to ensure the principles of the layout are installed.

n - refer to plans and install shelving and support brackets as noted, and to the lengths as proposed.

o - generic Trust supplied Multi Function Device. If specific data required, Trust to advise contractor accordingly, however this may form part of a post practical completion handover.
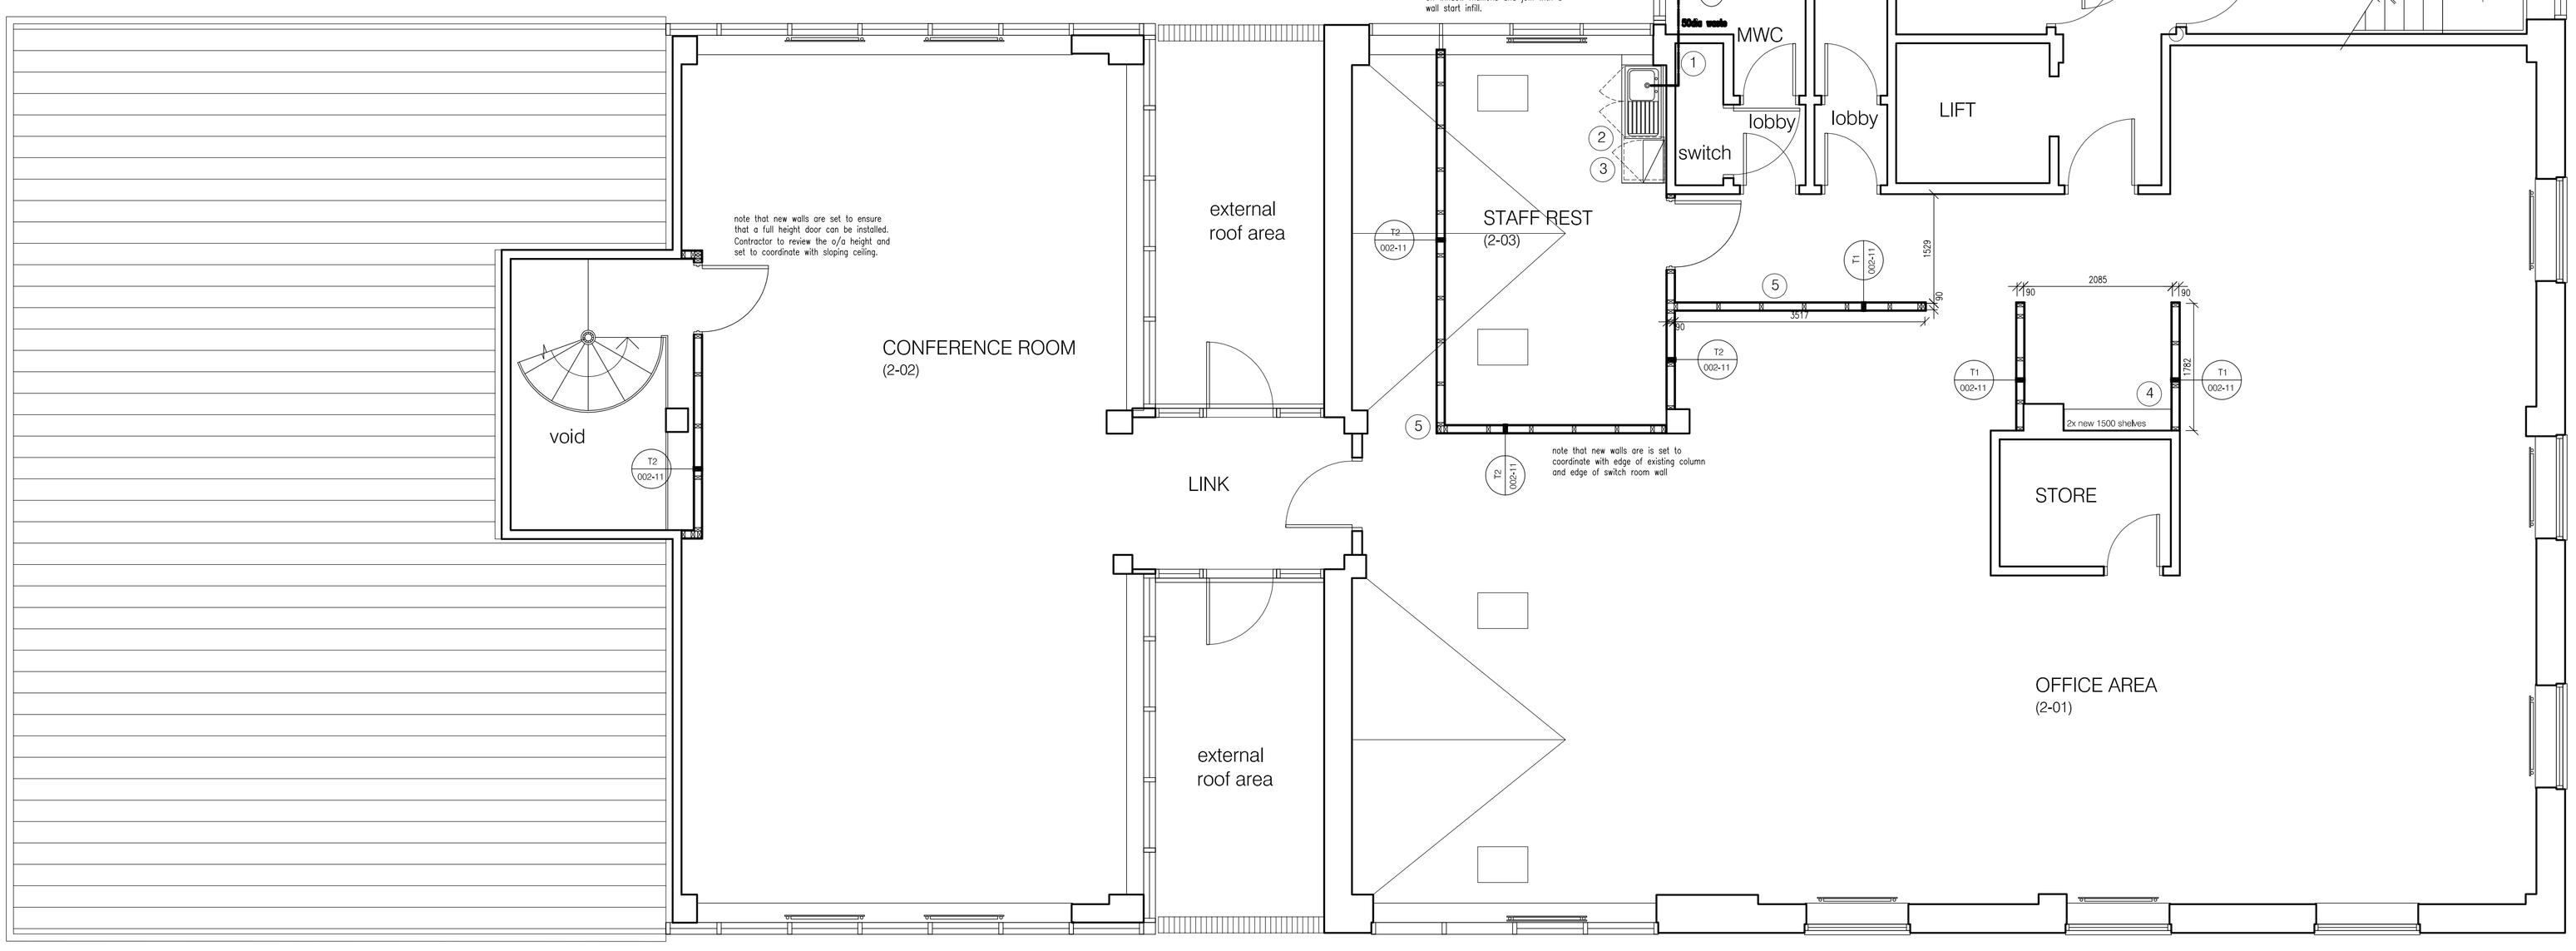
1 PLAN AS PROPOSED
SCALE: 1:50