



PLAN (1:100)

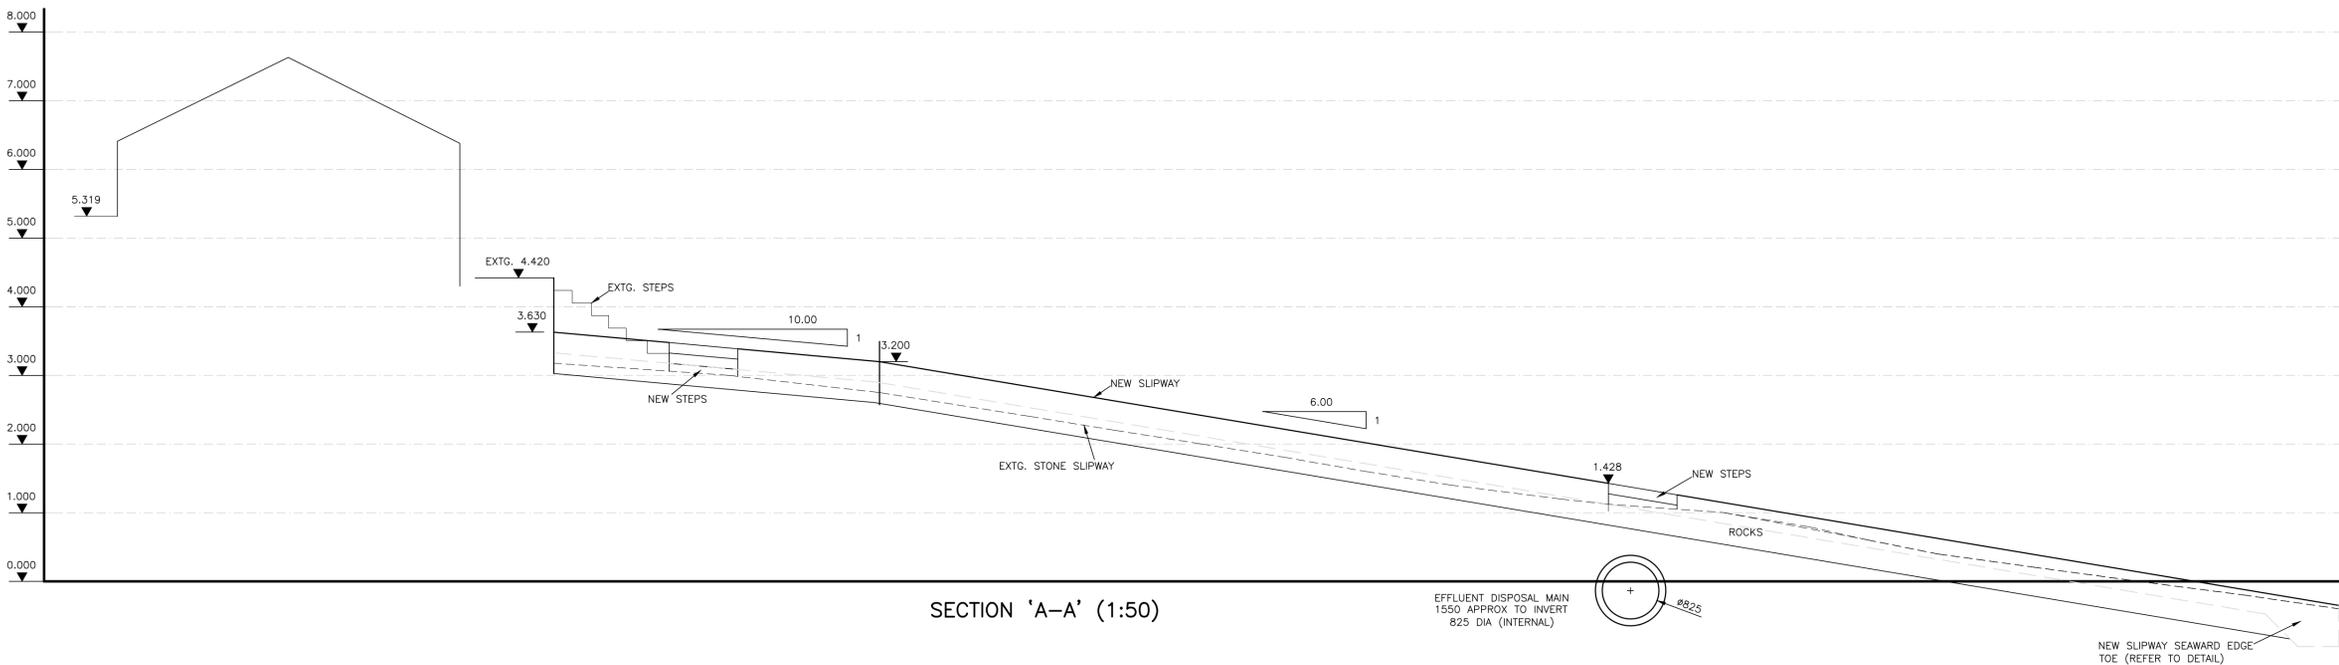


SECTION 'A-A' (1:50)

HEALTH & SAFETY: SIGNIFICANT RISKS/SPECIFIC METHODS OF CONSTRUCTION/FUTURE MAINTENANCE ISSUES.

- GENERAL NOTES**
1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, ENGINEERS, SERVICES AND SPECIALIST DRAWINGS AND THE SPECIFICATION.
 2. ANY DISCREPANCIES IN DIMENSIONS OR DETAILS ON OR BETWEEN THESE DRAWINGS SHOULD BE DRAWN TO THE ATTENTION OF THE ARCHITECT AND/OR THE ENGINEER IN WRITING FOR CLARIFICATION.
 3. ALL DIMENSIONS ARE IN MILLIMETRES. ALL LEVELS ARE IN METRES UNLESS NOTED OTHERWISE. DO NOT SCALE THIS DRAWING.

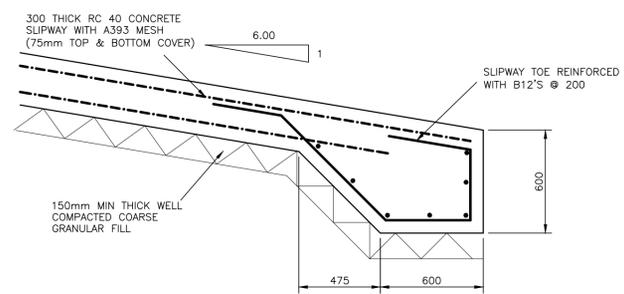

NEW SLIPWAY EDGE THICKENING TYPICAL DETAIL (1:20)

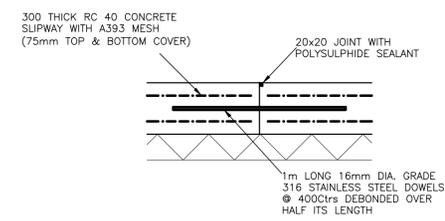

TYPICAL DETAIL - NEW SLIPWAY CONSTRUCTION JOINT (1:20)

- CONCRETE**
4. CONCRETE FOR INSITU FILL AND PRECAST SLABS SHOULD CONFORM TO BS8500-2, BS EN 12620 & BS EN 206 WITH THE FOLLOWING REQUIREMENTS:-
 COMPRESSIVE STRENGTH - C40/50
 MAX. AGGREGATE SIZE - 20mm
 CHLORIDE CLASS - CL 0.40
 CONSISTENCE CLASS - S3
 MAX. WATER/CEMENT RATIO - 0.40
 MIN. CEMENT OR COMBINATION CONTENT - 425kg/m³
 CEMENT OR COMBINATION GROUP - CEM III-B or III-A
 ADMIXTURE - SIKAFERROGARD 901 CORROSION INHIBITOR, 12 l/m³.
 NOMINAL COVER TO REINFORCEMENT - 75mm (EXCEPT WHERE NOTED OTHERWISE)
 5. WHERE REQUIRED IN ACCORDANCE WITH THE CONSTRUCTION PRODUCTS REGULATIONS (CPR), CEMENT, REINFORCEMENT, PRECAST CONCRETE ELEMENTS & OTHER CONCRETE RELATED PRODUCTS, SHALL CONFORM TO THE SPECIFIED CRITERIA OF THE CPR AND TO BE CE MARKED ACCORDINGLY.
 6. CONCRETE SHALL BE WELL COMPACTED BY MEANS OF A MECHANICAL VIBRATOR.
 7. REINFORCEMENT TO BE GRADES B500B OR B500C TO BS4449
 8. CONCRETE TO BE OBTAINED FROM PLANT HOLDING CERTIFICATION MEETING REQUIREMENTS OF THE NACCB CAT 2.

TENDER
 20th. FEBRUARY 2018
 THIS DRAWING SUPERSEDES EARLIER ISSUES OF THIS DRAWING WHICH SHOULD BE DESTROYED.

Revision	Suff	App'd	Date
CONSTRUCTION JOINT INDICATED DETAIL ADDED	T2	IF	20.02.18
DCC COMMENTS INCORPORATED. ISSUED FOR TENDER	T1	IF	16.02.18
PRELIMINARY ISSUE FOR COMMENT.	P1	IF	16.02.18

Project
FISHERMANS SLIPWAY SWANAGE

Drawing Title
PROPOSED SLIPWAY EXTENSION PLAN & SECTION A-A

SMITH FOSTER
 Consulting Civil and Structural Engineers
 Suite 8, Branksome Park House
 Branksome Business Park
 Bourne Valley Road
 Poole BH12 1ED
 Tel +44 (0) 1202 540888
 Fax +44 (0) 1202 540044
 Website: www.smithfoster.com
 e-mail eng@smithfoster.com

Drawn	Date	Checked	Date
AKS	FEB. 18	IF	
Scale		1:100 1:50	
Drawing Number		69011/04	
Rev		T2	