


Existing floors to have the existing floor covering and boarding removed. Lay 100mm Isover Spacesaver insulation between the existing joists. Provide and lay 19mm Gyproc Plank board supported on Gyproc SIF Floor Channel fixed over existing joists and cover with 22mm T&G chipboard flooring. Existing ground floor ceilings to be lined with 15mm Gyproc Firlene plasterboard with joints taped and sealed at all edges and perimeter with intumescent sealant to achieve 60 min fire rating. 25x50mm battens fixed over board to create cavity for services and then lined with 12.5mm plasterboard and skim finish. dB Rating: Impact - 63dB Airbourne - 54dB. All to comply with Approved Document Part E.

8h New sliding/folding fire doors, manufacturer to be confirmed, doors to be top hung with recessed track to floor. Doors to be provided with suitable fire and smoke seals to provide 30min fire resistance. Doors to meeting room to be acoustic to provide sound reduction between rooms.

30 New compliant step and ramp arrangement to rear access doors, see drawing No. 40 for details.

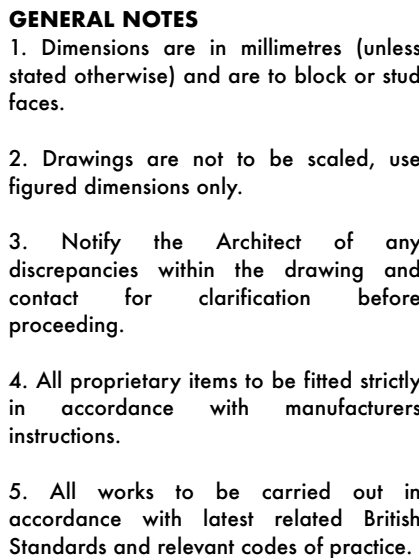

RIBA 
Chartered Practice

12A William's Walk, Colchester, Essex, CO1 1TS
T: 01206 578732
E: mail@dcbbarchitects.co.uk
W: www.dcbarchitects.co.uk

 **CIAT**
CHARTERED PRACTICE