



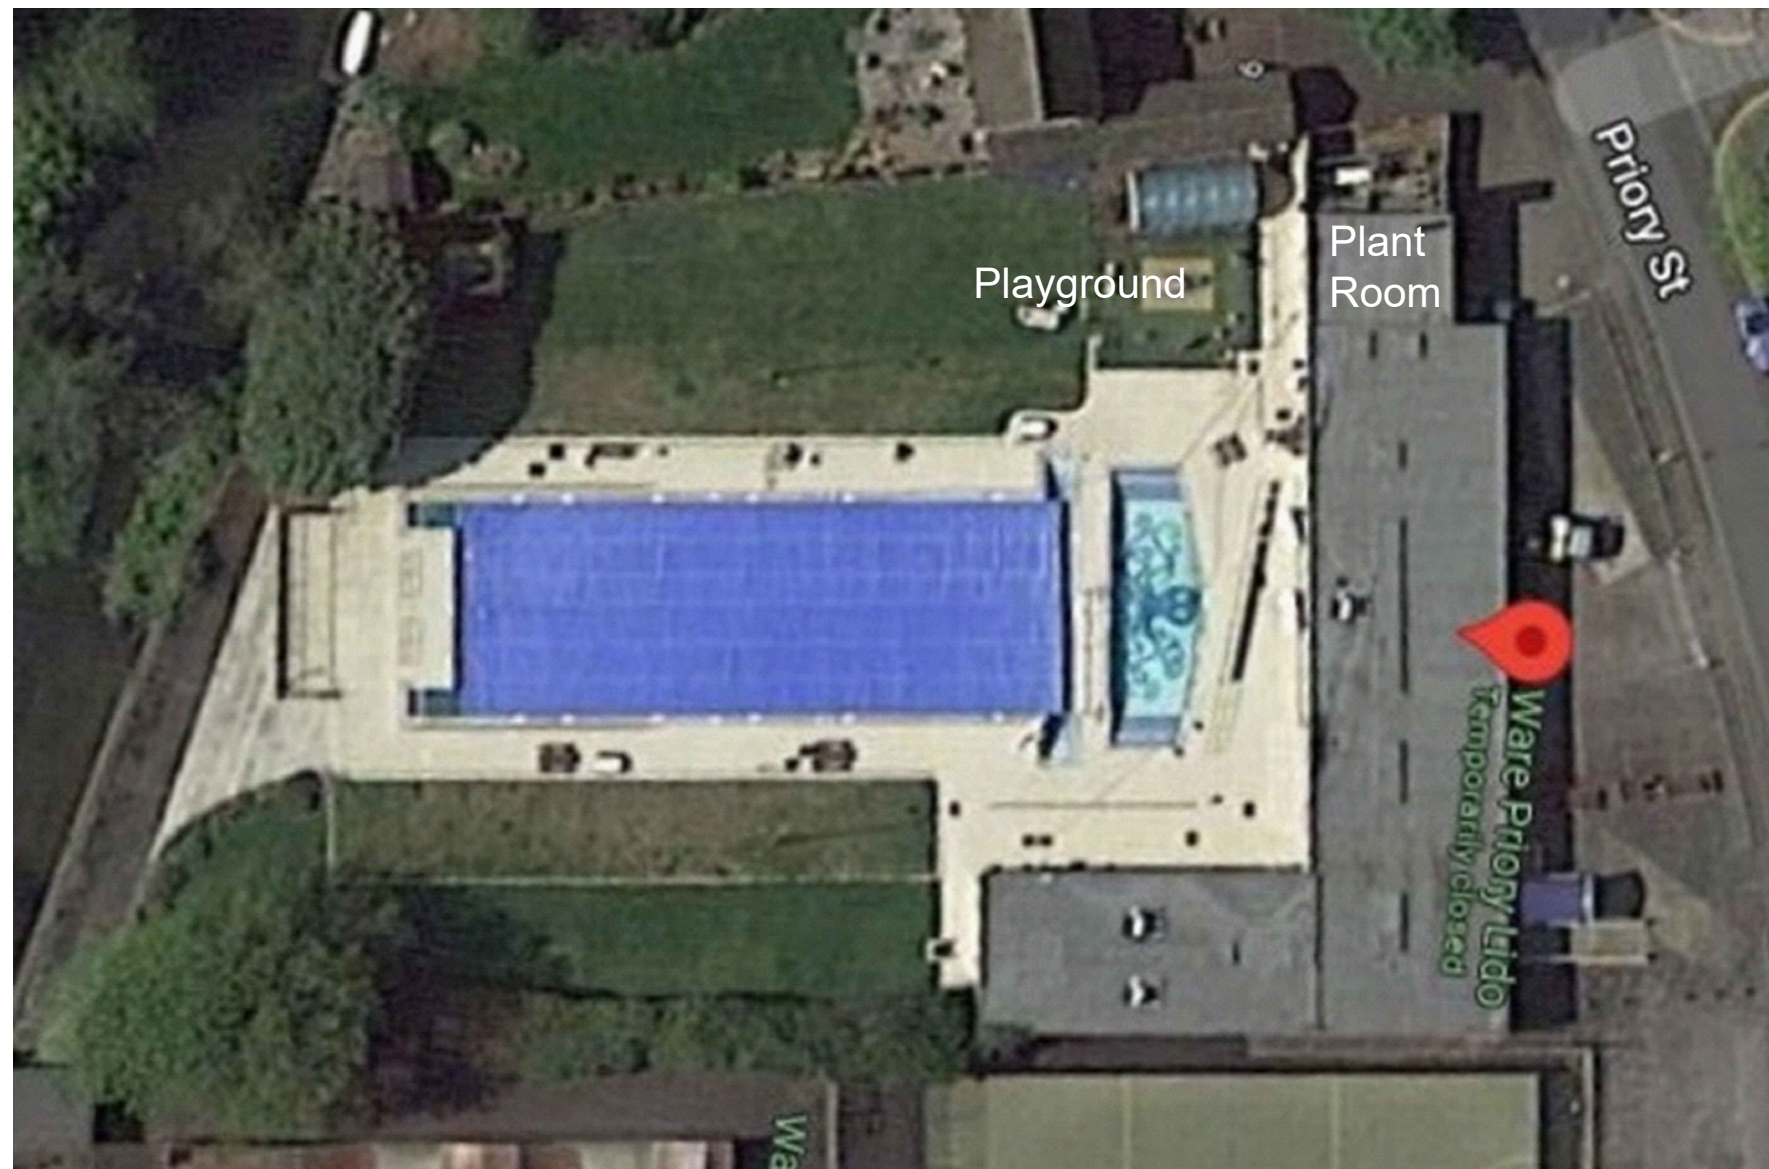

SITE PLAN - EXISTING POOL

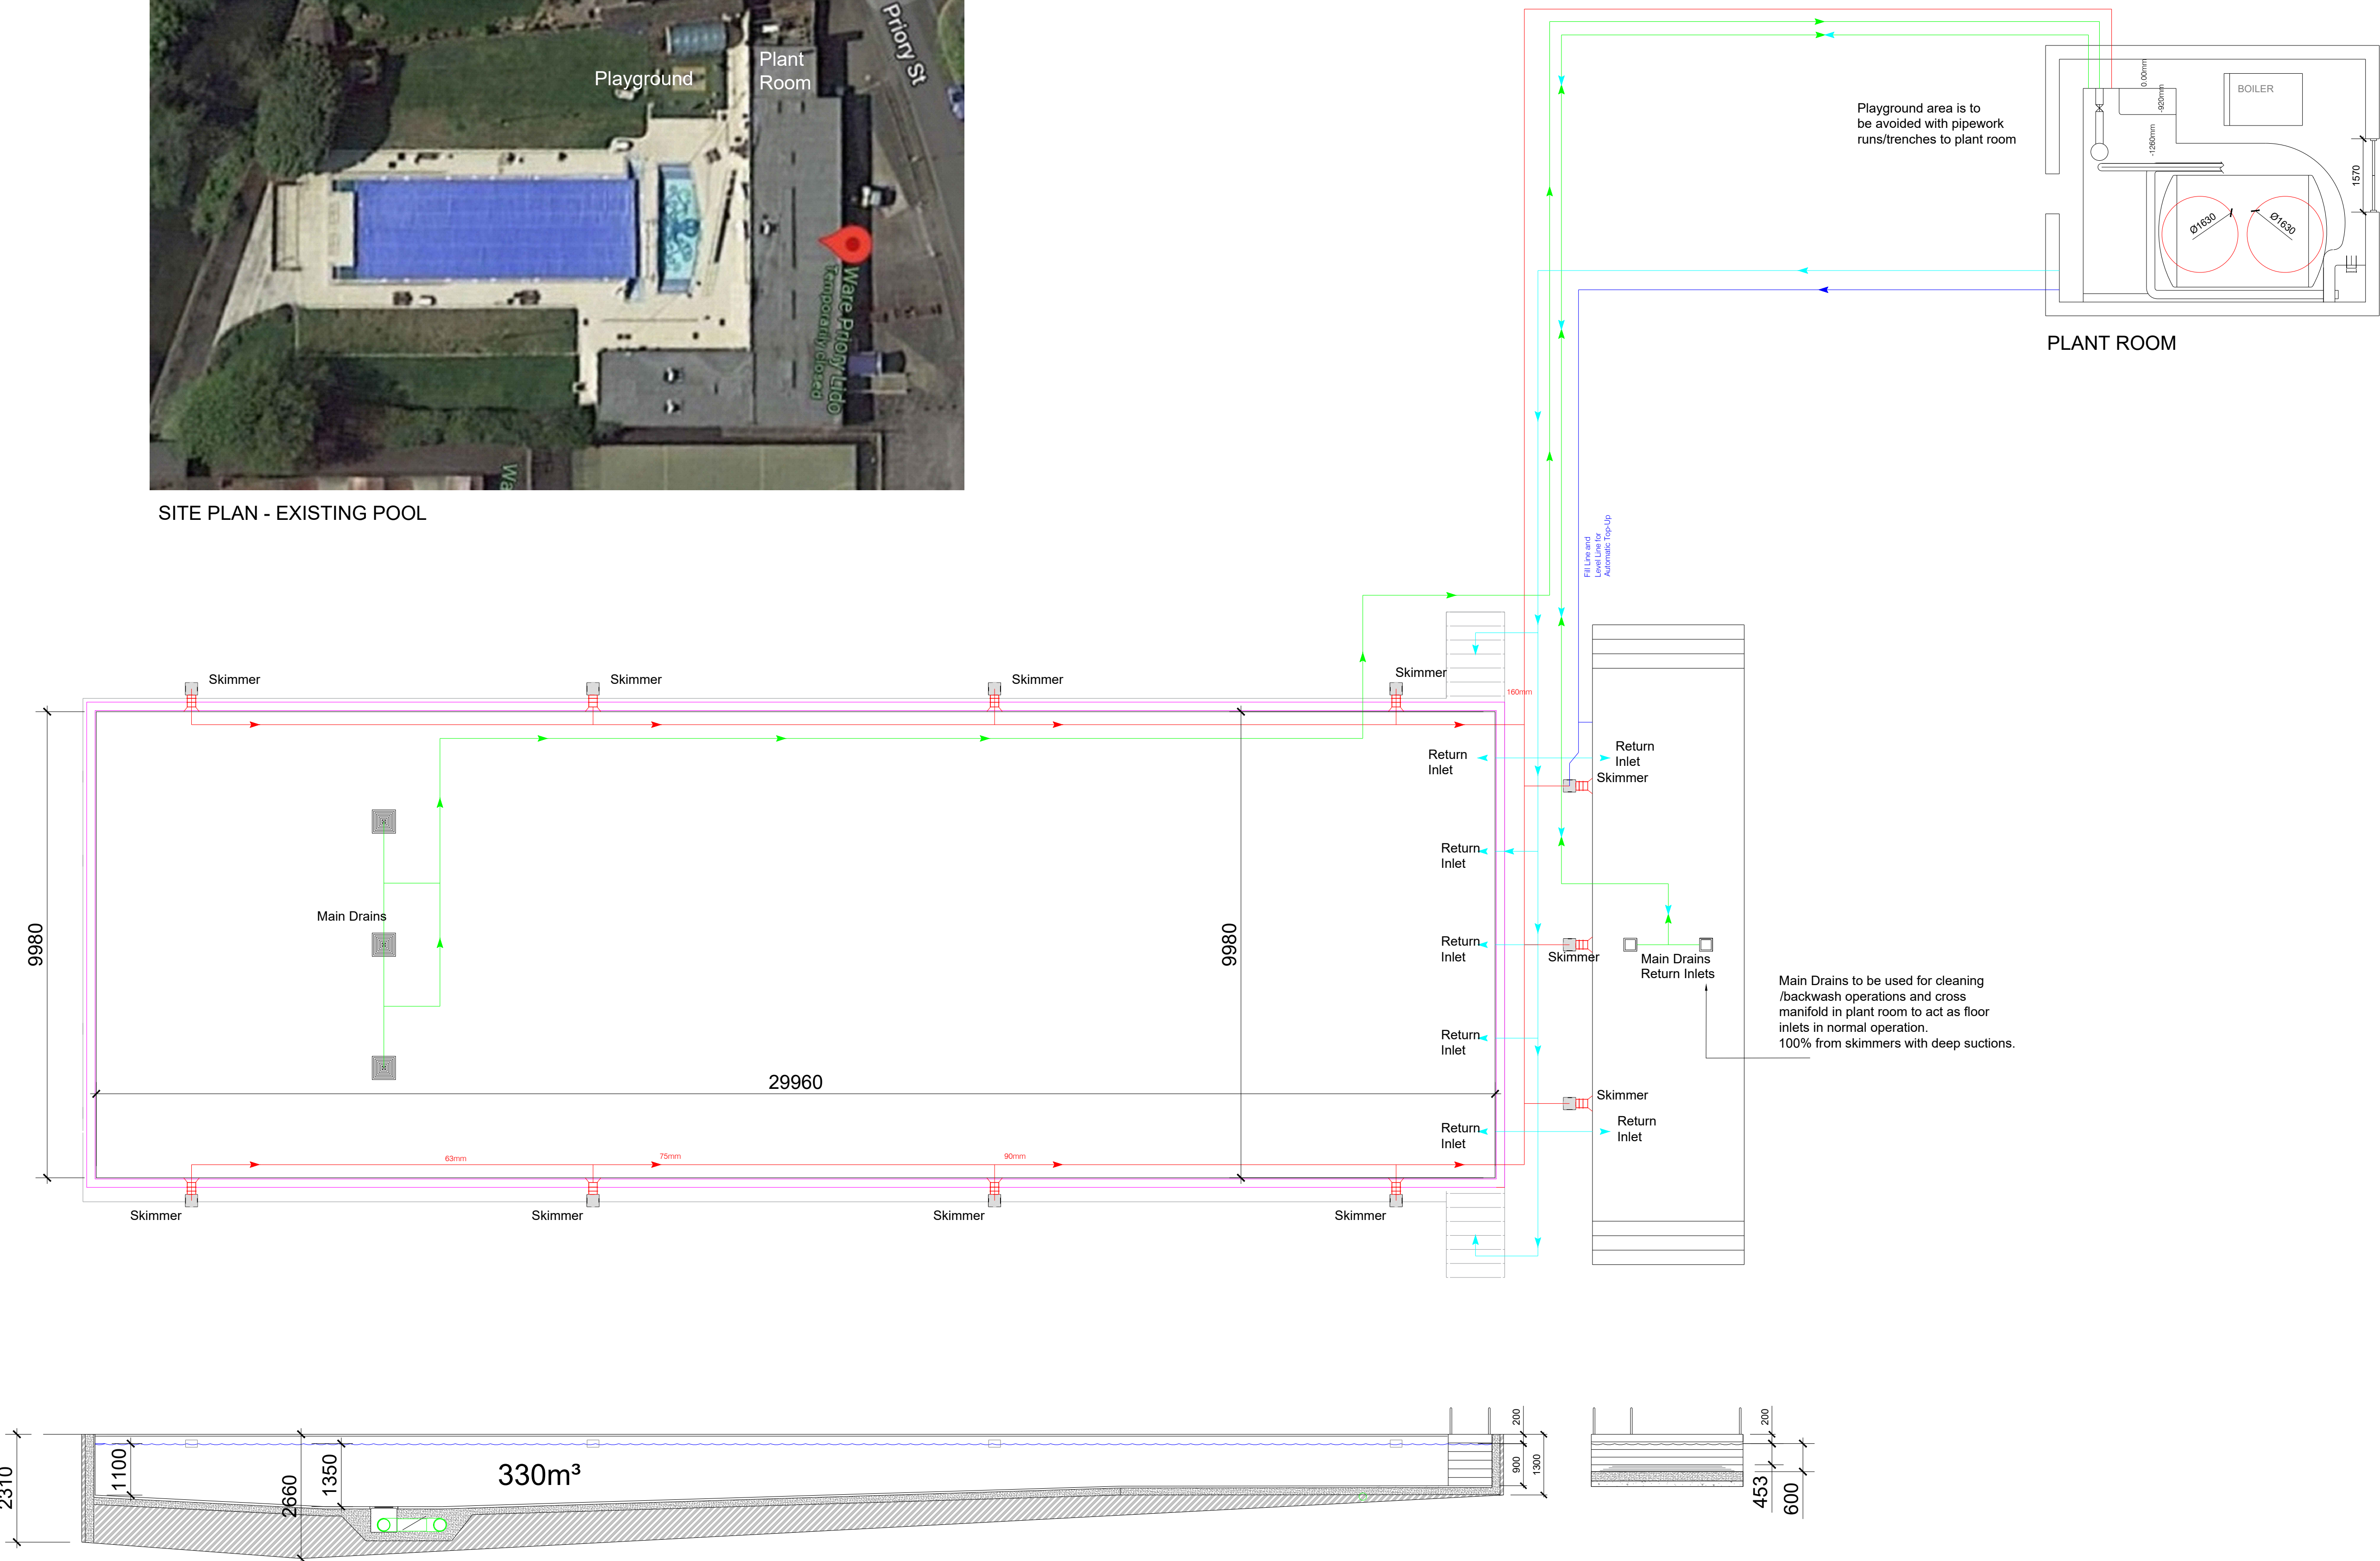

General Notes

Existing Main Pool Capacity: 555m³
Existing Teach Pool Capacity: 30m³
Total: 585m³
Turnover Rate: Approx. 6.5 hours

Proposed Pool Capacity: 352m³
Turnover Rate: 3.5 - 4 hours

Proposed Flow Rate: 93m³/hr Max

Suction Pipework: 160mmØ
2No 1600mmØ Filters @ 2.01m² ea
Total Filter Area: 4.02m²
Filtration Rate: 23.1m³/hr/m²

Revision Date and Description

HYDROSPEC
SWIMMING POOL ENGINEERS

UNIT 1, 41 TALLON ROAD
HUTTON INDUSTRIAL ESTATE
BRENTWOOD
ESSEX
CM13 1TG
TEL: 01277 225416
E-mail: info@hydrospec.co.uk

PROJECT

Ware Prior Lido
Hertfordshire

REF: LIDO POOL PROPOSALS - SCHEMATIC

FEBRUARY 2022 DRAWING NUMBER

NOT TO SCALE: **HYD/WPL/003**