


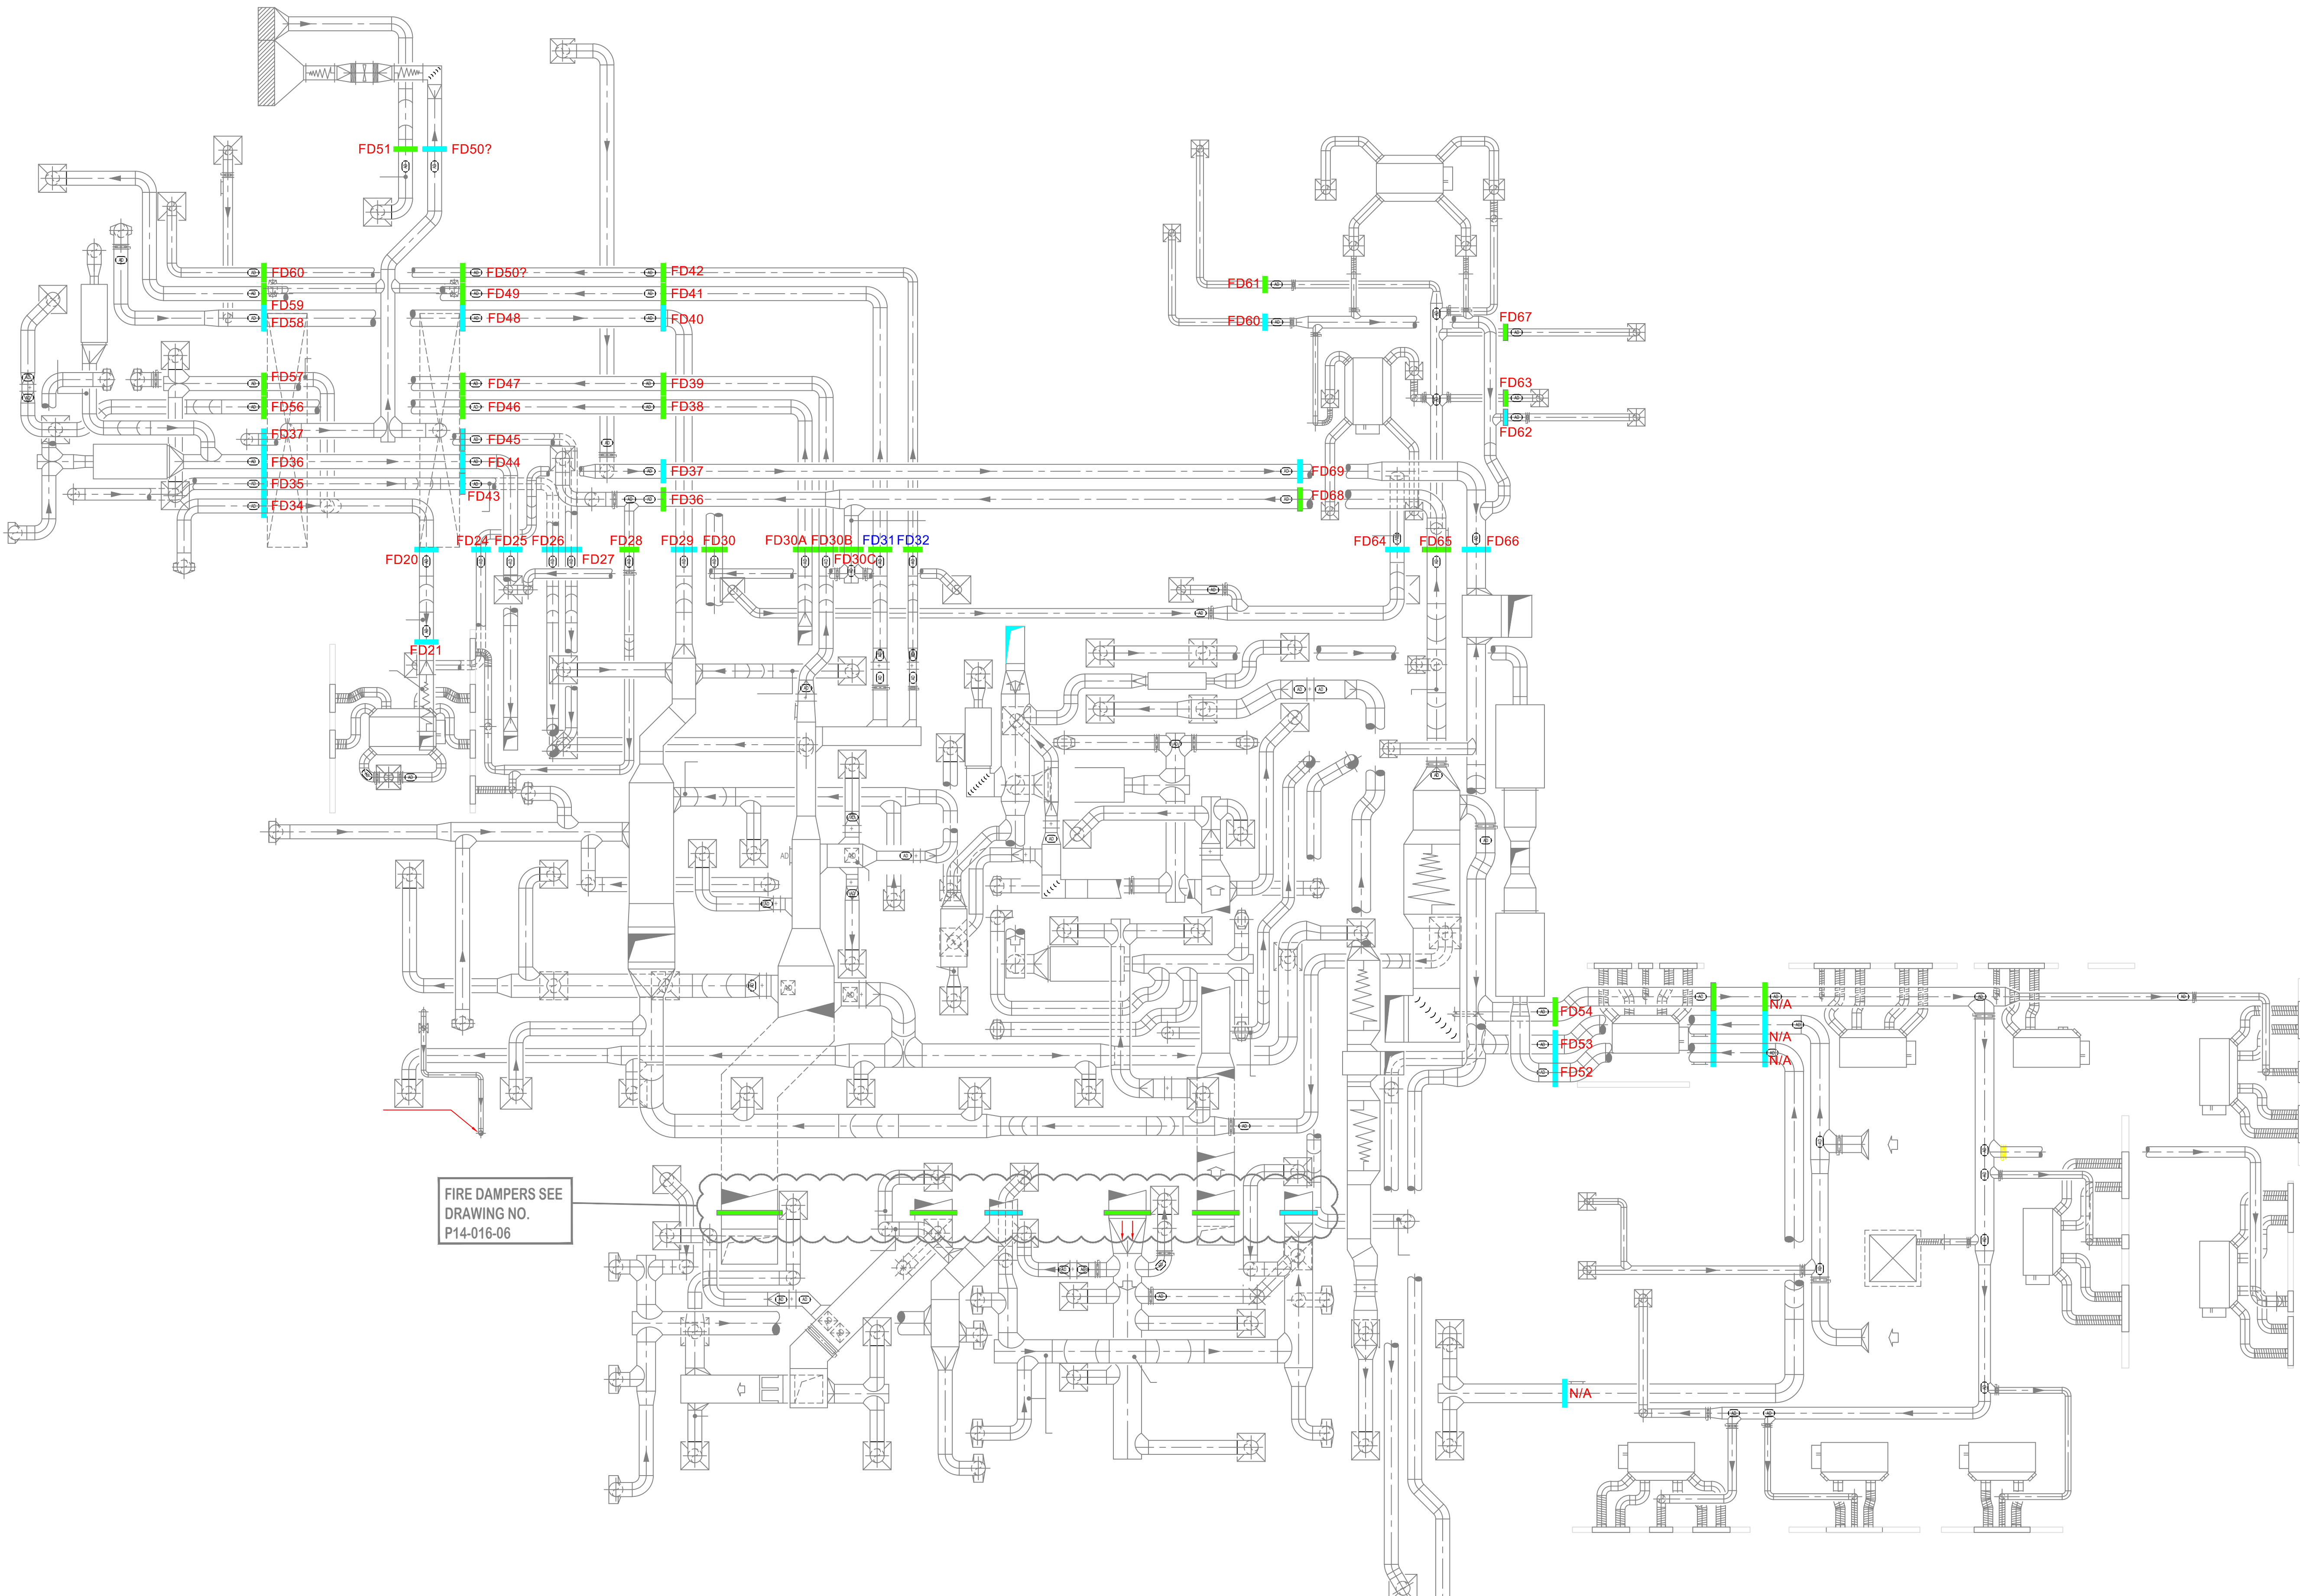

LEGEND

FD FIRE DAMPER - SUPPLY

FD FIRE DAMPER - EXTRACT

STATUS:	B	Fire damper ref numbers added from 2014 Sys Hygienics survey	AGB	12-06-16
	A	For information	AGB	17-07-14
	REV:	DESCRIPTION:	BY:	DATE:
MASTER				
NIBSC Confidence in Biological Medicines National Institute for Biological Standards and Control Blanche Lane, South Mimms, Potters Bar, Hertfordshire, EN6 3SD Tel: +44 (0)707 641000 Fax: +44 (0)707 641000 Website: www.nibsc.org				
PROJECT: South Mimms Main Intake Grilles, Ductwork and Fire Damper Survey				
TITLE: CBRM Distribution Level Ductwork & Fire Damper Locations				
DRAWN: AGB		DATE: 05-06-14		
CHECKED:		DATE:		
SCALE: 1:50		SHEET: A0		
DRAWING No: P14-016-07				REV: B