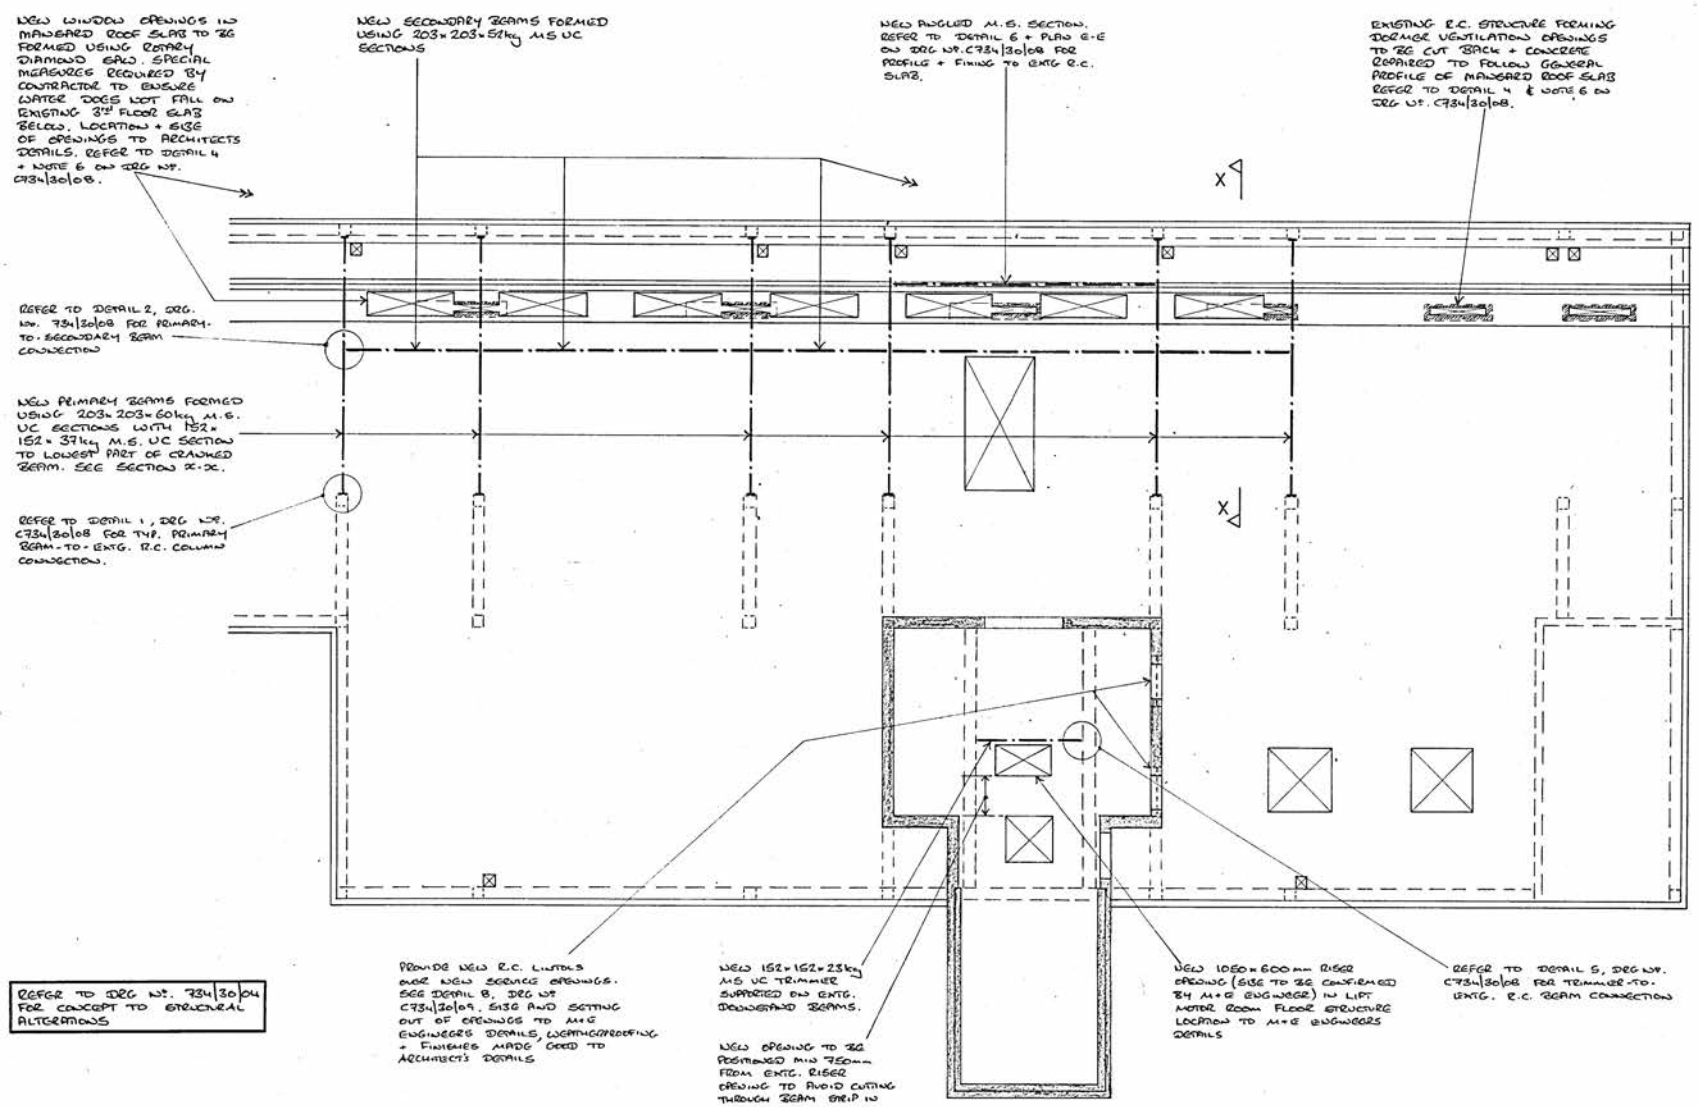

REFER TO DRG NO. 734/30/04 FOR CONCEPT TO STRUCTURAL ALTERATIONS

Notes:

1. THIS DRAWING IS TO BE READ IN ACCORDANCE WITH ALL RELEVANT ARCHITECTS AND ENGINEERS DRAWINGS, AND THE SPECIFICATION.
2. REFER TO DRG NO. C734/30/07 FOR SECTION X-X.
3. CONCRETE FOR LINTOLS AND CONCRETE REPAIRS TO BE 1:1½:3 BY VOLUME, PORTLAND CEMENT (PC 42.5): SAND: AGGREGATE MIX. DO NOT USE MARINE AGGREGATES.
4. THE MATERIALS + WORKMANSHIP FOR CONCRETE WORKS TO BE IN ACCORDANCE WITH BS 8110: PART 1 EXCEPT AS STATED ABOVE.
5. MILD STEELWORK IN THE WORKS TO BE GRADE S275 TO BS EN 10 025. MATERIALS + WORKMANSHIP TO BS 5950: PART 2.
6. CORROSION PROTECTION SYSTEM FOR MILD STEELWORK

   TWO COATS SHOP-APPLIED EPOXY ZINC PHOSPHATE PRIMER (EACH WITH MEAN DFT-FILM THICKNESS = 75µm) WITH TOUCH UP ON ENDS OF DAMAGED AREAS (MEAN DFT-FILM THICKNESS = 150µm). OTHER SITE COATINGS TO ARCHITECTS DETAILS.
7. THE CONTRACTOR SHALL ENSURE THAT THE STABILITY OF THE BUILDING IS MAINTAINED AT ALL STAGES OF CONSTRUCTION. HE SHALL DESIGN, MAINTAIN & INSTALL ALL NECESSARY TEMPORARY WORK AND PROGRAMME THE WORKS ACCORDINGLY.
8. ALL BOLTS TO BE GRADE 8.8 TO BS 4190
9. REFER TO SECTION A-A DRG NO. 734/30/08 FOR RESIN ANCHOR SPECIFICATION.
10. ALL WELDS TO 6mm CONTINUOUS FILLET WELD UNO. TO BS 6135 AND BS 4570 AS APPROPRIATE USING CONSUMABLES WHICH GIVE A WELD DEPOSIT WITH MECHANICAL PROPERTIES NOT LESS THAN THE MINIMUM SPECIFIED FOR THE PARENT METAL. SITE WELDING IS NOT PERMITTED.

Rev:	Date:	Amendment:
	20.2.97	ISSUED TO CONTRACT
	19.1.97	ISSUED FOR BUILDING CONTROL SUBMISSION
	15.1.97	ISSUED FOR TENDER.

ALAN BAXTER & ASSOCIATES
CONSULTING ENGINEERS
14-15 COWCROSS STREET, LONDON EC1M 6DR
TELEPHONE: 0171 250 1555 FAX: 0171 250 3022

Job:
IMPERIAL WAR MUSEUM - DEPARTMENT OF DOCUMENTS REFURBISHMENT

Dwg Title:
PROPOSED ROOF PLAN

Scale: (original - A1)	Date:	Drawn:
1 : 50	SEPT 96	Checked:

Dwg No. C734 / 30 / 06 Rev:

© COPYRIGHT