



*Concrete cover slab can be substituted for type-1 sub base when in landscaped areas with no vehicle access. **Minimum pipe cover to be 900mm in access roads and 1200mm min in highway.

Temporary cap to provided to inspection chamber shaft during construction to prevent debris and run off entering system.


PVC Small Dia. Chamber Construction Details

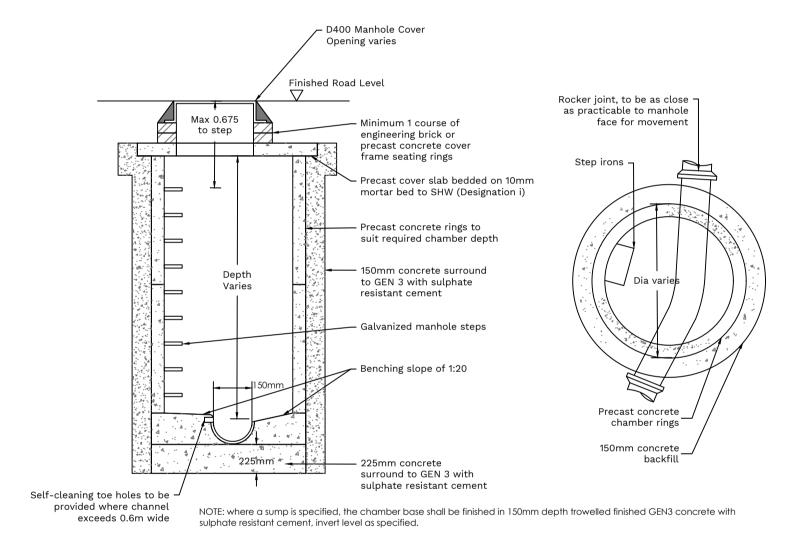


PCC Chamber Details (NTS)

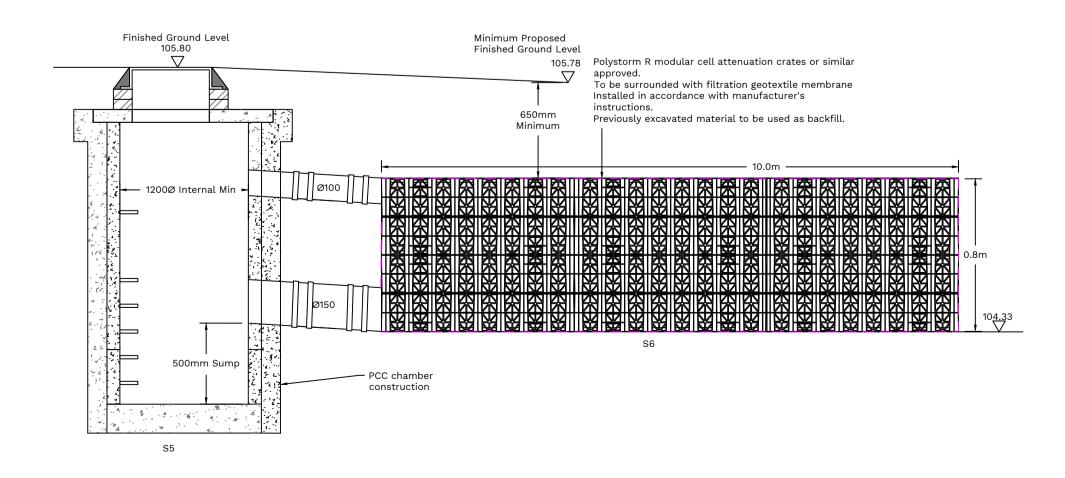

Private Soakaway Detail S7

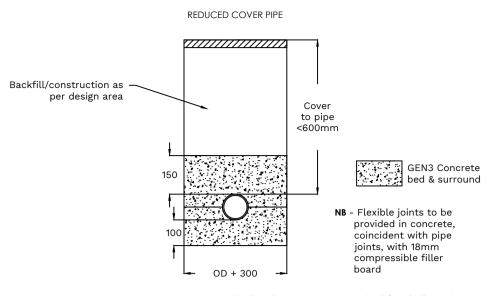



Note: concrete bed and surround not required for shallow pipes in patio and garden area

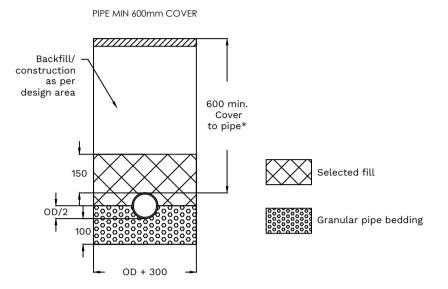

*Minimum cover increased to 900mm in access roads and 1200mm in highway. Where desirable cover is not met, a reinforced concrete cover slab shall be provided to the pipe backfill, compressible filler board required between cover slab and backfill.

Pipe Construction Details

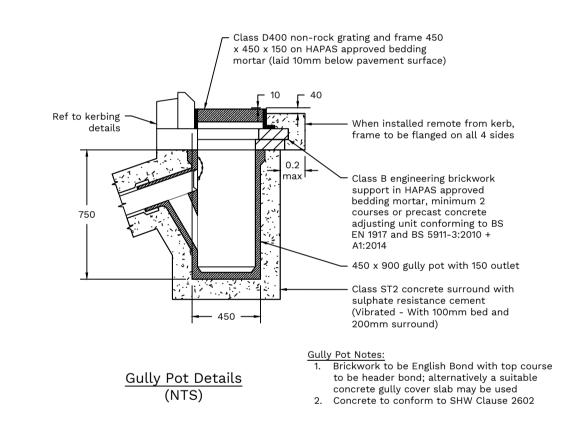

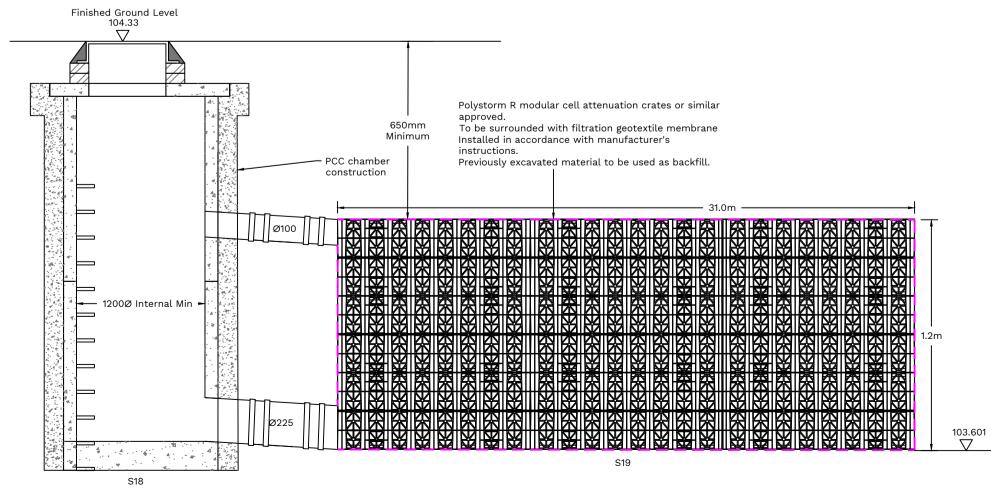

Private Soakaway Detail S19

DRAWING: Standard Details

Witney Town Council

Detailed Drainage Design For New Depot

REV DESCRIPTION

SHREWSBURY BUSINESS PARK

ORIGINATING OFFICE:

BEECH HOUSE

SHREWSBURY

SHROPSHIRE

SY2 6FG

CLIENT:

DATE BY CHKD

shrewsbury@berrys.uk.com www.berrys.uk.com

TEL: 01743 271697

DISCLAIMER NOTES:

SCALE BAR & NORTH POINT:

DO NOT SCALE THIS DOCUMENT - USE FIGURED DIMENSIONS ONLY

THIS DOCUMENT IS COPYRIGHT OF THE ORIGINATOR, IT MUST NOT BE ALTERED, REPRODUCED OR DISTRIBUTED WITHOUT PRIOR

THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH ALL SUPPORTING DOCUMENTS PRODUCED BY THE ORIGINATOR AND OTHER PROJECT DISCIPLINES.

OS MAPPING OBTAINED FROM PROMAP LICENCE No. 100022432 REPRODUCED BY BERRYS UNDER OS LICENCE No. 100003668

ALL DIMENSIONS MUST BE CHECKED ON SITE PRIOR TO COMMENCEMENT OF ANY RELATED WORKS.

SCALE @ A1: DRAWN BY: CHKD BY: DATE: RH

SA53162 -BRY-ST -PL - C - 502 _

12.06.25 REVISION: DRAWING No:

BERRYS

PRELIMINARY