


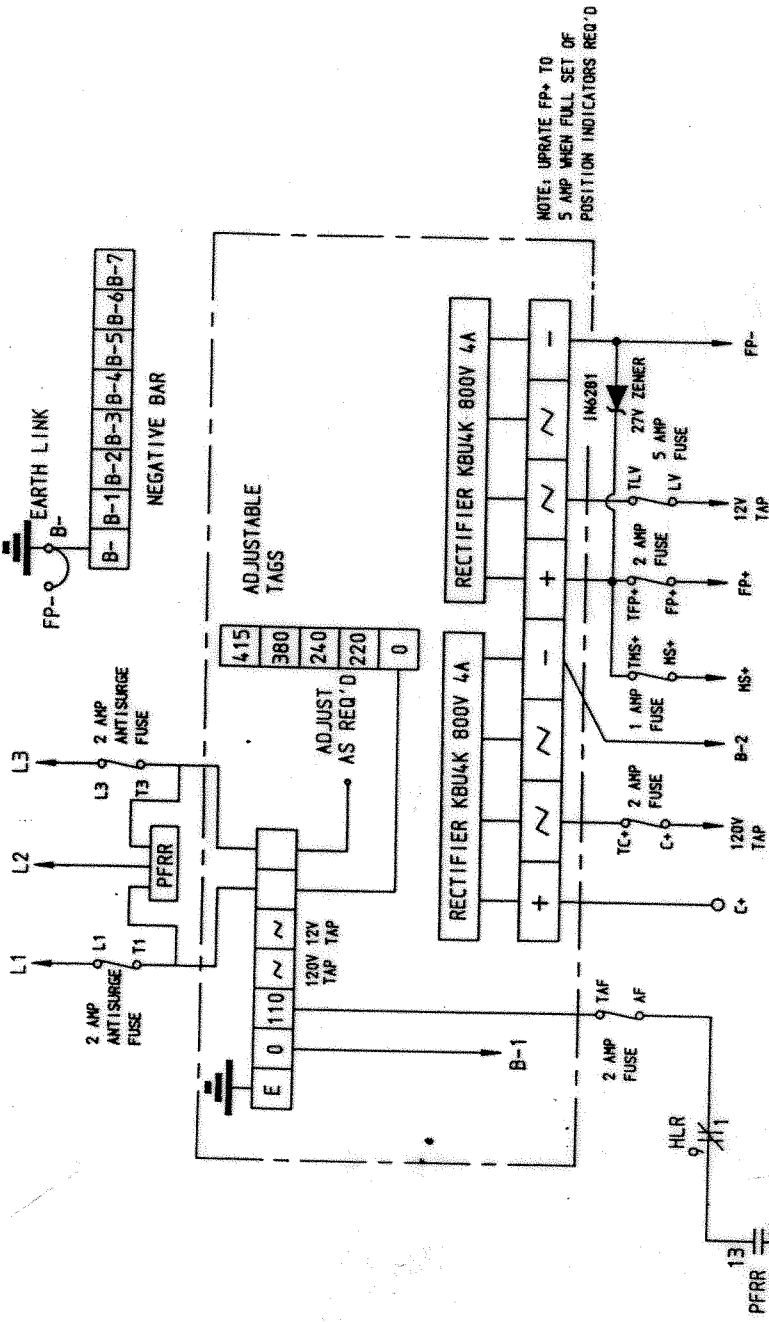
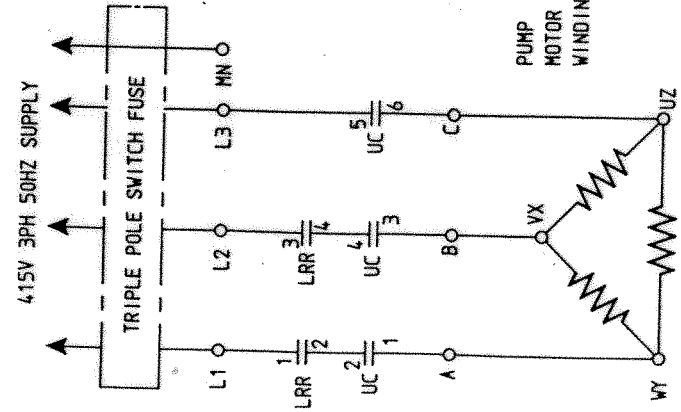
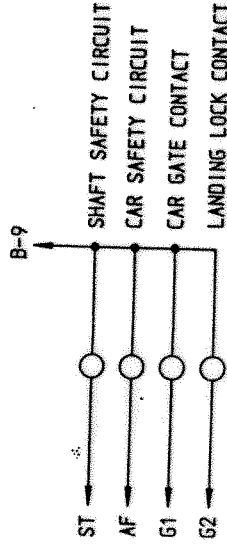



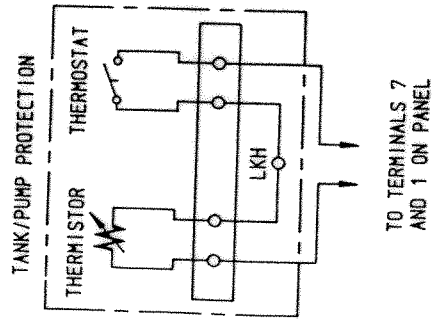

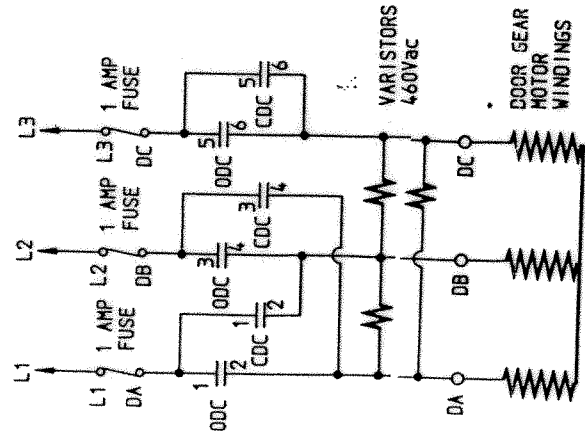

NOTE: UPRATE FP+ TO 5 AMP WHEN FULL SET OF POSITION INDICATORS REQ'D

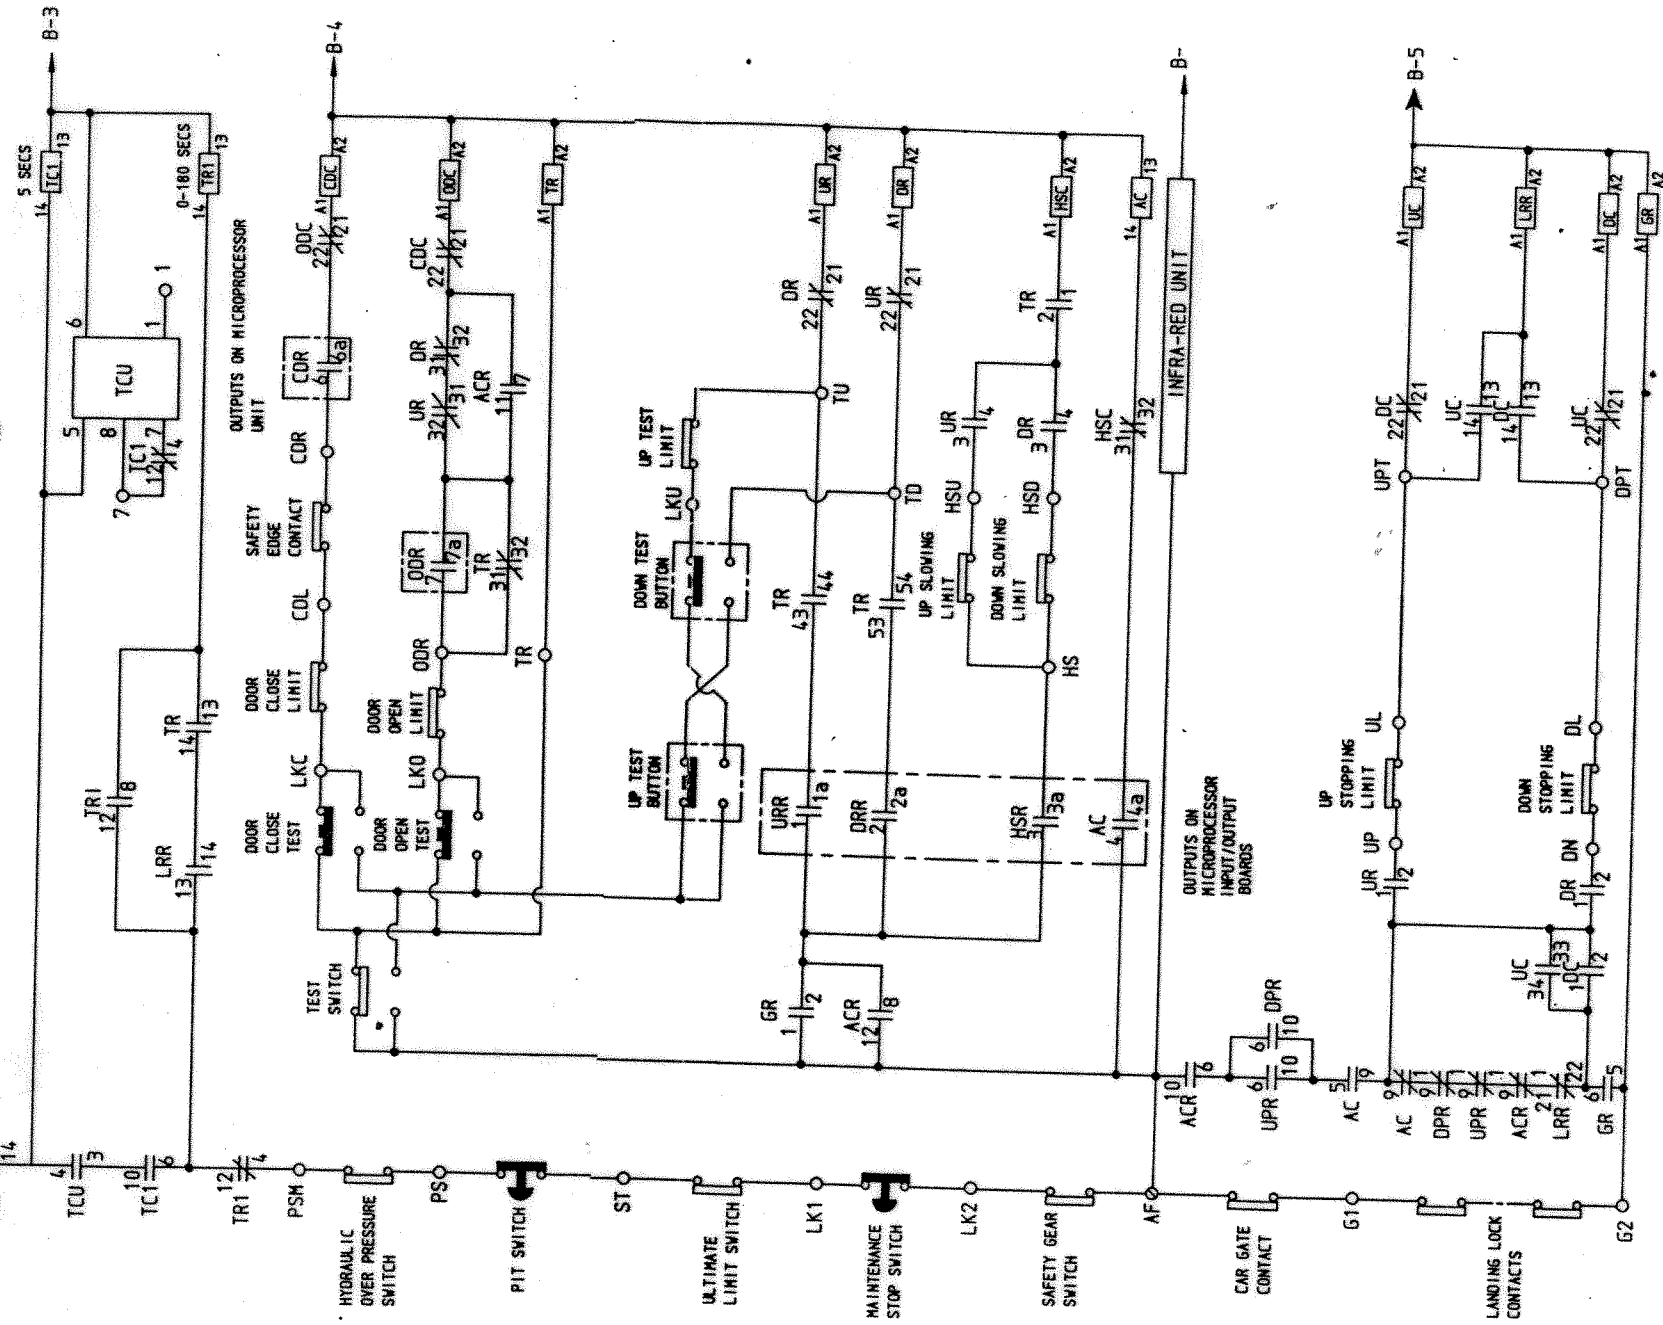

RELAY AND CONTACTOR DATA
 1MO K2-16/K2-23/K2-30 CONTACTORS 110Vac
 LRR UC
 1MO K2-09 CONTACTORS 110Vac
 HSC TR UR DR CDC ODC DC LRR GR
 1MO H3Y4 TIMER 0-10 SECS 110Vac
 TC1 SDT
 1MO H3Y4 TIMER 0-180 SECS 110Vac
 TR1
 1MO MY4 RELAYS 110Vac
 AC SDR
 1MO MY4 RELAYS 110Vdc
 ACR UPR DPR VHR
 1MO MY4 RELAYS 12Vdc
 HLR ULR

62x
 29
 12x
 22x