


PLANT ROOM



Proposed Flow Rate: 93m³/hr Max

Existing Main Pool Capacity: 555m³


Existing Teach Pool Capacity: 30m³
Total 585m³

General Notes

Suction Pipework: 160mmØ

2No 1600mmØ Filters @ 2.01m² ea Total Filter Area: 4.02m² Filtration Rate: 23.1m³/hr/m²



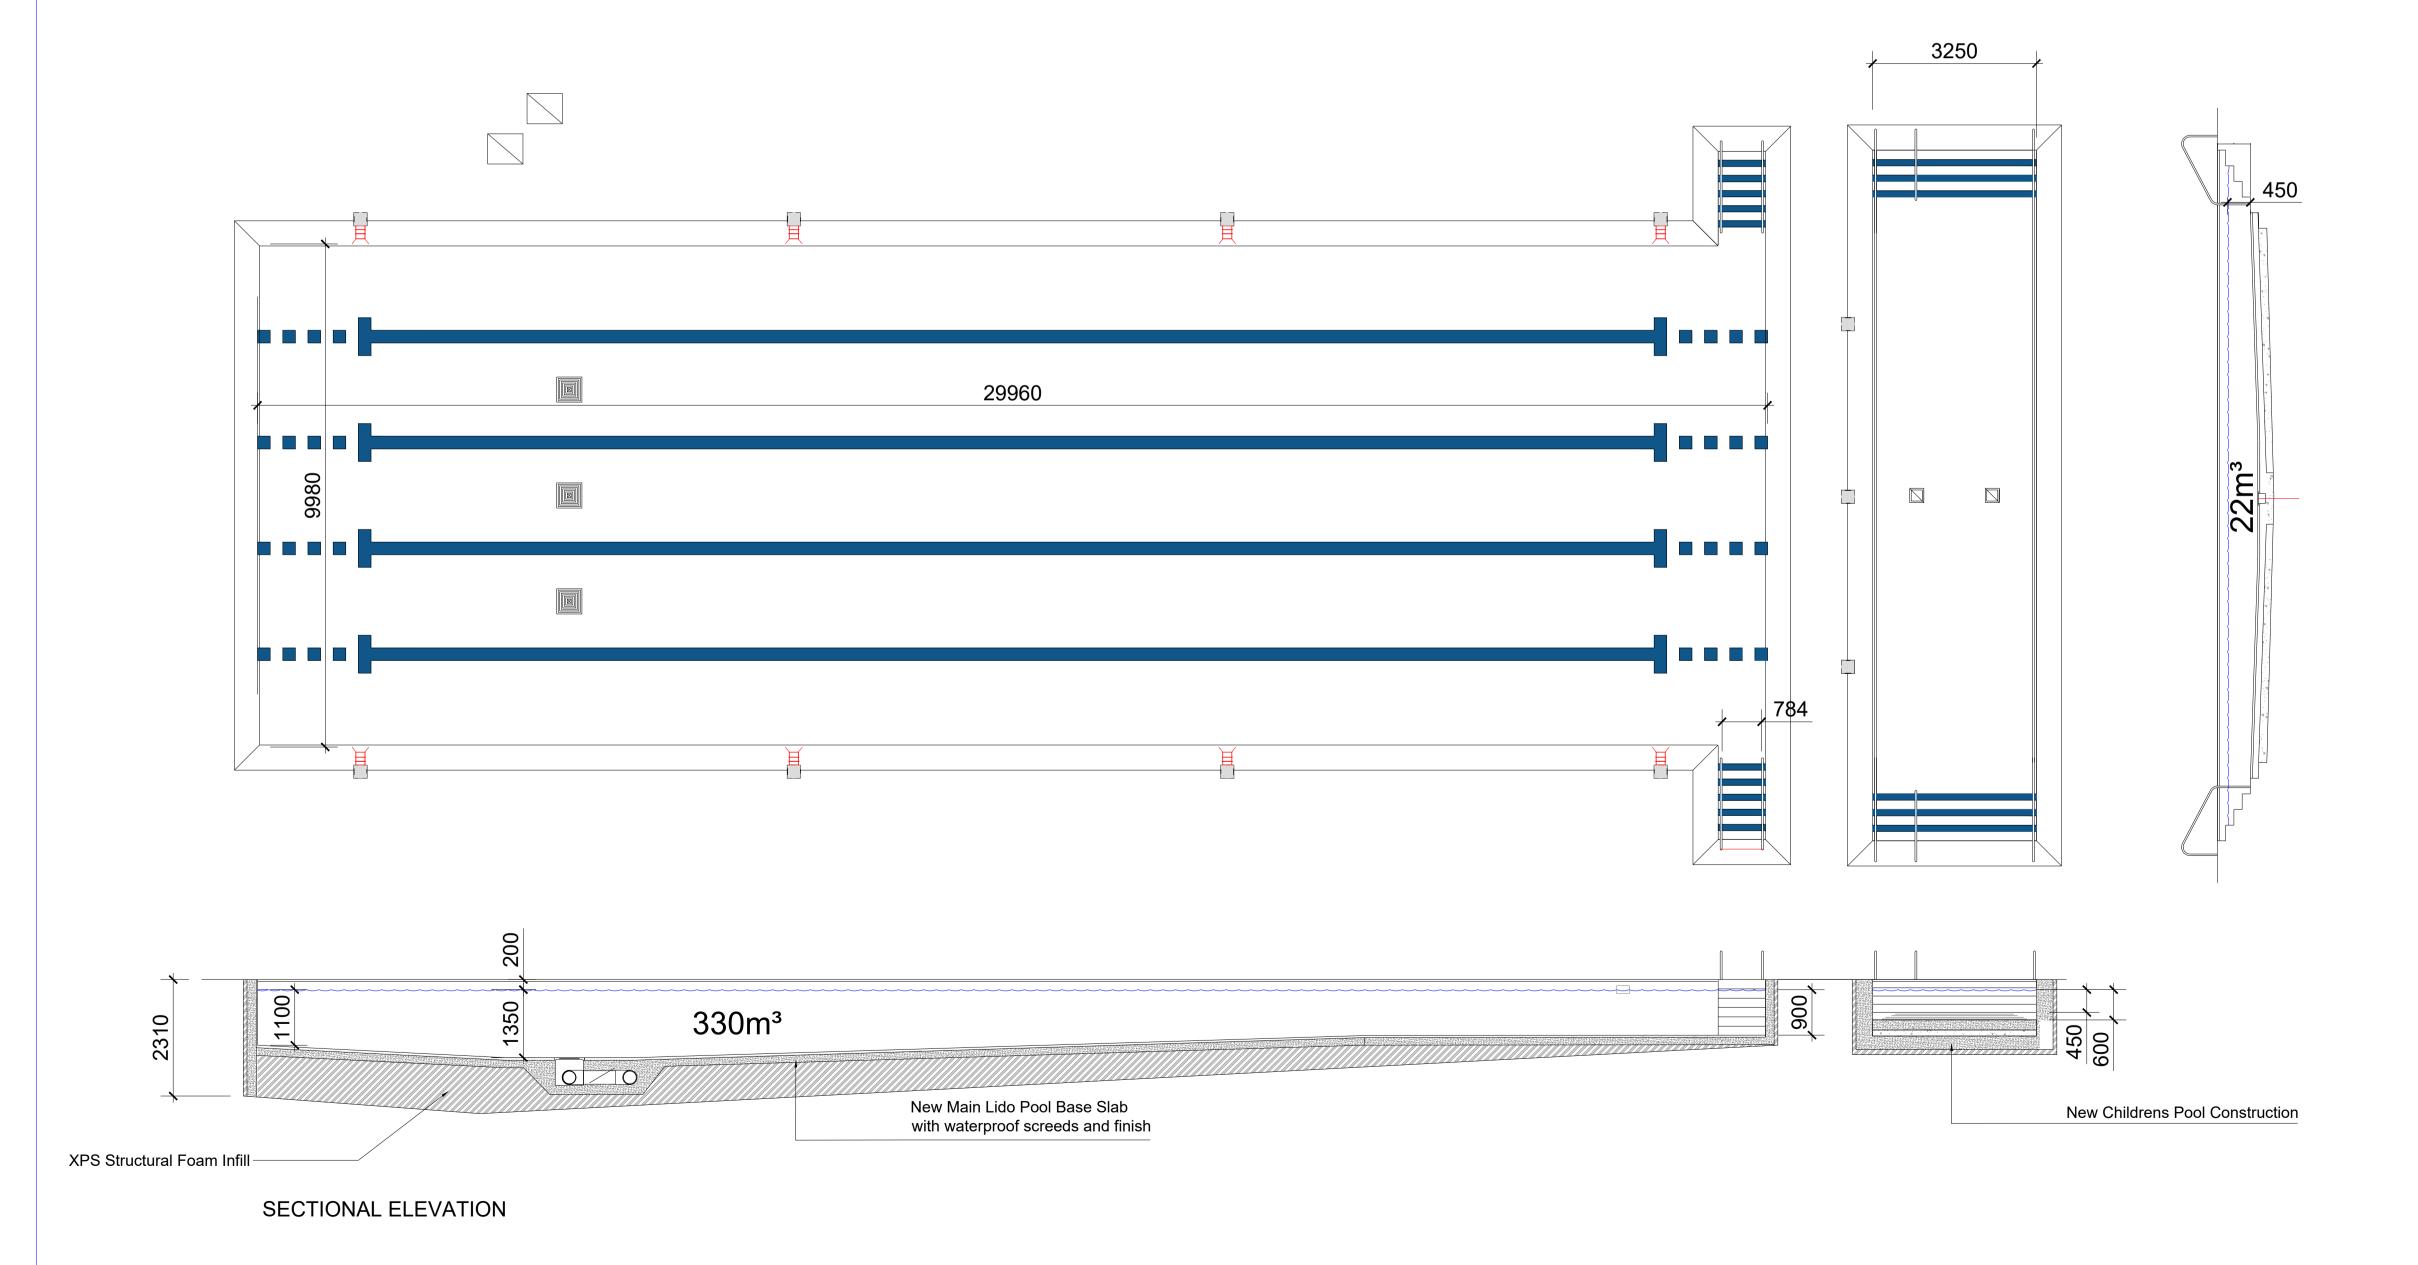

B 23/02/22 - Tender Issue - JWC
 A 06/12/21 - Revised based on final proposal.

Date and Description

JWC

HYDROSPEC SWIMMING POOL ENGINEERS UNIT 1, 41 TALLON ROAD HUTTON INDUSTRIAL ESTATE

ESSEX CM13 1TG TEL: 01277 225416

E-mail: info@hydrospec.co.uk

BRENTWOOD

PROJEC

Ware Prior Lido Hertfordshire

REF: Lido Pool Rebuild 1.35mtr Proposal

REF: LIDO POOL PROPOSAL - 1.35m DEEP

DECEMBER 2021 DRAWING NUMBER

NOT TO SCALE: HYD/WPL/001B