


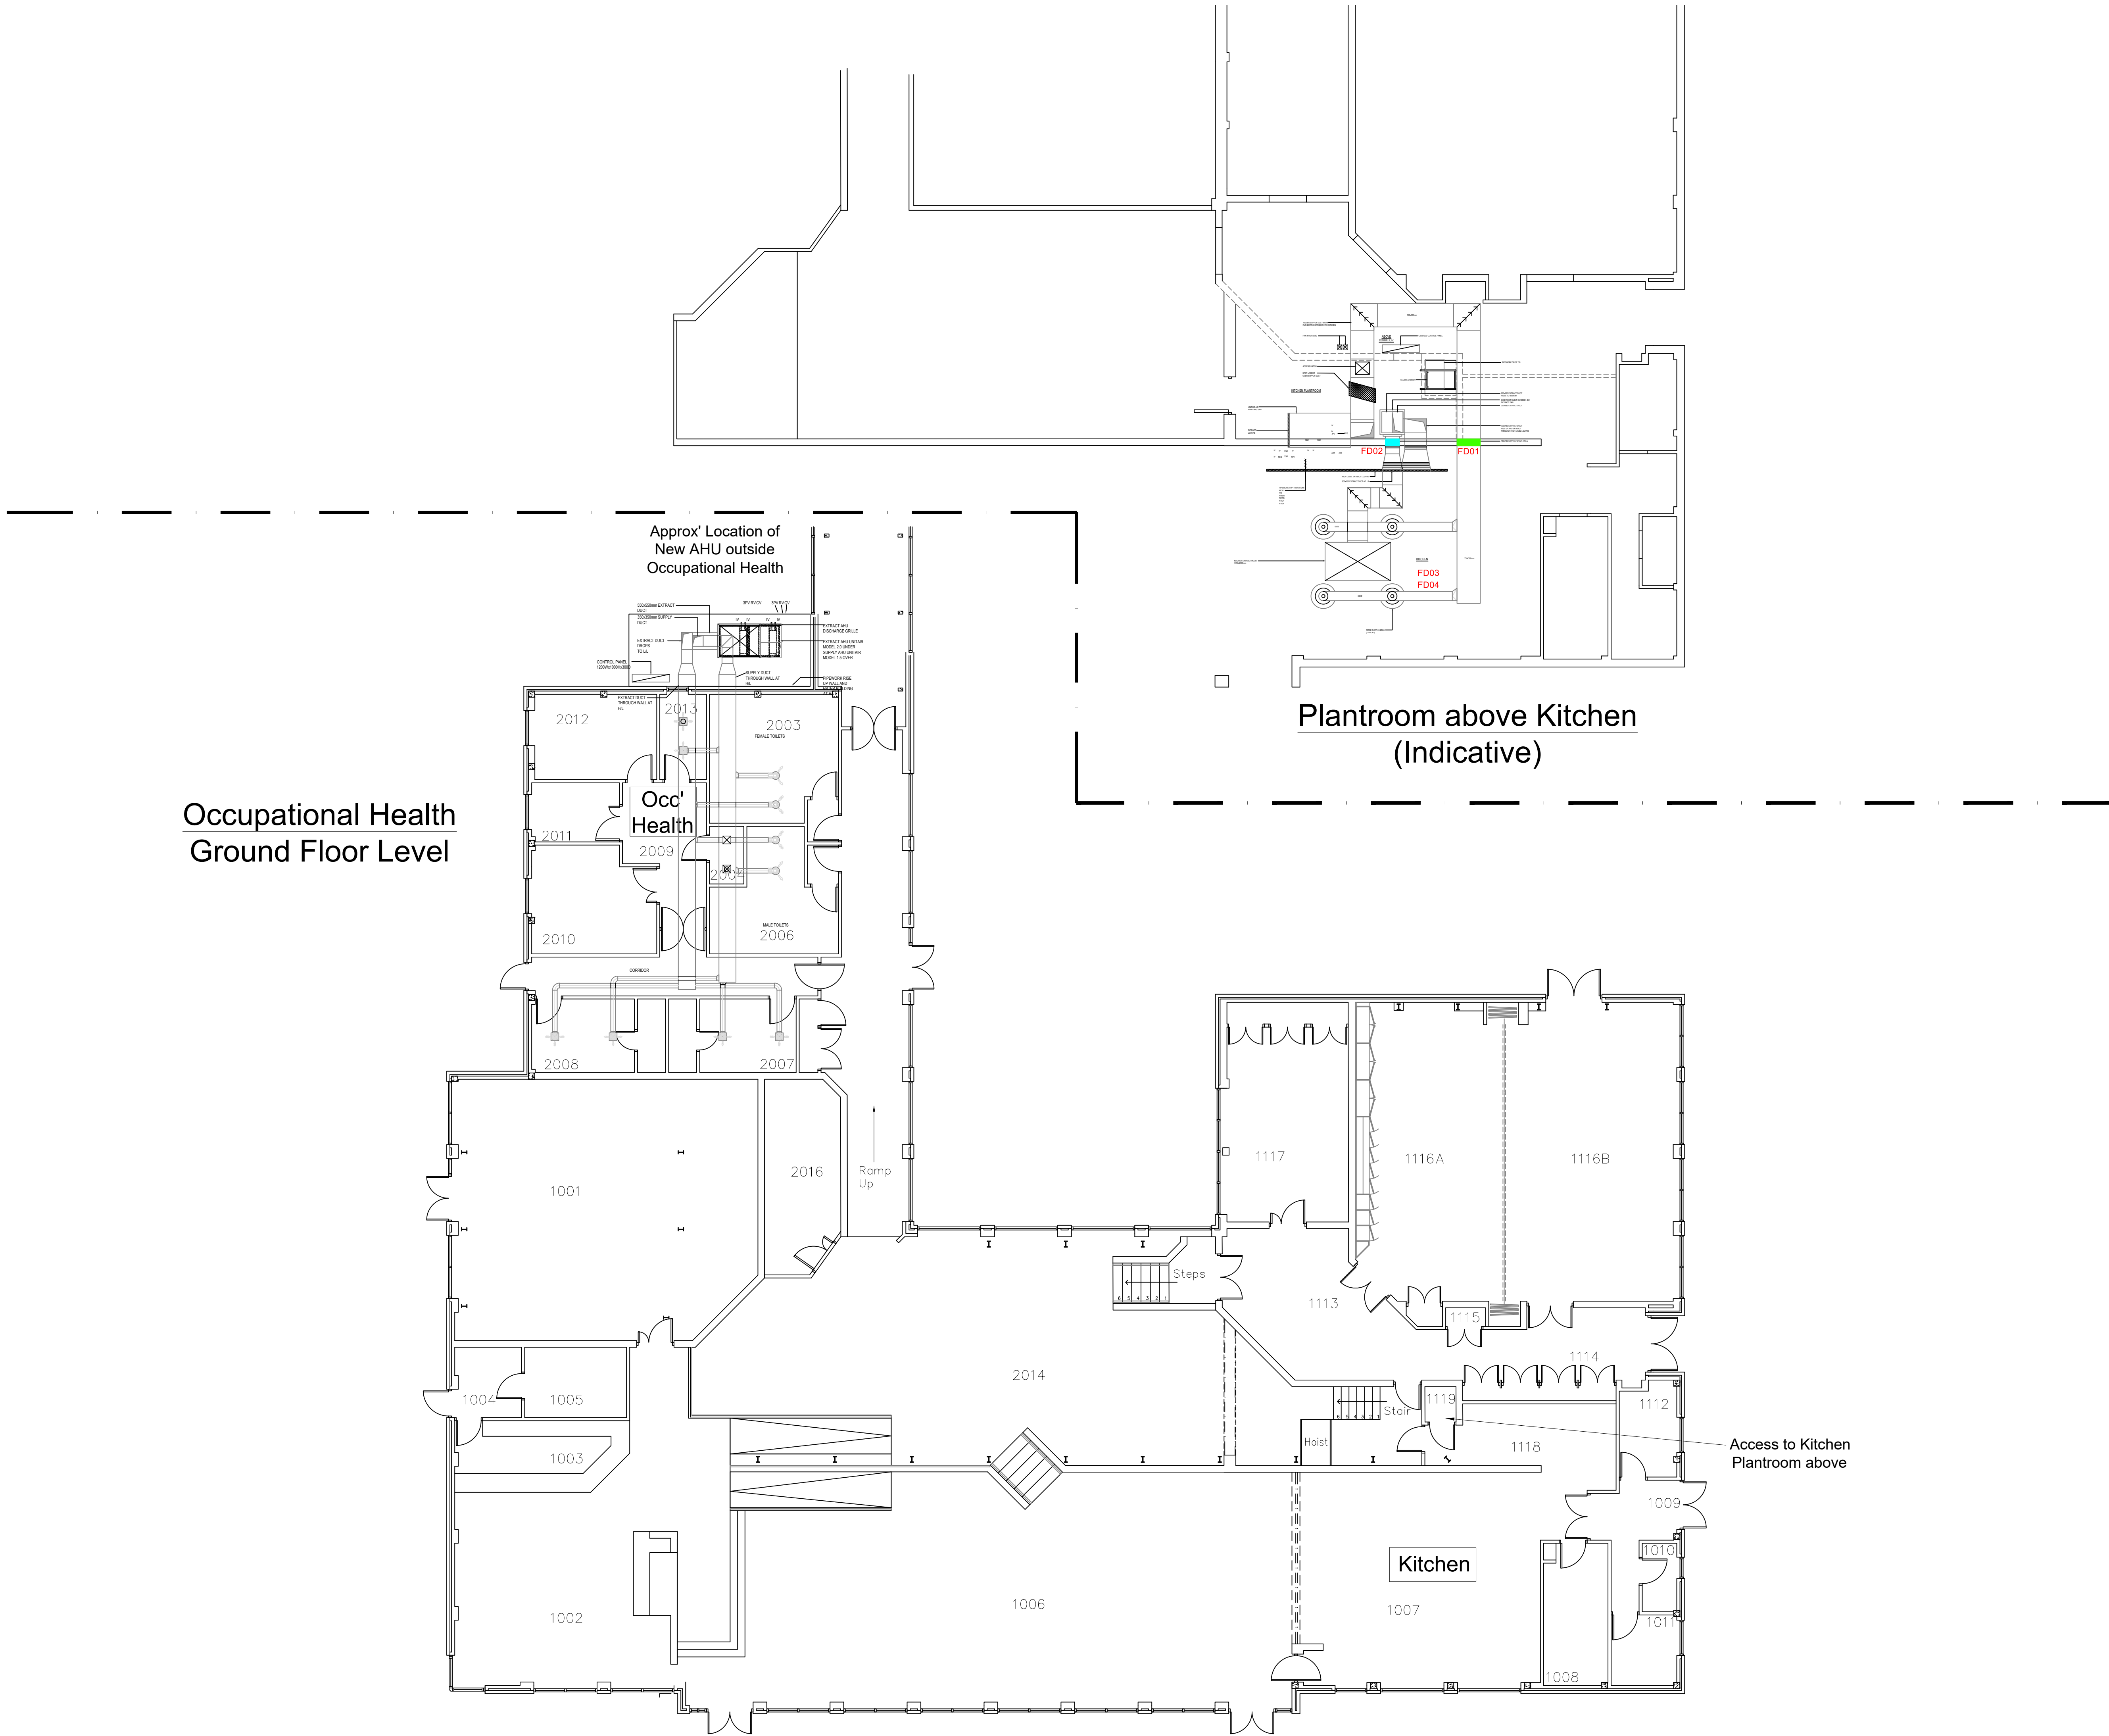

Occupational Health
Ground Floor Level

Plantroom above Kitchen
(Indicative)

LEGEND

- FD FIRE DAMPER - SUPPLY
- FD FIRE DAMPER - EXTRACT

B	Survey record	AGB	15-08-16
A	For information	AGB	06-02-15
REV:	DESCRIPTION:	BY:	DATE:
STATUS: MASTER			
 National Institute for Biological Standards and Control Confidence in Biological Medicines Blanche Lane, South Mimms, Hertfordshire, EN8 3QG Tel: +44 (0)1707 641000 Fax: +44 (0)1707 641050 Website: www.nibsc.org			
PROJECT: South Mimms Main Intake Grilles, Ductwork and Fire Damper Survey			
TITLE: Amenities and Occupational Health Plantroom Level (Kitchen) Fire Damper Locations			
DRAWN:	AGB	DATE:	06-02-15
CHECKED:		DATE:	
SCALE:	1:100	SHEET:	A1
DRAWING No:	P14-016-12		REV: B