


Rev	T1		
Rev Purpose of Issue/Modifications	ISSUED FOR TENDER		
Ву	SPB		
Chk'd	PTH		
Date	03/06/15		

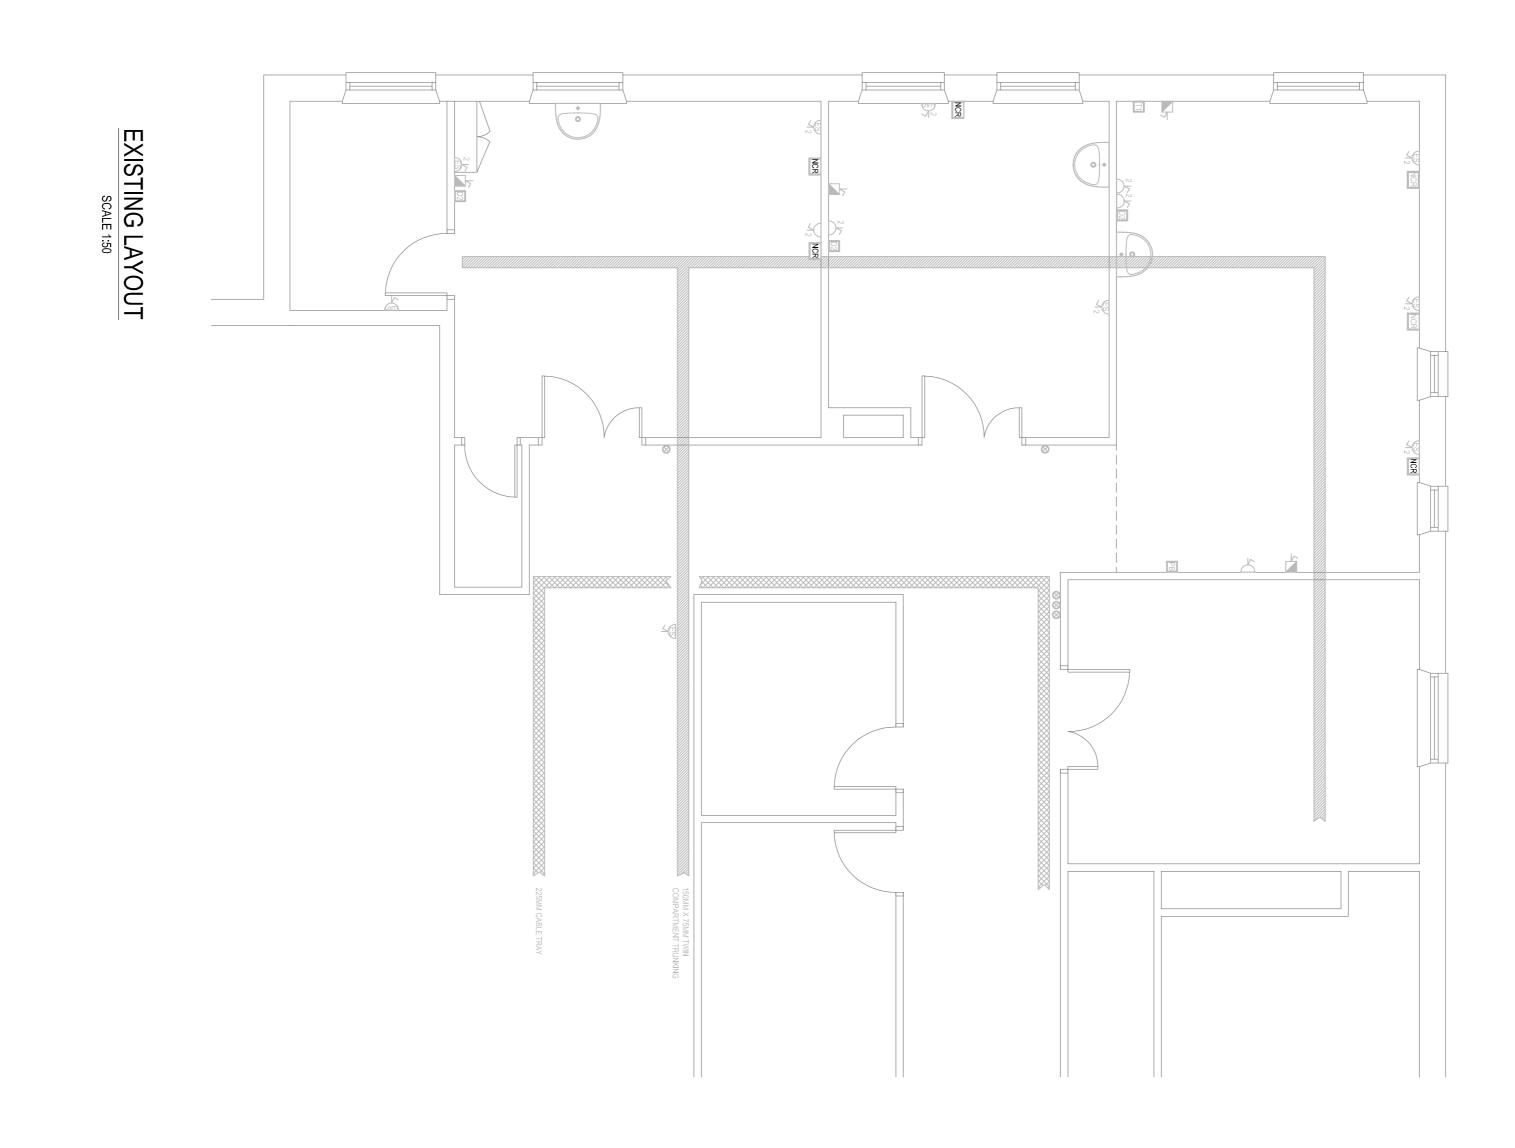

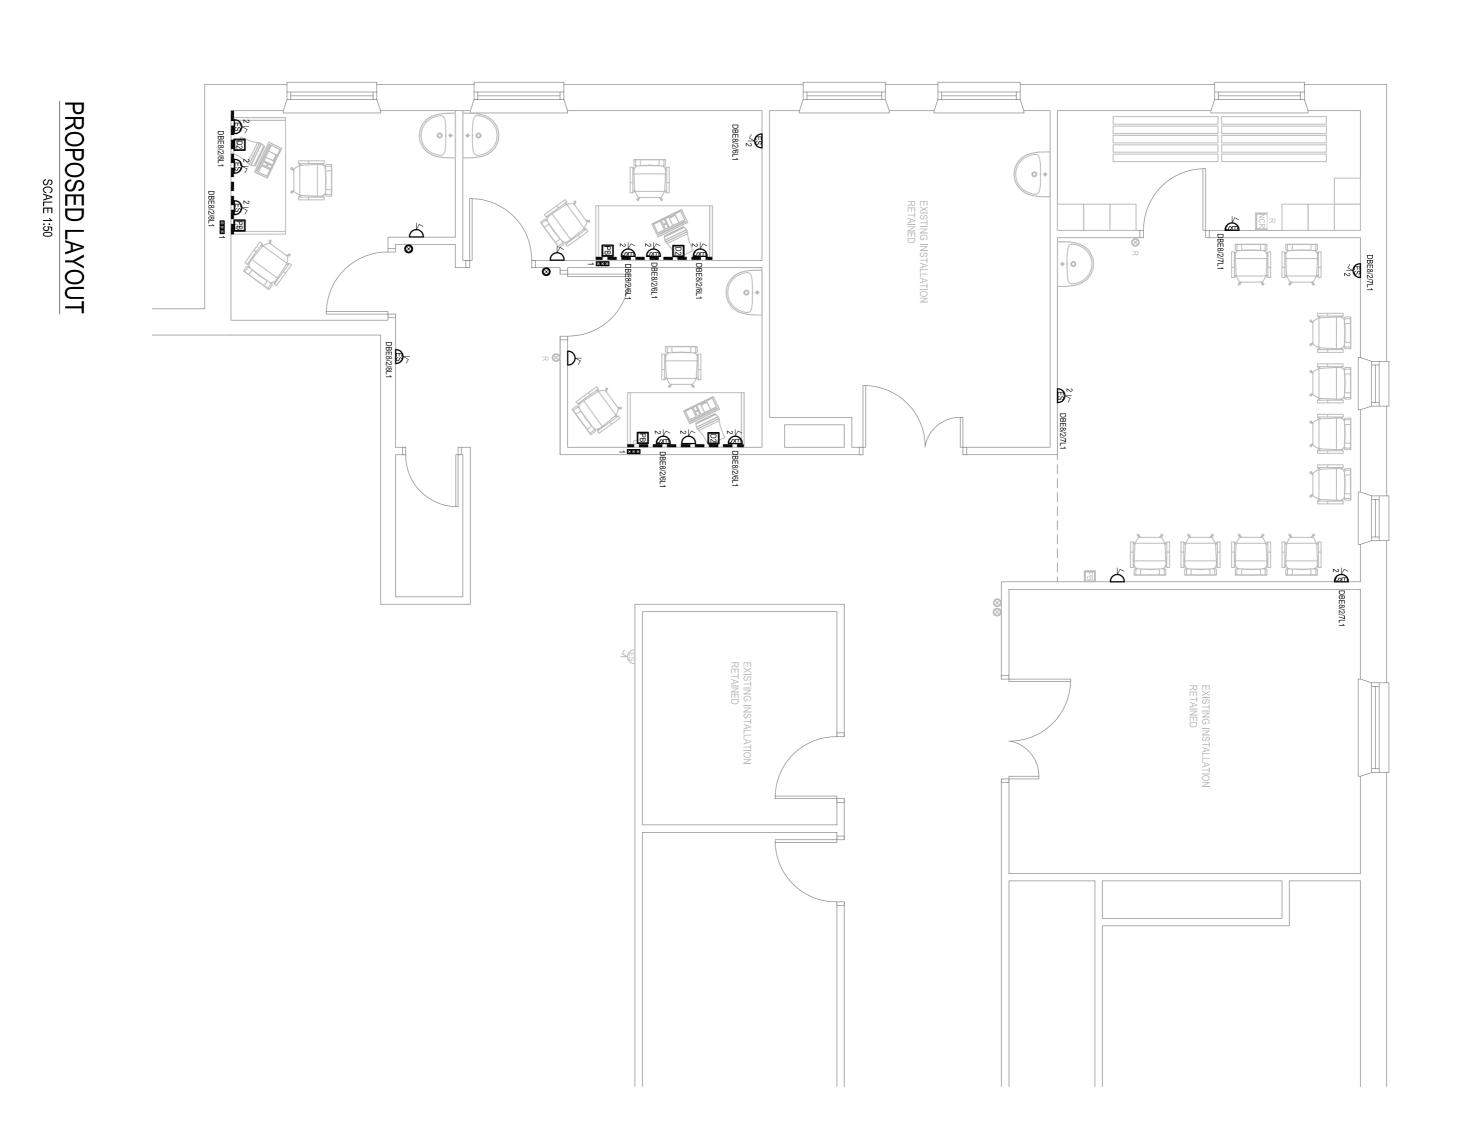

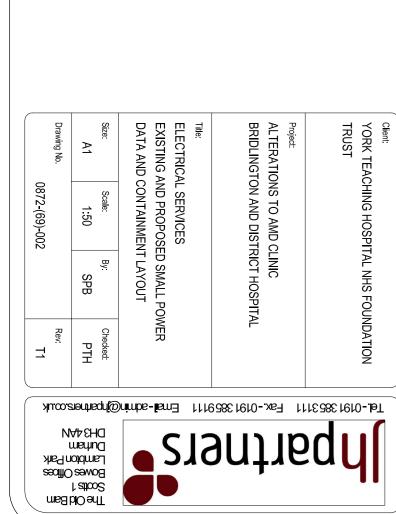

WIRING DROP TO DADO TRUNKING COMPRISING OF 1NO. 25mm DIA STEEL CONDUIT FOR RING MAIN CIRCUIT & 2NO. 25mm DIA STEEL CONDUITS FOR DATA CABLES. ALL CONDUITS TO BE SECURELY FIXED WITHIN WALLS, CONDUITS TO TERMINATE IN FLUSH END BOXES BEHIND DADO TRUNKING WITH SLOW RADIUS BENDS INTO CEILING VOID FOR DATA CABLES AND CONNECTION TO VOID TRUNKING

3 COMPARTMENT PVC/DADO TRUNKING AS MK PRESTIGE 3D CAT 6 (ANTIBACTERIAL TO CLINICAL AREAS) MOUNTED ABOVE DESK POSITIONS. ALL HEIGHTS TO BE AGREED PRIOR TO COMMENCMENT OF WORKS

NURSE CALL OVERDOOR LIGHT (EXISTING)
NURSE CALL OVERDOOR LIGHT (EXISTING RELOCATED) NURSE CALL OVER DOOR LIGHT

NURSE CALL/RESET UNIT (EXISTING)
NURSE CALL/RESET UNIT (EXISTING RELOCATED) STAFF ATTACK PUSH BUTTON

STAFF ATTACK PUSH BUTTON (EXISTING)

TWIN DATA OUTLET (EXISTING) TWIN DATA OUTLET

DOUBLE SWITCH SOCKET NON ESSENTIAL SERVICES (EXISTING)
SWITCHED FUSE CONNECTION UNIT (EXISTING)

DOUBLE SWITCH SOCKET ESSENTIAL SERVICES
SINGLE SWITCH SOCKET NON ESSENTIAL SERVICES

LEGEND

ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED. THE CONTRACTOR SHALL CHECK ALL DIMENSIONS AND REPORT ANY OMISSIONS OR ERRORS. DO NOT SCALE FROM THIS DRAWNG.