


- CONCRETE NOTES:
- ALL CONCRETE WORKS, MATERIALS, WORKMANSHIP ETC., TO BE IN ACCORDANCE WITH CURRENT EDITIONS OF BS 8110 - BRITISH STANDARDS, CODES OF PRACTICE FOR THE STRUCTURAL USE OF CONCRETE.
 - ALL STRUCTURAL CONCRETE TO BE CAST ON 50mm MINIMUM THICKNESS OF CONCRETE BLINDING DESIGN MIX GEN1 OR STANDARD MIX ST1/ST2.
 - MINIMUM CONCRETE COVER TO SHALL BE 40mm TO ALL SIDES UNLESS INDICATED OTHERWISE.
 - CONCRETE QUALITY TO BE DESIGN GRADE RC35 USING 20mm NOMINAL AGGREGATES
MINIMUM CEMENT CONTENT OF 280kg/m³
W/C RATIO = 0.6
 - FOR DETAILS OF REINFORCEMENT REFER TO BAR BENDING SCHEDULE: 220007-CCL-XX-XX-SH-S-0702
 - ALL STRUCTURAL CONCRETE SHALL BE ADEQUATELY COMPACTED USING POKER TYPE IMMERSION VIBRATOR WITHIN SUITABLE PURPOSE MADE SHUTTERS UNLESS OTHERWISE STATED.
 - ALL REINFORCEMENT CAGES SHALL BE SECURELY WIRED TOGETHER AND LOCATED WITHIN THE SHUTTERS BY SUITABLY FIXED SPACERS, CHAIRS ETC.
 - ALL CHAIRS AND SPACERS ARE TO BE SCHEDULED AND SUPPLIED BY THE CONTRACTOR.
 - REINFORCEMENT CALLED UP THUS:
10 - H10 - (01) - 200 - T1/B1
NO. BARS BAR TYPE AND SIZE BAR MARK BAR CTRS LAYER
- ABBREVIATIONS:
T - TOP FACE
B - BOTTOM FACE
C - CENTRAL ON BEAM / WALL FACE
NF - NEAR FACE
FF - FAR FACE

REFER TO ARCHITECTS DRAWINGS FOR ALL SETTING OUT, DPMS AND FINISHES


FOR RAFT SLAB REINFORCEMENT REFER TO DRAWING 220007-CCL-XX-XX-DR-S-0700

MANUAL LIFTING:
ANY STRUCTURAL ELEMENT IN EXCESS OF 25kg REQUIRES SPECIFIC RISK ASSESSMENT AND CONSIDERATION OF ASSISTED LIFTING EQUIPMENT.


SITE DIMENSIONS:
ACCURATE ON-SITE MEASUREMENTS FOR OVERALL ELEMENT SIZES MUST BE CARRIED OUT PRIOR TO FABRICATION OF ANY STRUCTURAL ELEMENTS, BY THE CONTRACTOR OR SPECIALIST SUPPLIER. DESIGN DIMENSIONS WITHIN THE CALCULATIONS MUST NOT BE USED FOR THE PROCUREMENT OF ANY STRUCTURAL ELEMENTS. DO NOT SCALE OFF THIS DRAWING.

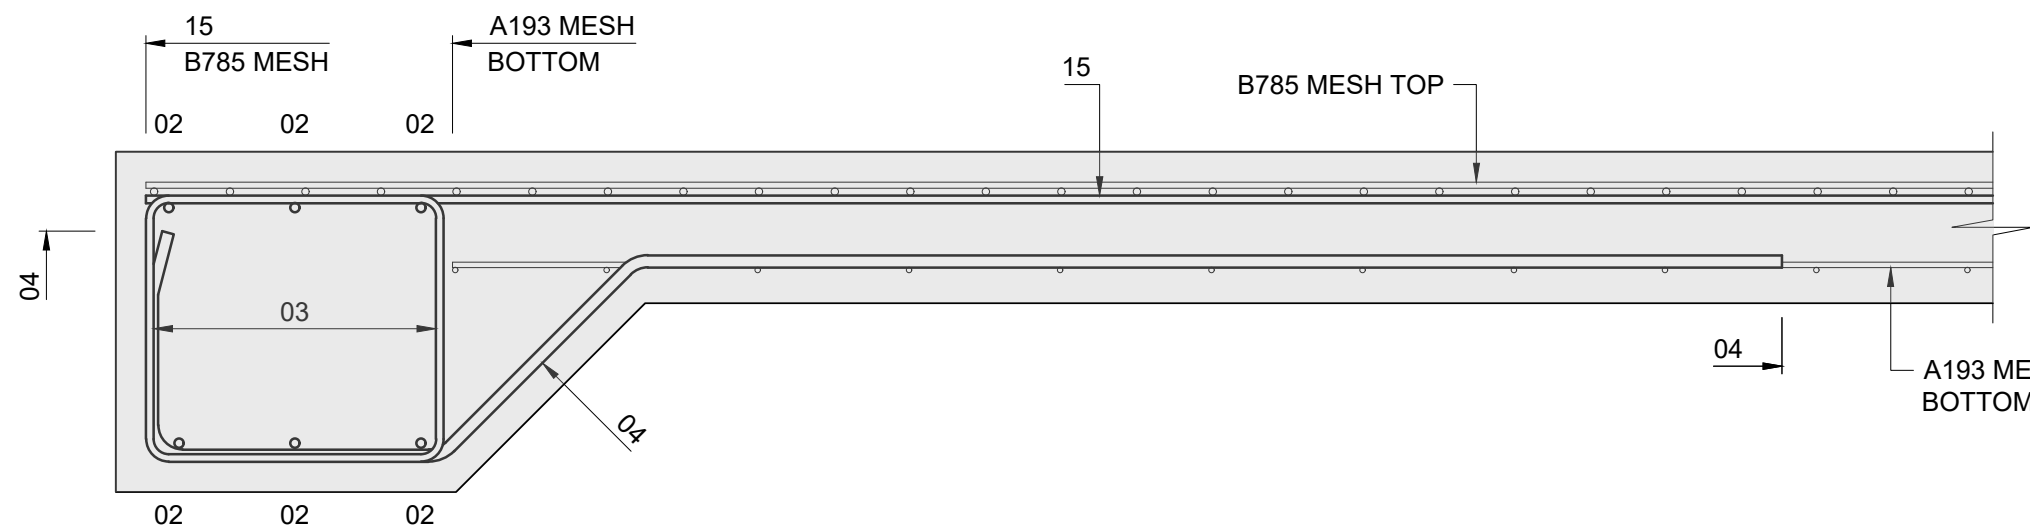

SECTION A-A
SCALE 1:10

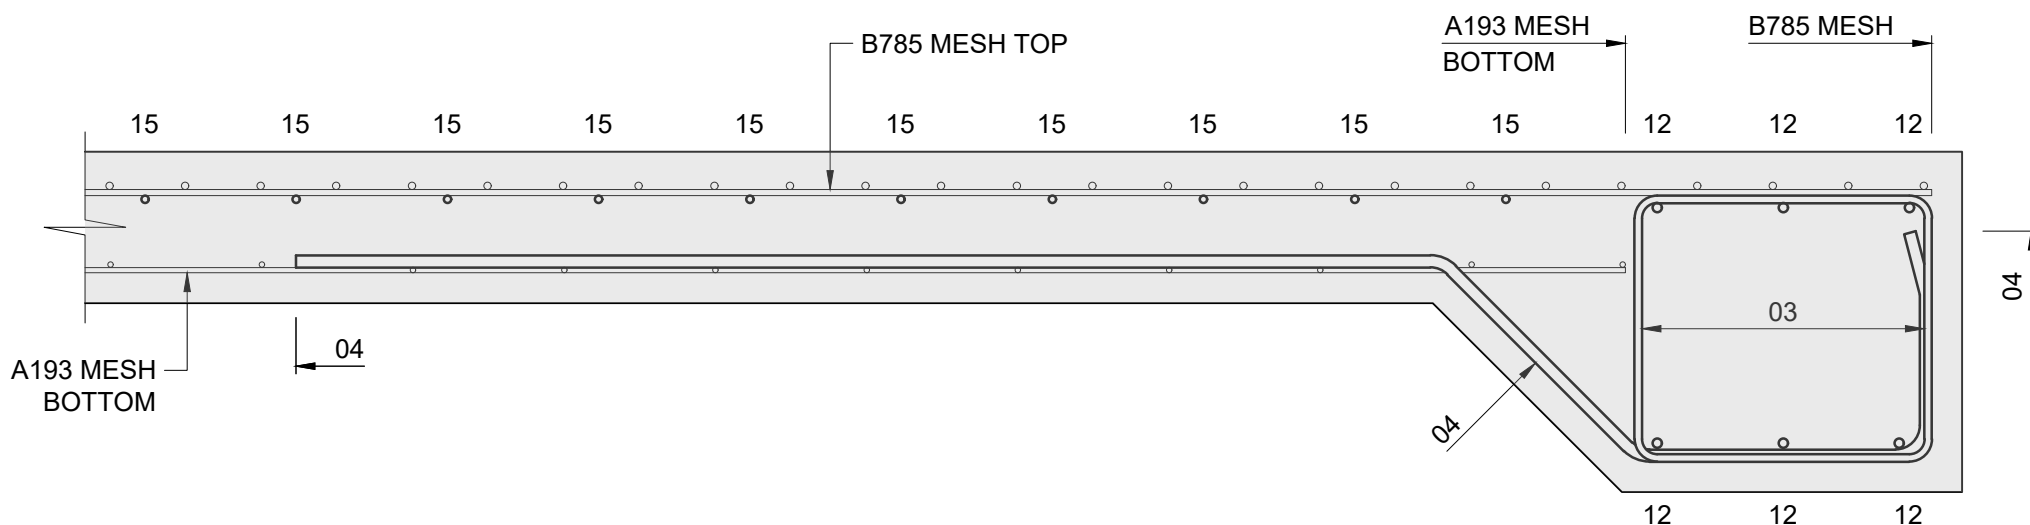

SECTION B-B
SCALE 1:10

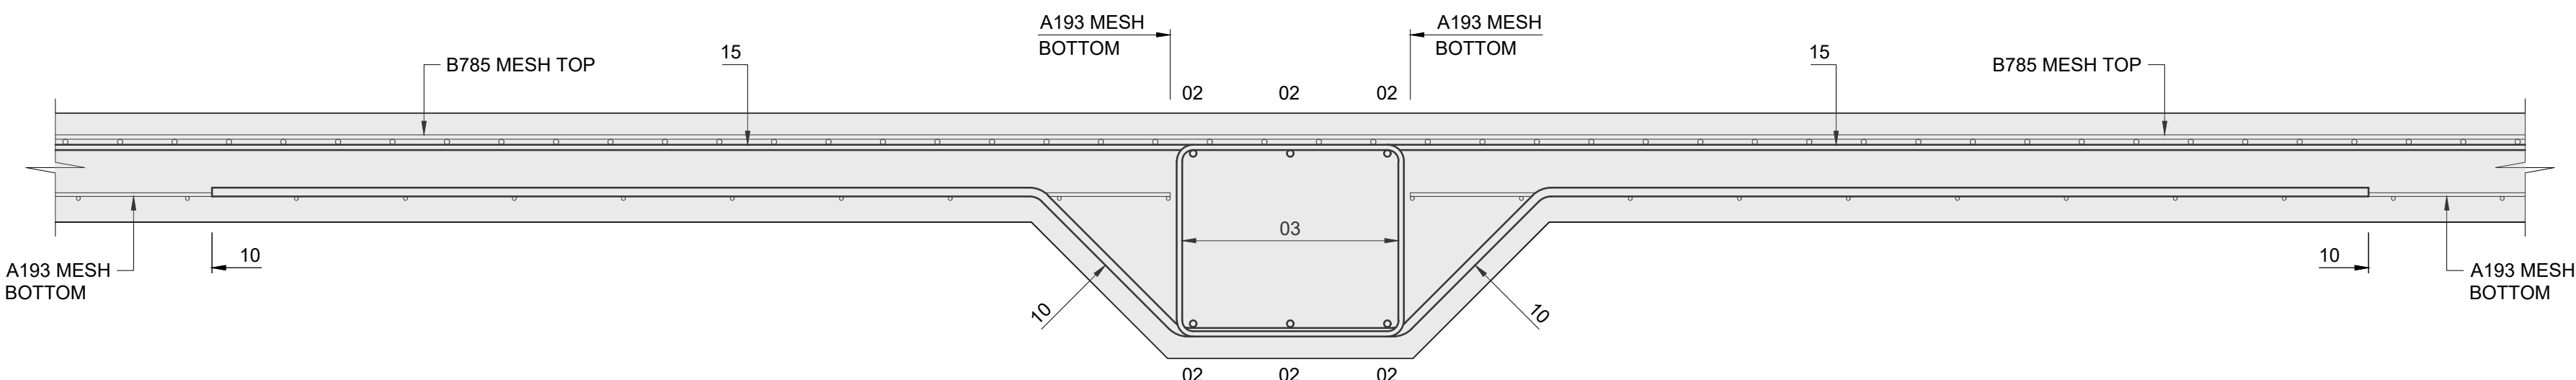

SECTION C-C
SCALE 1:10

rev	date	details	drawn	check
P02	17.06.24	RAFT SLAB SPLIT INTO 3 SEPARATE SLABS	AW	NTE
P01	30.05.24	PRELIMINARY ISSUE	AW	NTE



Structural Civil Building Engineers

+44 (0)1603 430650 | clientservice@canhamconsulting.co.uk | www.canhamconsulting.co.uk

GREAT AND LITTLE PLUMSTEAD PARISH COUNCIL

architect
DAVID BULLEN LIMITED
RACKHEATH, NORWICH

project
GREAT PLUMSTEAD PAVILION, CHURCH ROAD
GREAT PLUMSTEAD, NORWICH, NR13 5AB

title
RAFT SLAB THICKENING REINFORCEMENT
SHEET 2

CCL ref:	drawn	design	checked	scale	size	date
220007	AW	JP	NTE	1:50, 1:10	A1 (L)	20.05.2024

status:
S3 - SUITABLE FOR REVIEW & COMMENT

drawing number	revision
220007-CCL-XX-XX-DR-S-0702	P02

© This drawing is copyright and is not to be reproduced without the written permission of Canham Consulting Ltd

THIS DESIGN IS PRODUCED IN ACCORDANCE WITH THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS 2015 INCORPORATING THE APPROVED CODE OF PRACTICE (REGULATIONS 2, 9 AND 11). THERE ARE NO ALTERNATIVES TO THE DESIGN WITHOUT THE AUTHORITY OF CANHAM CONSULTING LTD. ANY CHANGES TO THE DESIGN MUST BE APPROVED BY CANHAM CONSULTING LTD. BEFORE THEY ARE MADE.