


Note: The existing Cast iron radiators are to be retained as they may have to be refinished and reused.

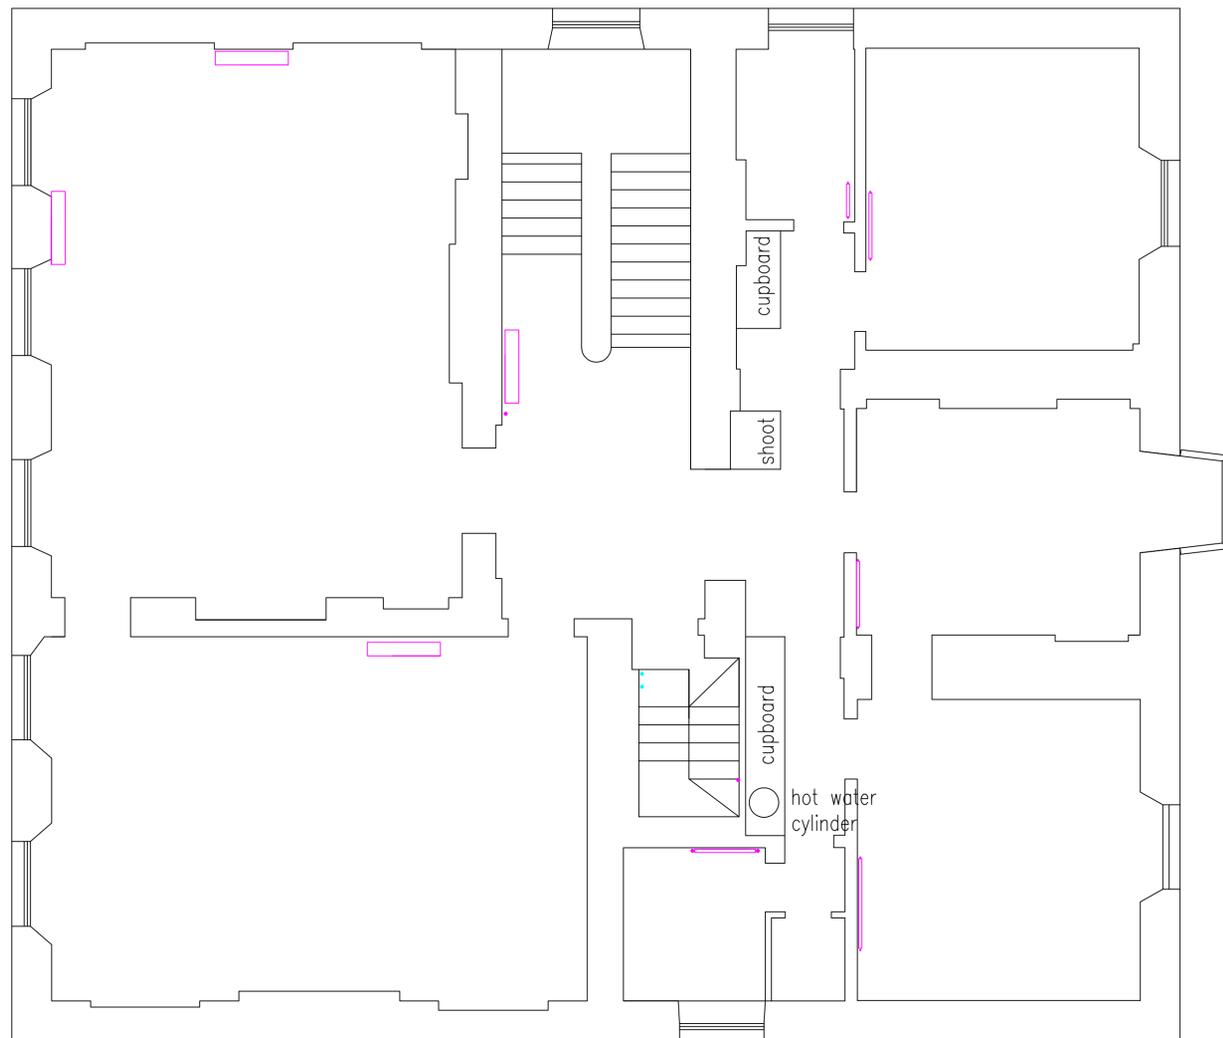

Remove the existing heat emitter, pipework and water cylinder. extend the hot and cold water service pipework to the ground floor. Decommission the cold water storage tank. Remove dead ends and cap of the vent pipe as the new cylinder is to be pressurised.

TENDER ISSUE

Rev.	Revision Notes	Date
A	- DRAFT ISSUE	11-02-17
B	-	-
C	-	-
-	-	-
-	-	-

Rev.	Revision Notes	Date
A	-	-
-	-	-
-	-	-
-	-	-
-	-	-



Job Description REPLACEMENT HEATING SYSTEM	Date 05.02.2017	Scale 1:100	Drawn AA/AA	Checked AA/AA
Location BODMIN TOWN COUNCIL OFFICE	Drawing Title EXISTING RADIATOR POSITIONS FIRST AND SECOND FLOOR			
Client BODMIN TOWN COUNCIL	Dwg. No. M702	Rev. A		