


Existing Fire Safety Drawings

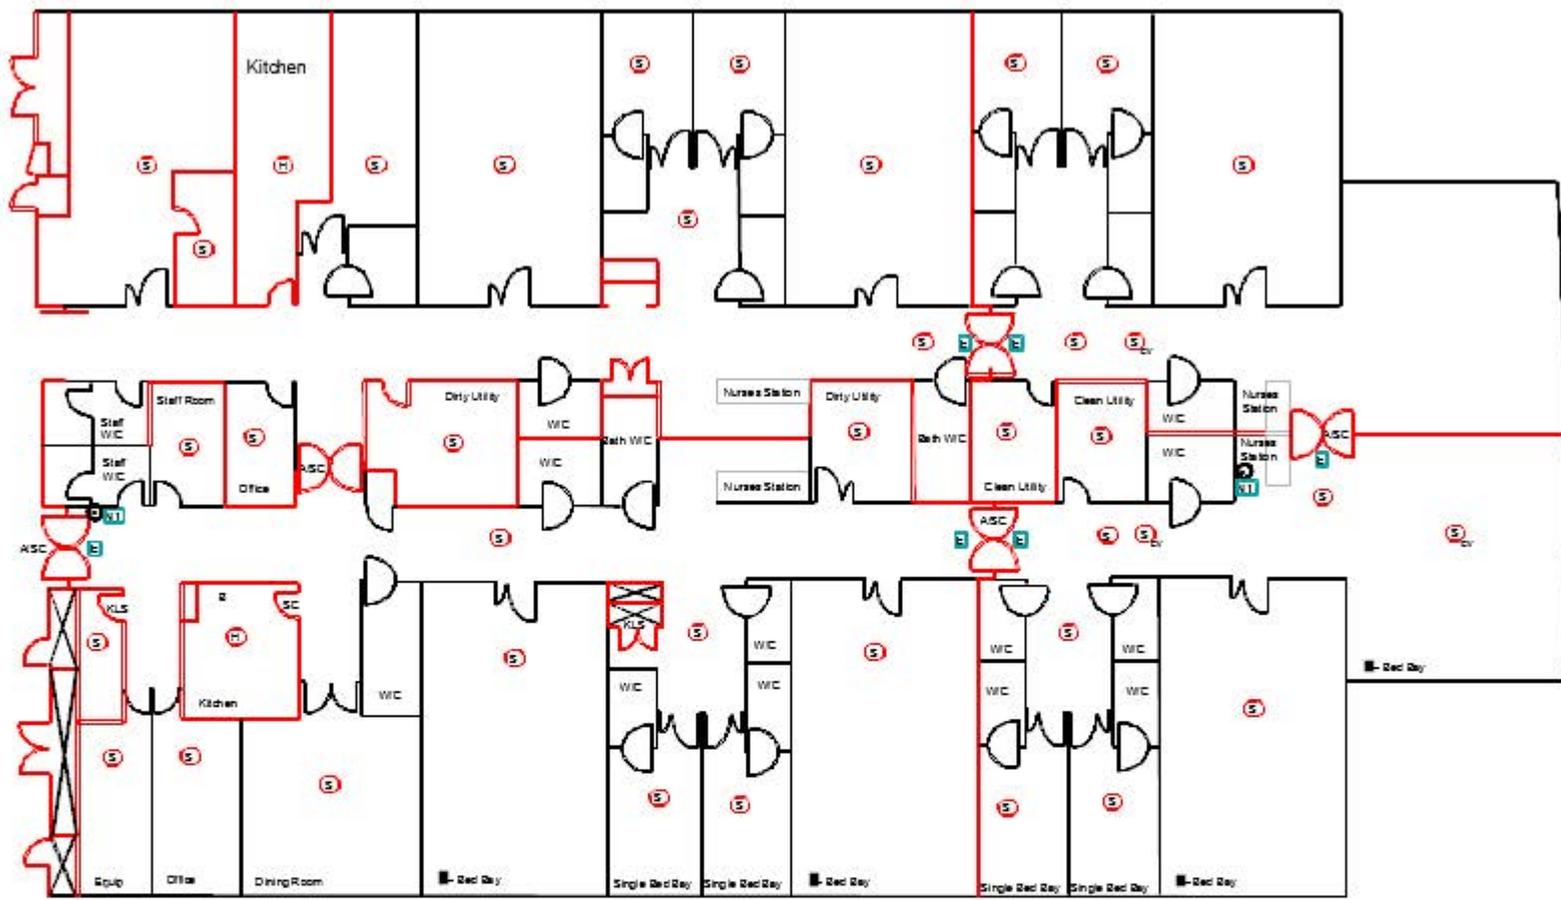


KEY

- (S) Automatic Smoke Detector
- (S_{CV}) Automatic Smoke Detector in Ceiling Void
- (H) Automatic Heat Detector
- (E) Exit Sign
- (E, E, E, E) Directional exit Sign
- (N1) Fire Action Notice
- (EL) Fire Alarm Break Glass Call Point
- (FAP) Fire Alarm Panel
- (W) 9 Ltr Water extinguisher
- (F) 9 Ltr Foam extinguisher
- (C₀₂) 2Kg Carbon Dioxide extinguisher
- (B) Fire Blanket
- (SC) Self-closing Fire resistant door
- (KLS) Keep Locked Shut
- (EL) Emergency Lighting Unit
- (PB) Approved emergency fastening
- (ASC) Automatic Selfclosing Fire resistant door

Prepared by	Checked by	Reviewed by	Approved by	Date	Scale	Notes
PAH						Existing VS Proposed Fire Safety Drawings
				PAH	22/01/2022	

Proposed Fire Safety Drawings

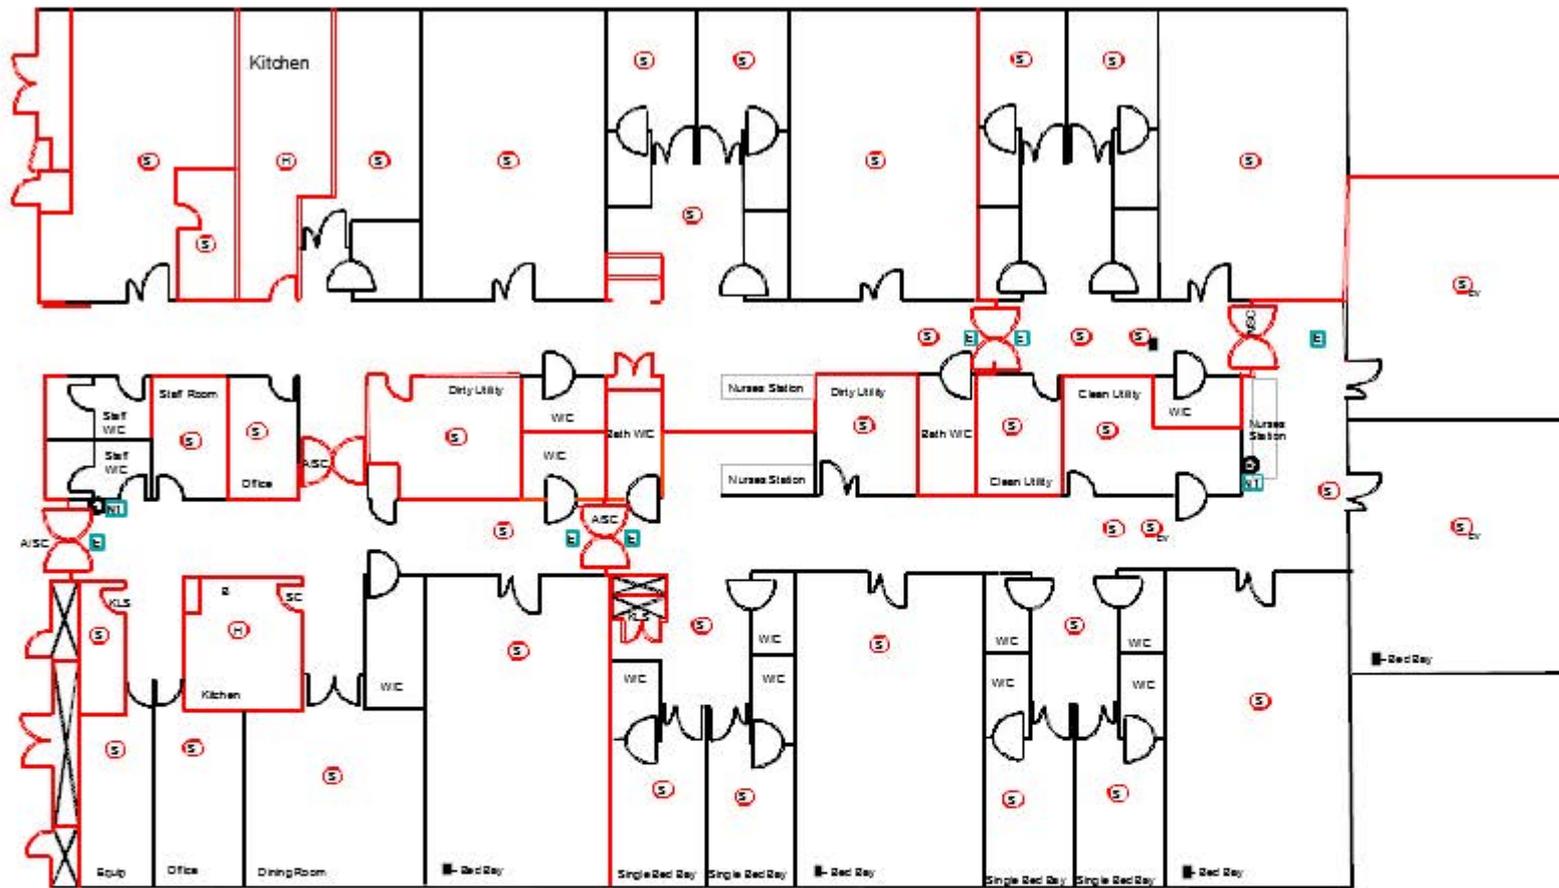

KEY

- | | | | |
|---|--|---|---|
|  | Automatic Smoke Detector |  | 9 Ltr Water extinguisher |
|  | Automatic Smoke Detector in Ceiling Void |  | 9 Ltr Foam extinguisher |
|  | Automatic Heat Detector |  | 2Kg Carbon Dioxide extinguisher |
|  | Exit Sign |  | Fire Blanket |
|  | Directional exit Sign |  | Self-closing Fire resistant door |
|  | Fire Action Notice |  | Keep Locked Shut |
|  | Fire Alarm Break Glass Call Point |  | Emergency Lighting Unit |
|  | Fire Alarm Panel |  | Approved emergency fastening |
| | |  | Automatic Selfclosing Fire resistant door |

Project	Client	Prepared by	Checked by	Approved by	Date	Scale
P&H						1:100
Proposed Fire Safety Drawings						Sheet 2/2