


Proposed Control Room Lighting Layout.

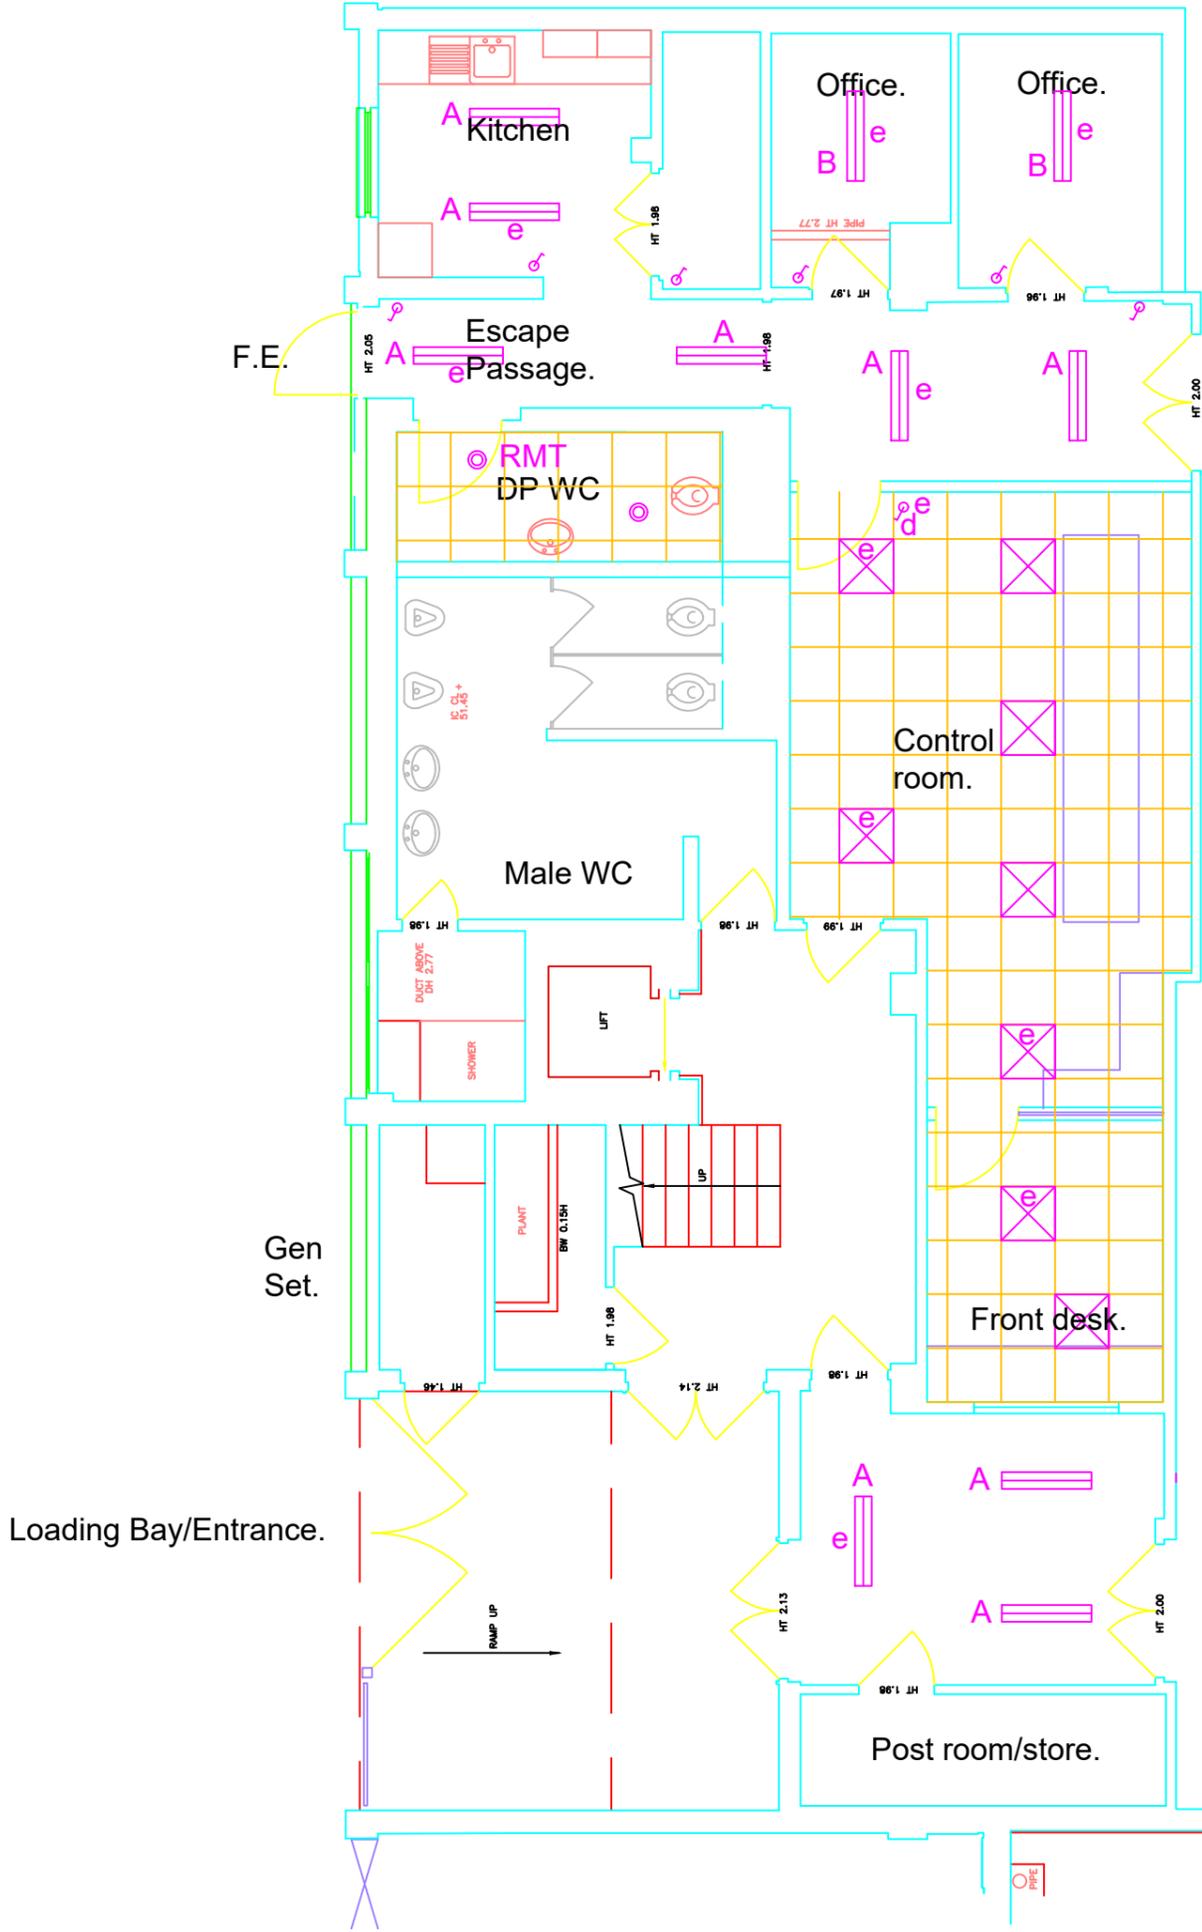

- A  Tamlite Prima surface TMPO4270NW 17W 2700lm.
- B  Tamlite Prima surface TMPO4330NW 28W 4300lm.
-  Tamlite ModuledLGV1 3000lm with Dali and remote 3hr Emergency where shown. PLG6624NW.
- d DALI dimmer control for control room only.
- e 3 hr Self contained Emergency unit.
- RMT Remote Emergency unit.
-  Switch position.
-  Tamlite Nimbus NMB120NW recessed unit.

New lighting installation to be split between the two main supplies. The control room will be connected to the maintained distribution board backed by UPS and generator and the balance of the circuits fed from the non-maintained board. Lighting circuits shall be run in new white PVC conduit and fittings on the ceiling surface. Fittings mounted in suspended ceilings shall be fed by 1.5mm three core butyl flex from a plug in conduit mounted click rose.