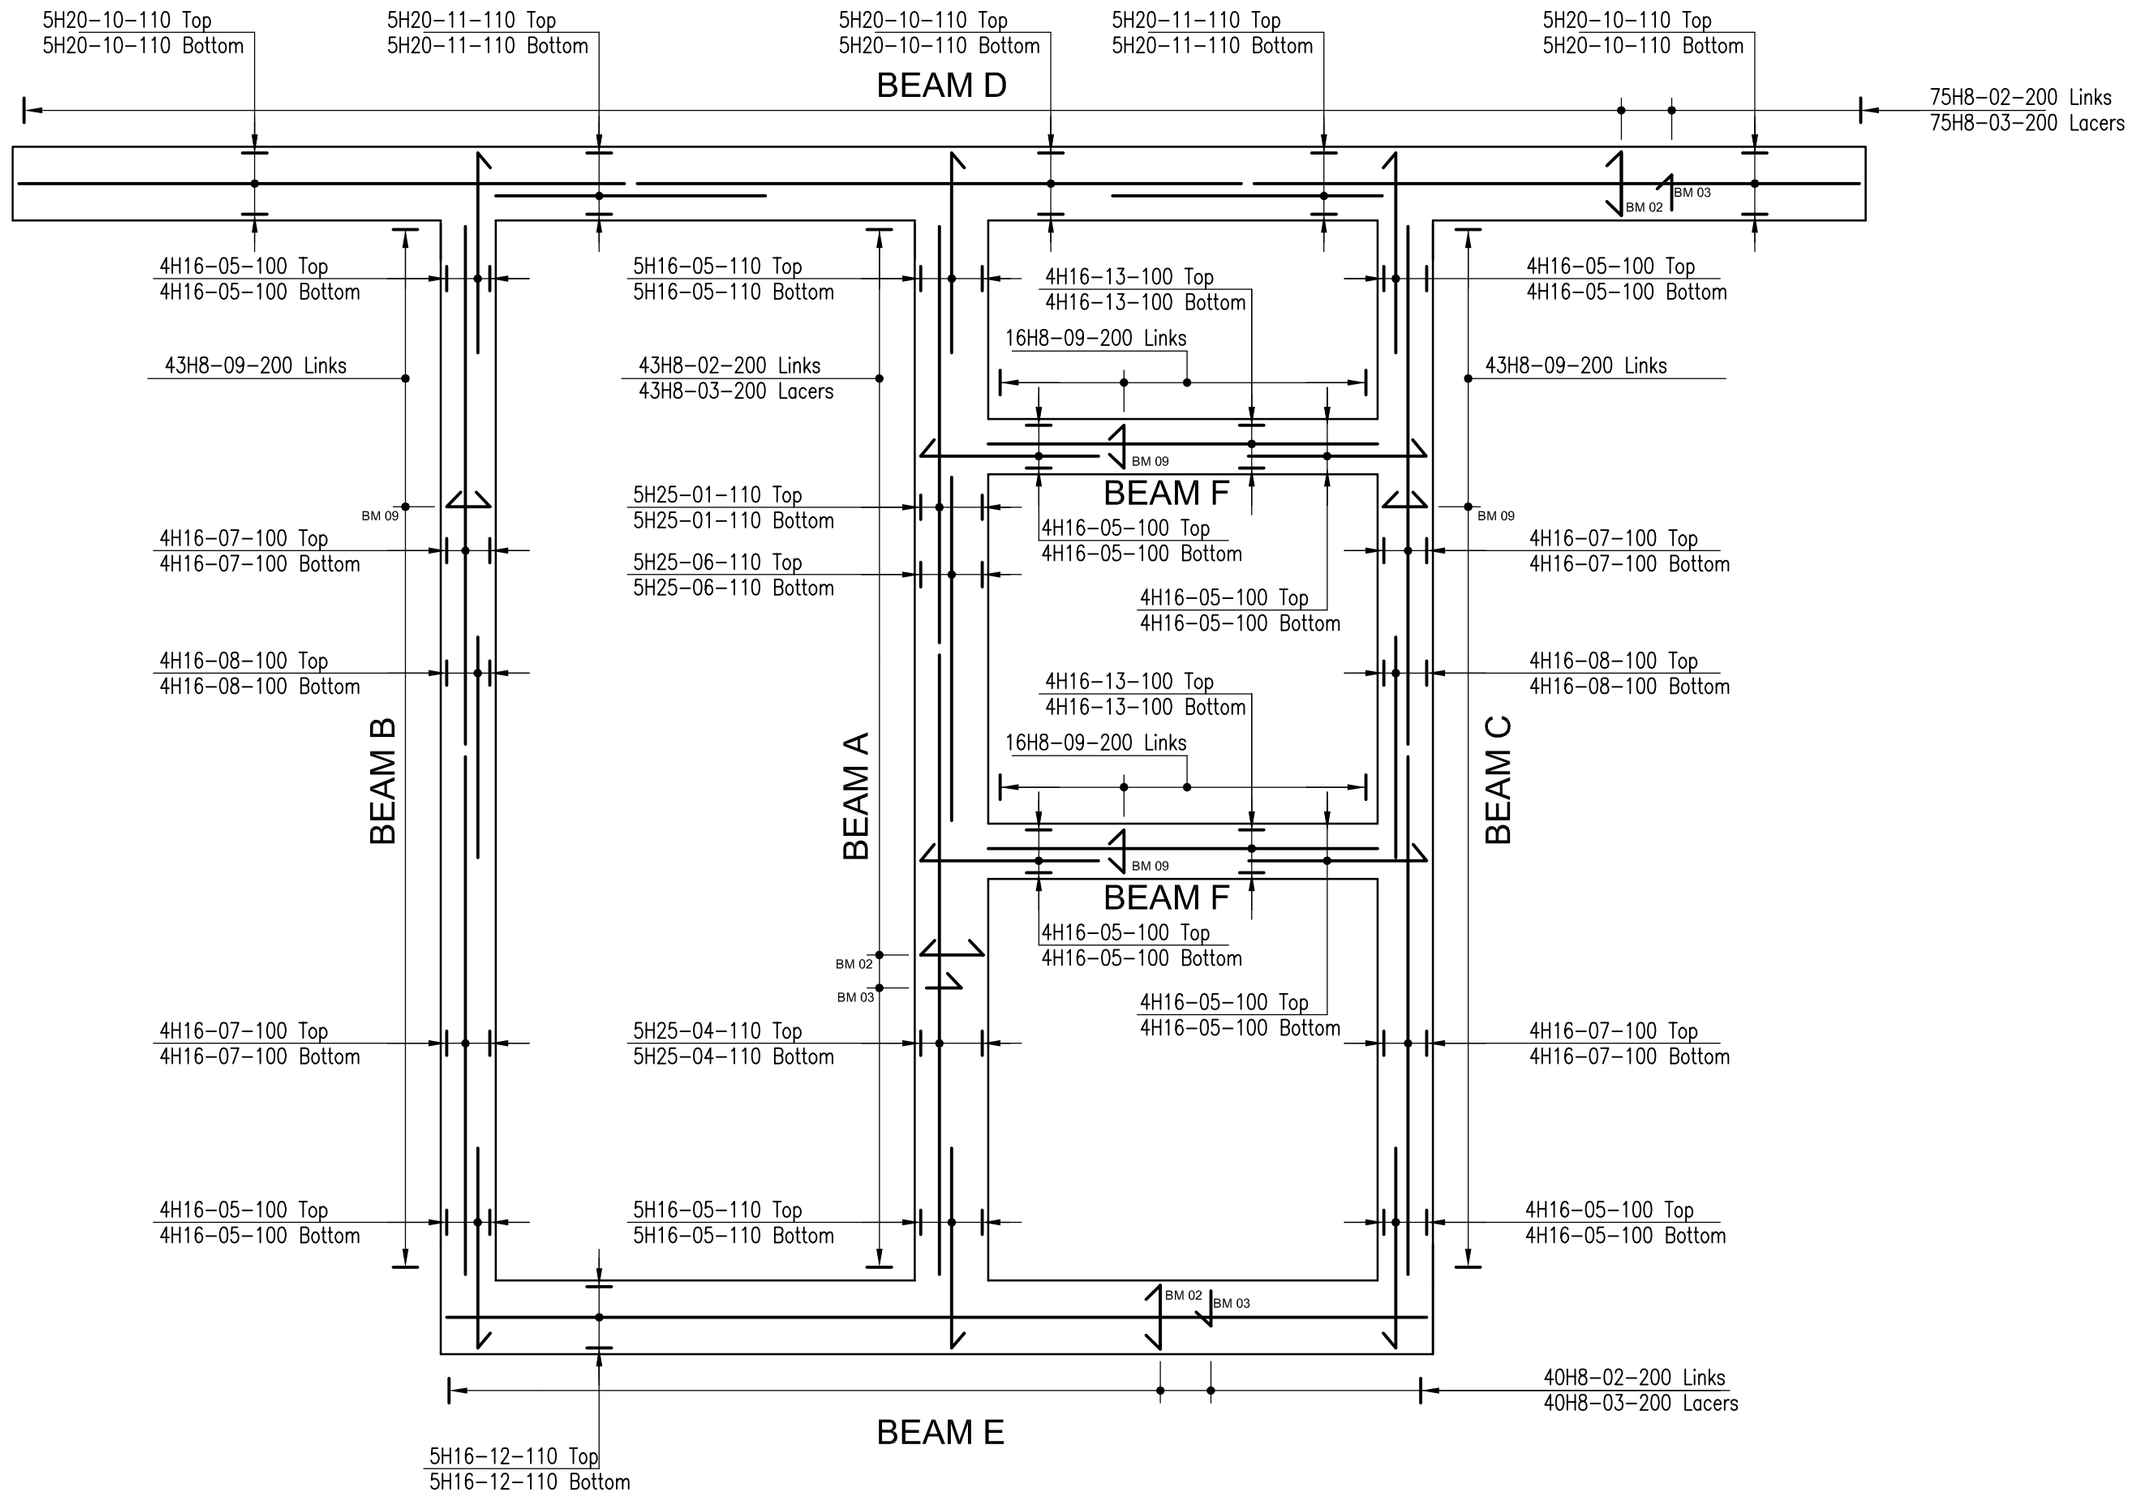

GROUND BEAM REINFORCEMENT DETAILS
Scale1:50

50mm nominal cover to all faces.

Use proprietary shuttering if required by Building Inspector to prevent soil and loose material falling in when concrete is placed.

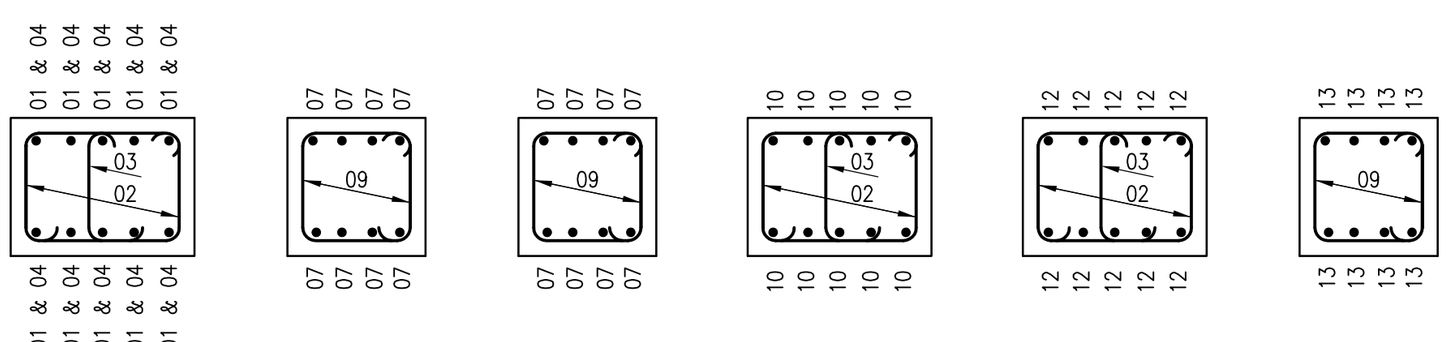

BEAM A Scale 1:20 | BEAM B Scale 1:20 | BEAM C Scale 1:20 | BEAM D Scale 1:20 | BEAM E Scale 1:20 | BEAM F Scale 1:20

REINFORCEMENT NOTES

Nominal reinforcement cover 50mm to all faces of beams.

Refer to Bar Bending Schedule ref u141.01

Unless shown otherwise, lap lengths to be a minimum of:
- H16 880mm
- H20 1100mm
- H25 1400mm

Example of reinforcement call up:
8H10-02-200

- 8 Number of bars
- H10 Type and size of bar
- 02 Bar mark
- 200 Bar spacing

REF.	REVISIONS	DATE
B	– –	–
A	– –	–
–	ISSUE FOR COMMENT	05/09/19

CHEDDAR PARISH PAVILION SHARPHAM ROAD PLAYING FIELDS, CHEDDAR

FOUNDATION REINFORCED CONCRETE DETAILS

Sand Engineering Consultants
Beggars Roost Wedmore
Somerset BS28 4XF
Tel 01934 712427
david@sandengineering.co.uk
www.sandengineering.co.uk

SCALES:			
AS SHOWN @ A2	DRAWN	KMB	Sept 19
	CHECKED	DCB	Sept 19
	APPROVED		

DRAWING No.
u141/04 Rev –