


DO NOT SCALE FROM THIS DRAWING.  
THE CONTRACTOR SHALL CHECK ALL DIMENSIONS AND REPORT ANY OMISSIONS OR ERRORS.  
ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.

LEGEND

- BD BALANCING DAMPER
  - CT CONTROL THERMOSTAT
  - CV CEILING VCD
  - DTG DOOR TRANSFER GRILLE
  - DTLL DROP TO LOW LEVEL
  - E EXTRACT
  - EG EXTRACT GRILLE
  - EX EXISTING
  - FAR FLOW AND RETURN
  - Htg HEATING
  - RAD RADIATOR
  - S SUPPLY
  - SD SUPPLY DIFFUSER
  - SD VOLUME CONTROL DAMPER
  - VCD
- #/ DENOTES EQUIPMENT REFERENCE
- ▬ DENOTES EXTENT OF STRIP-OUT WORKS

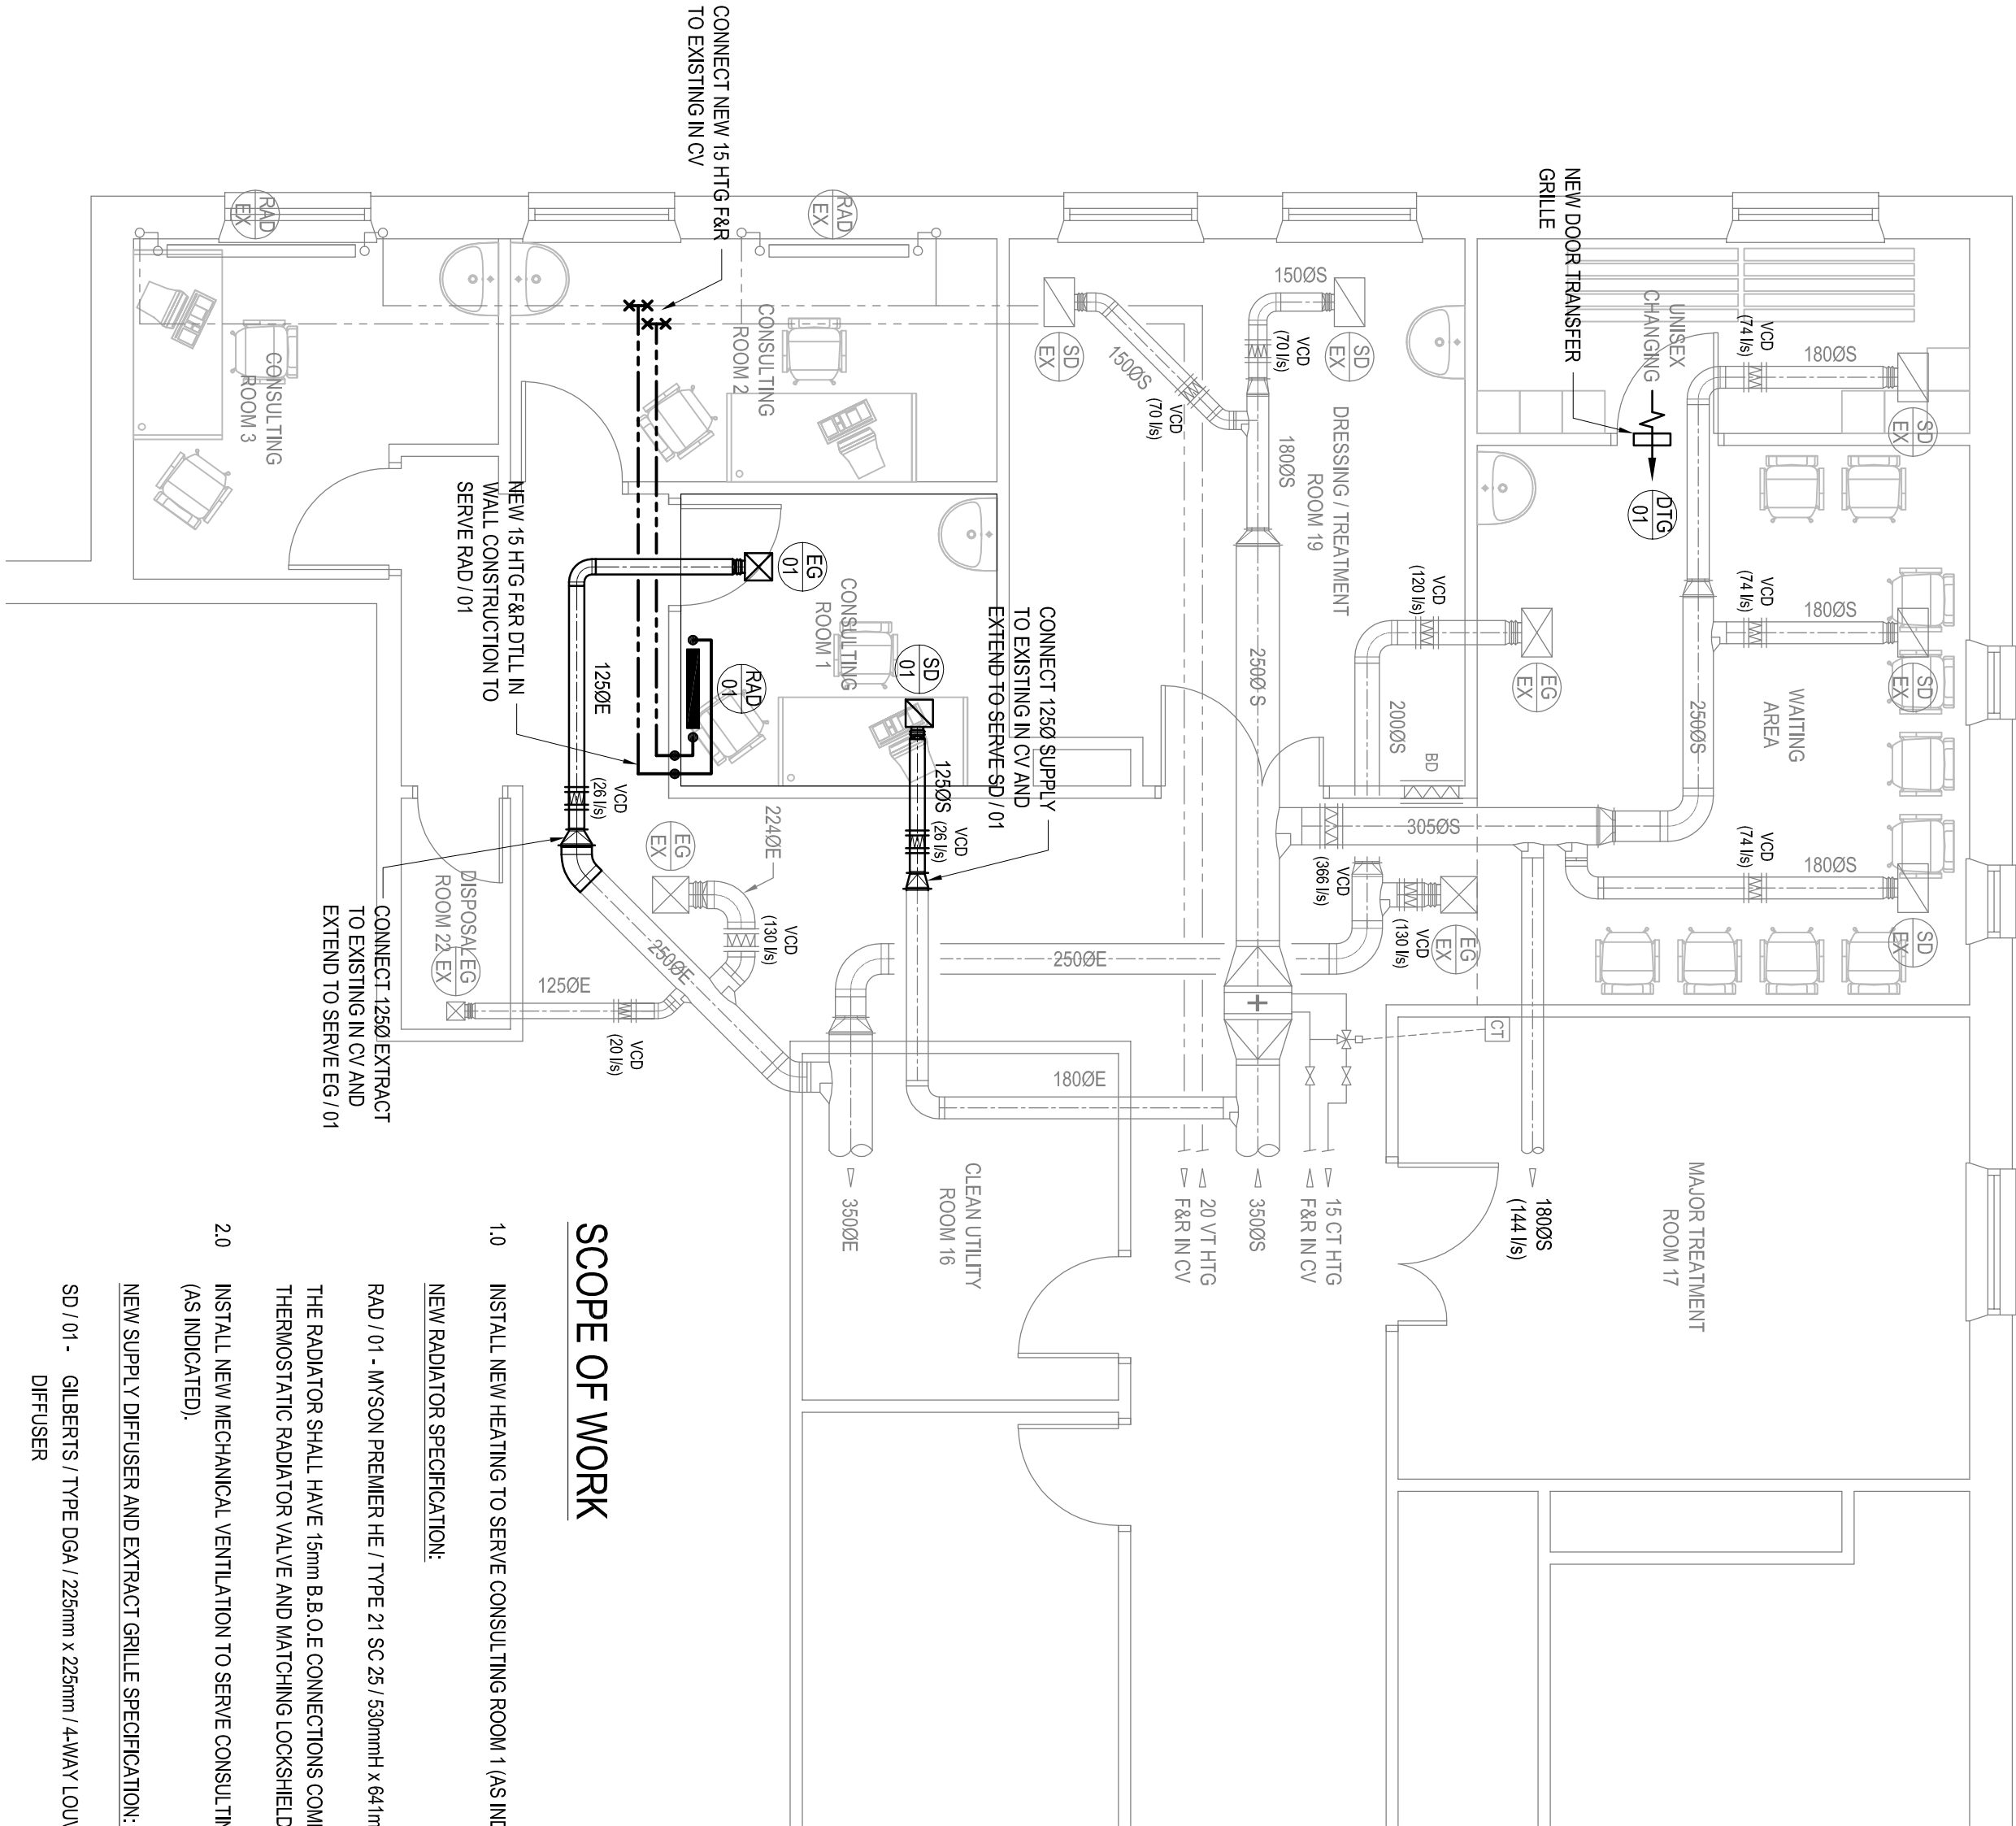


SCOPE OF WORK

- 1.0 ALL EXISTING HEATING SHALL BE RETAINED AND PROTECTED DURING THE WORKS.
- 2.0 STRIP-OUT EXISTING MECHANICAL VENTILATION (AS INDICATED). ALL OTHER MECHANICAL VENTILATION SHALL BE RETAINED AND PROTECTED DURING THE WORKS.
- 3.0 INSTALL NEW DOOR TRANSFER GRILLE BETWEEN UNISEX CHANGING AND WAITING AREA (AS INDICATED).
- 4.0 RE-BALANCE EXISTING MECHANICAL VENTILATION IN ACCORDANCE WITH THE AIR VOLUMES INDICATED (AIR VOLUMES ARE NOTED IN BRACKETS NEXT TO EACH VOLUME CONTROL DAMPER).
- 5.0 CARRY OUT TESTING AND COMMISSIONING IN ACCORDANCE WITH APPROPRIATE CIBSE COMMISSIONING CODES AND TO THE COMPLETE SATISFACTION OF THE ENGINEER / CLIENT. THE CONTRACTOR SHALL PROVIDE COMMISSIONING / TEST REPORTS AS REQUIRED BY THE ENGINEER / CLIENT.
- 6.0 PROVIDE OPERATING AND MAINTENANCE INSTRUCTIONS (INCLUDING AS INSTALLED DRAWINGS) FOR INCLUSION IN THE PROJECT HEALTH AND SAFETY FILE. THE INSTRUCTIONS SHALL BE PROVIDED IN AN APPROVED FORMAT TO THE COMPLETE SATISFACTION OF THE ENGINEER / CLIENT.

PROPOSED LAYOUT

SCALE - 1:50

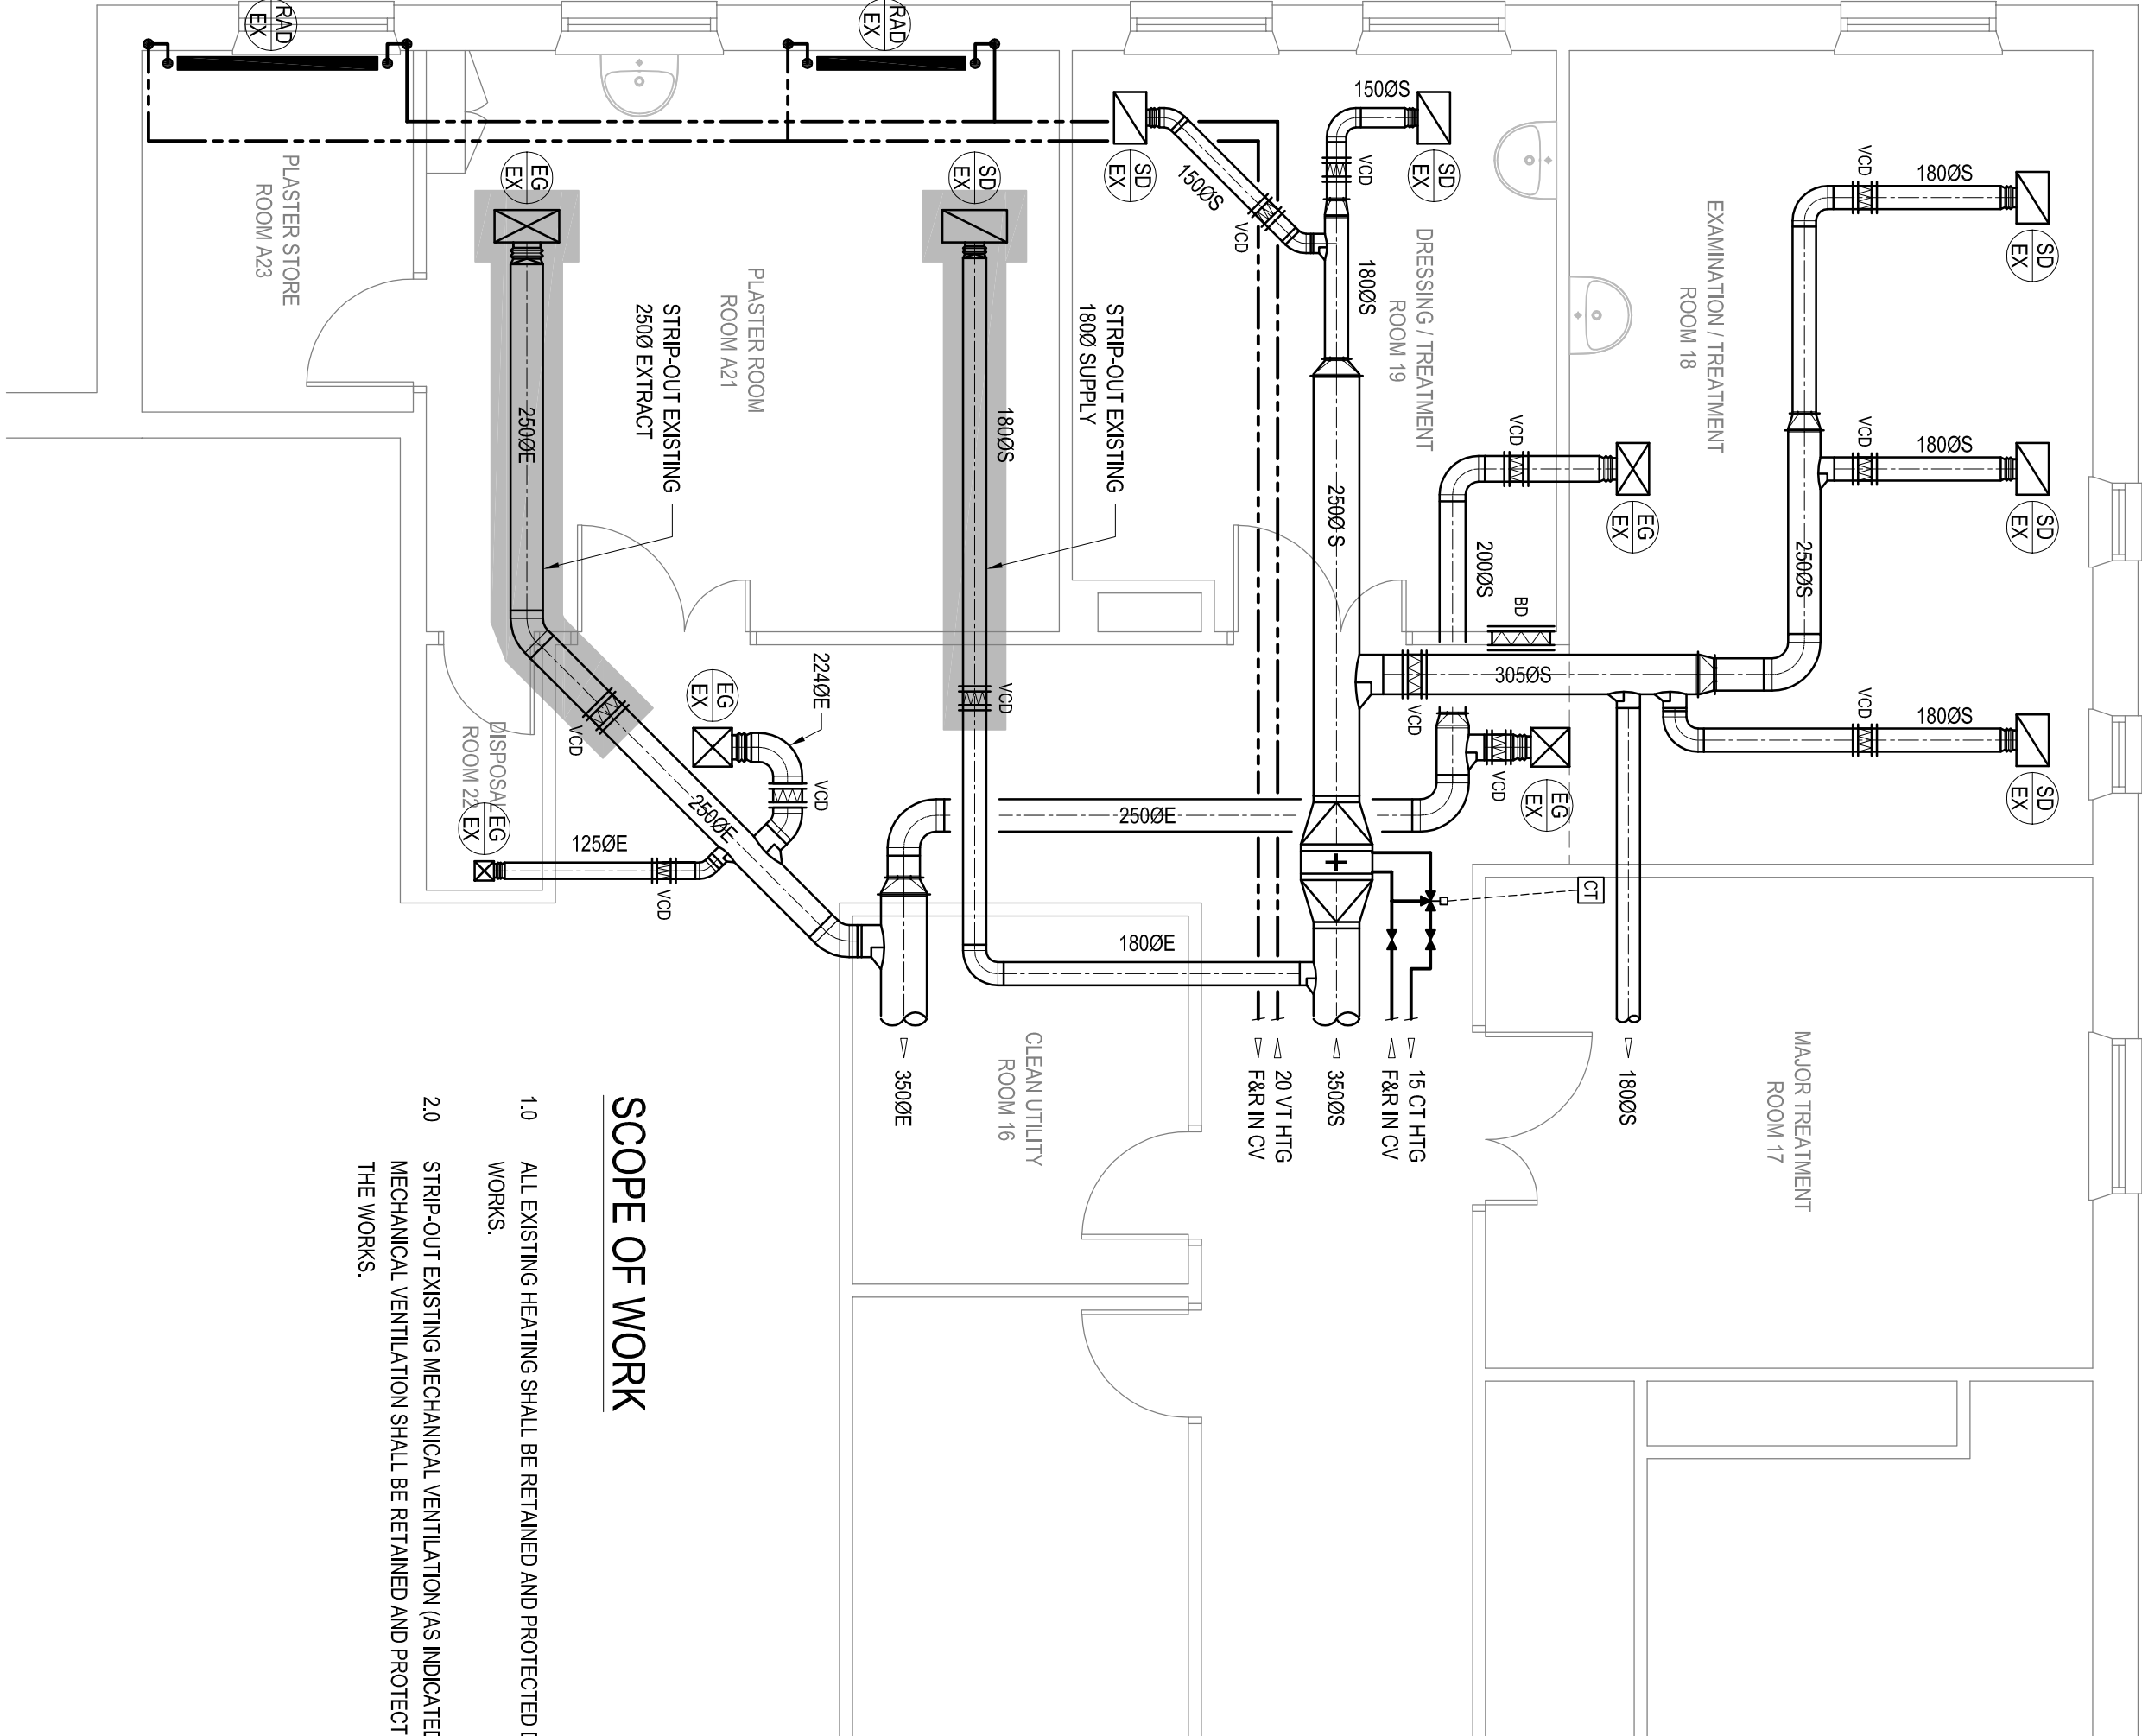

SCOPE OF WORK

- 1.0 ALL EXISTING HEATING SHALL BE RETAINED AND PROTECTED DURING THE WORKS.
- 2.0 STRIP-OUT EXISTING MECHANICAL VENTILATION (AS INDICATED). ALL OTHER MECHANICAL VENTILATION SHALL BE RETAINED AND PROTECTED DURING THE WORKS.

EXISTING LAYOUT

SCALE - 1:50

Rev					
T1	ISSUED FOR TENDER	GS	SB	08/06/15	
	Purpose of Issue/Modifications	By	Chkd	Date	

Client:  
YORK TEACHING HOSPITAL NHS FOUNDATION TRUST

Project:  
ALTERATIONS TO AND CLINIC BUILDING AND DISTRICT HOSPITAL

Task:  
MECHANICAL SERVICES HEATING AND MECHANICAL VENTILATION EXISTING AND PROPOSED LAYOUT

Drawn By:  
A1

Scale:  
1:50

By:  
GS

Checked:  
SB

Rev:  
T1

184-0191 36531111 Fax-0191 36539111 Email-adv@yorkhospitals.co.uk

The City Centre  
Scots 1  
Bowes Cross  
Lambton Park  
Durham

ihpartners