


Map Response
 Western Power Distribution
 Toll End Road, Tipton
 DY4 0HH
 Phone 0121 623 9780

Date Requested: 10/05/2013
 Job Reference: 877415
 Site Location: 395630 219578
 Requested by: MR Geoff Beer
 Your Scheme/Reference: Southfield Manor

1:1250 Area or Circle dig site
 1:500 Line dig site


IMPORTANT NOTICES

- These plans are provided as a general guide only. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present but will not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- **Report damage to 0800 328 1111 immediately – KEEP EVERYONE AWAY FROM THE AREA**

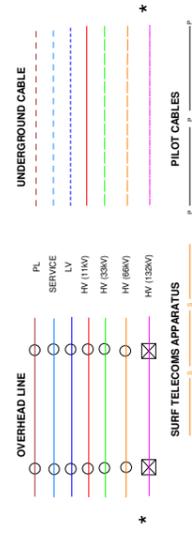

*Advice should be sought from the Western Power Distribution Contact Centre for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines – 0800 096 3080

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: EL27318X, 100024877 and 100021807.
 WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

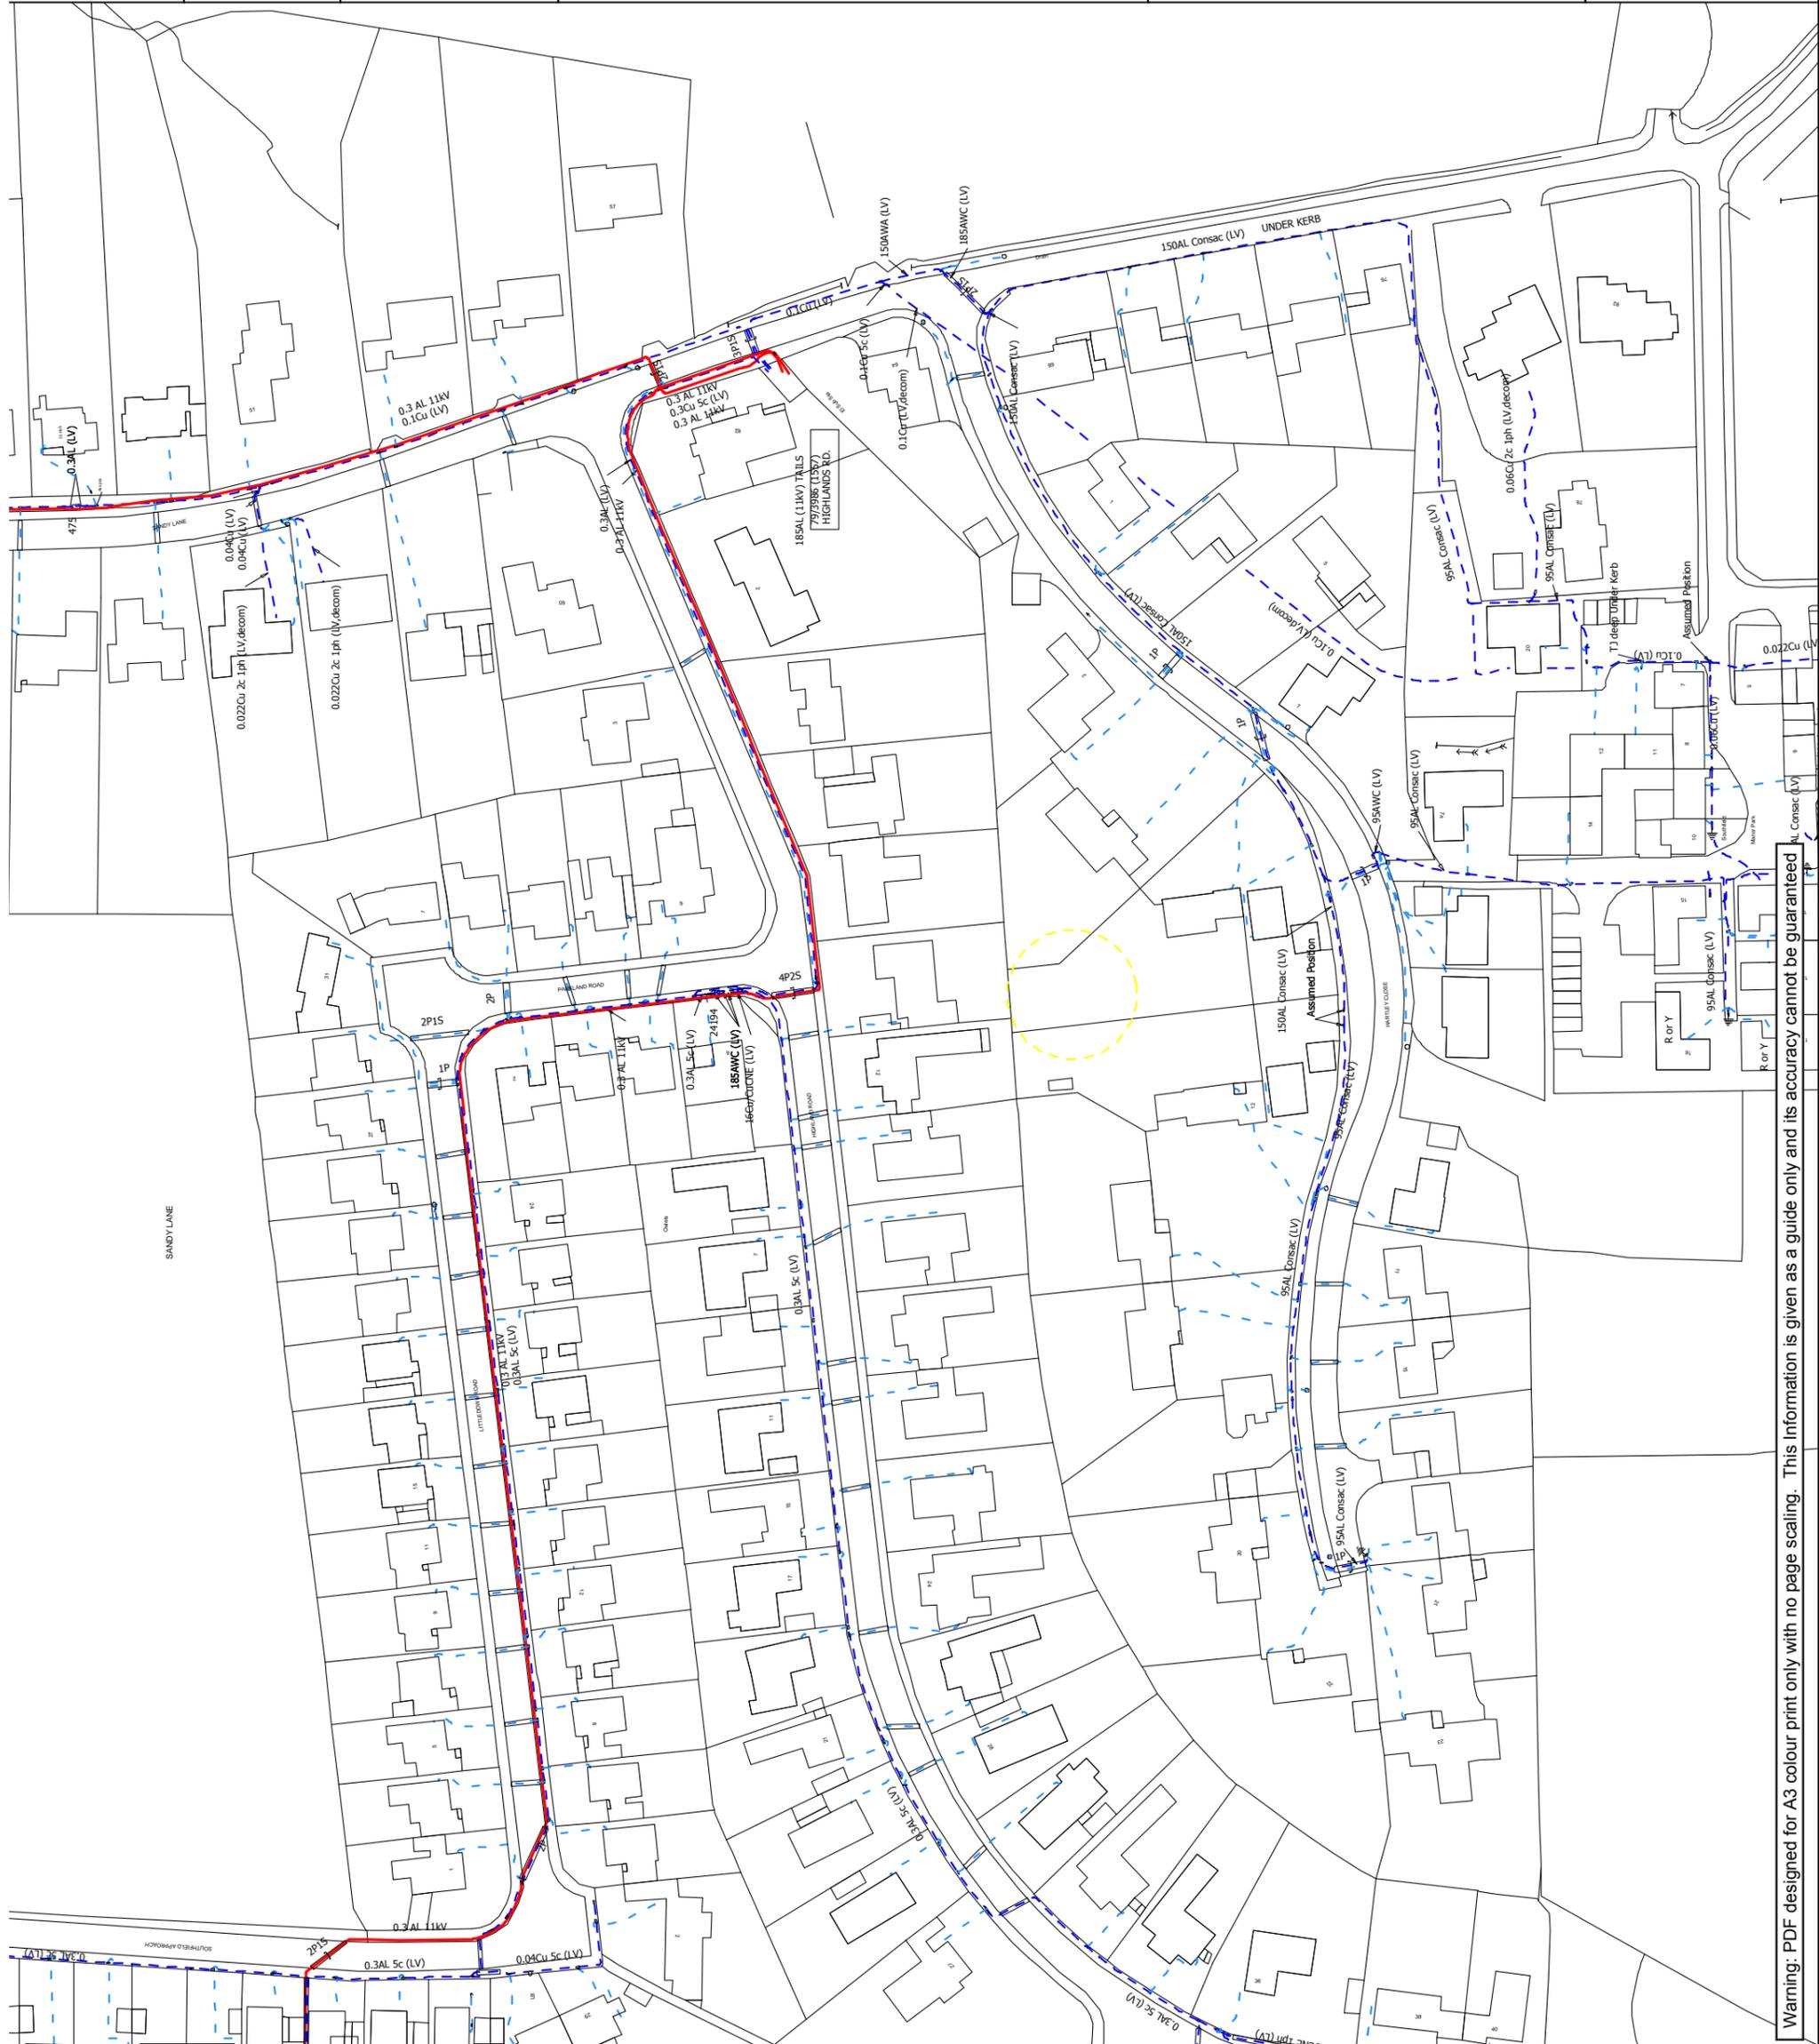

Warning: PDF designed for A3 colour print only with no page scaling. This information is given as a guide only and its accuracy cannot be guaranteed