
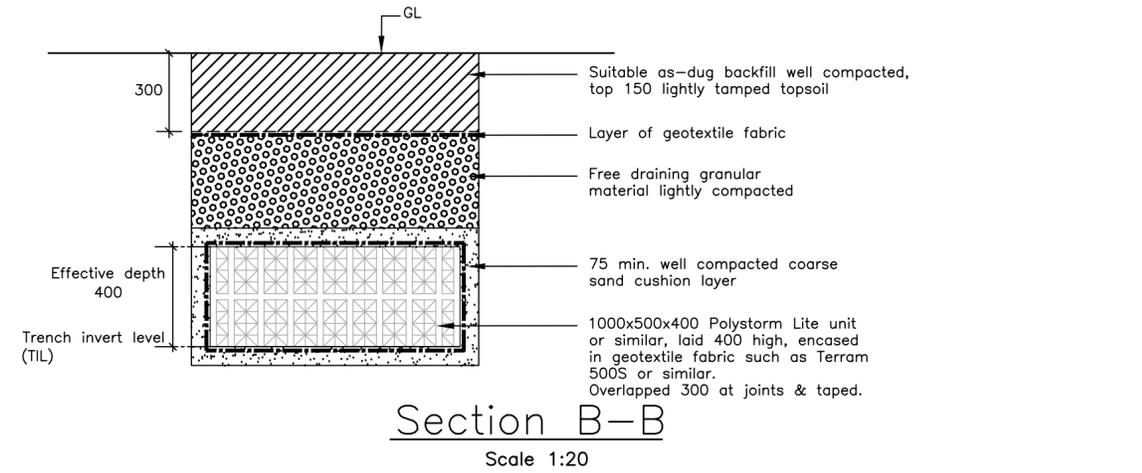
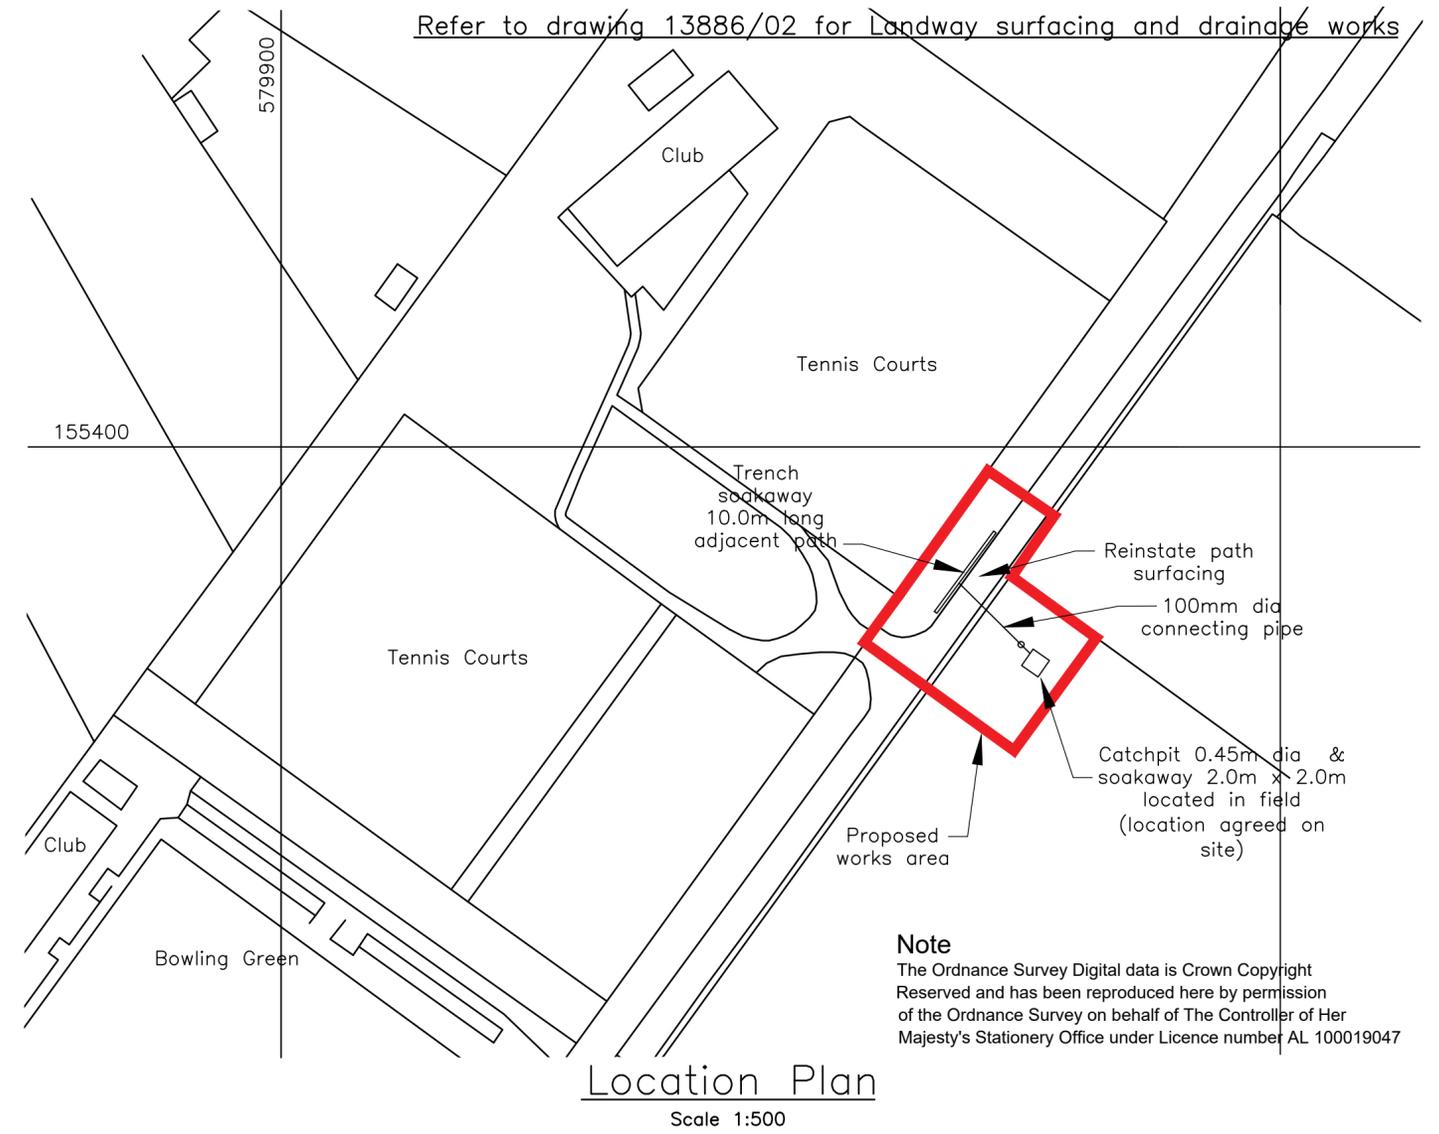


- GENERAL NOTES:**
1. Do not scale this drawing.
 2. All dimensions are in millimetres unless otherwise stated.
 3. Machinery/plant to be suitable for use and not detrimental to adjacent and surrounding structures and features.
 4. All surface water manholes / catchpits may be single seal cover and frames.
 5. All manholes to have either SW or FW cast into the cover as appropriate.
 6. The manhole chamber sizes quoted are the minimum. If two or more pipes enter the manhole, the chamber size must be sufficient to accommodate adequate benching.
 7. Cover and frames to manholes/inspection chambers to comply with BS EN124.
 8. Suitable 'as dug' material to comply with Appendix A of BS5955. The maximum particle size should not exceed 20mm and be free from stones exceeding 40mm. The presence of an occasional particle between 20mm and 40mm is acceptable provided the total quantity of such particles is only a very small fraction of the whole, but shall not be allowed within the first 100mm of pipe cover. If particles exceed 40mm then the material shall be rejected.
 9. Backfill should be placed in layers not exceeding 300mm uncompacted thickness, each layer being well compacted. Mechanical compaction equipment should not be used until there is a minimum of 450mm of compacted material above the crown of the pipe.
 10. Carpark surfacing is to be compacted in accordance with Specification For Highways Works Clause 802.

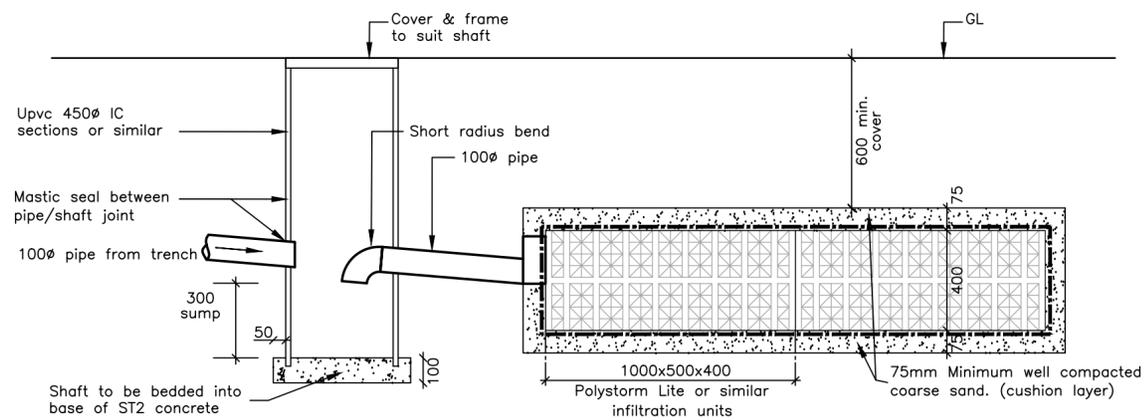

Note
The Ordnance Survey Digital data is Crown Copyright Reserved and has been reproduced here by permission of the Ordnance Survey on behalf of The Controller of Her Majesty's Stationery Office under Licence number AL 100019047

Evans & Langford LLP

- Structural & Civil Engineers
- Land & Building Surveyors
- Geo-Environmental Engineers
- Project Managers
- CDM Consultants
- Contract Administrators

Evans & Langford LLP, 91 King Street, Maidstone, Kent ME14 1BG
www.evanslangford.com Tel +44 (0) 1622 690120 mail@evanslangford.co.uk

Revisions		Checked	Date	Scale
A	Plan amended	DM	17.11.2016	1:500 1:20 1:10 © A2

Drawn	CAS
Date	Sept 16
Checked	DM
Date	Sept 16
Approved	
Date	

Bearsted, Church Landway

Trench and Crate Soakaway

13886/01A