Notes

This Drawing is an instrument of service and shall remain the property of Kier. It may not be reproduced or copied in any form. It shall not be used for the construction, enlargement or alteration of a building or area other than the said project without the authorisation of the issuing office.
Contractors shall verify and be responsible for all dimensions and conditions and shall report any discrepancies to the issuing office before proceeding with any work. Drawings shall not be scaled.

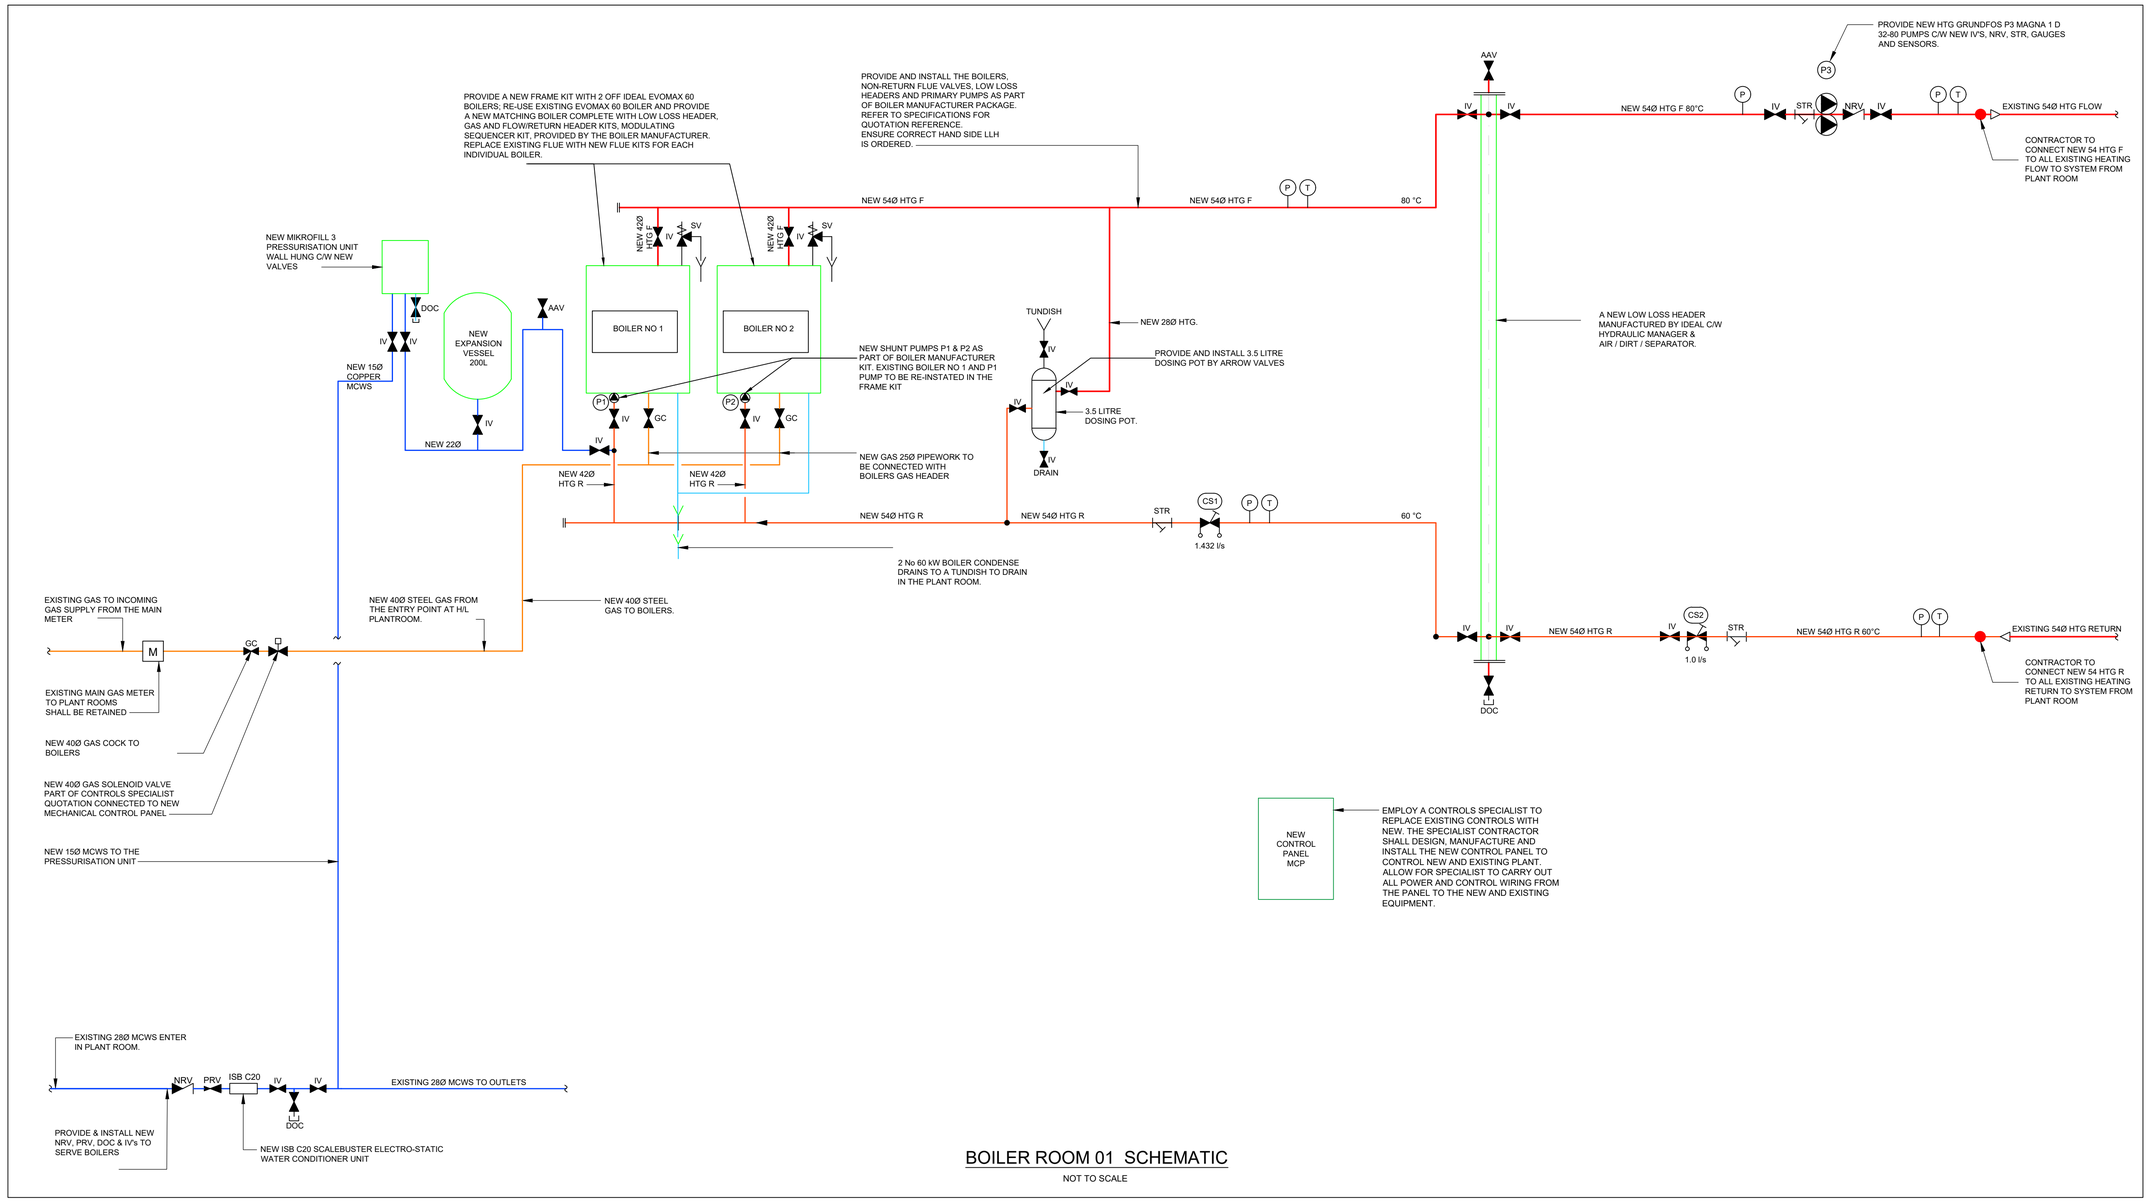

BOILER ROOM 01 SCHEMATIC

NOT TO SCALE

PIPEWORK VALVE SYMBOLS

IV	Isolation valve
DRV	Double regulating valve
FMD	Flow measuring device
CS	Commissioning set
NRV	Non-return valve
	Pump
SV	Angle safety valve
SC	Stop cock
DOC	Drain off cock
PRV	Pressure reducing valve
T	Temperature gauge.
P	Pressure gauge.
To CP	Pressure sensor to control panel.
STR	Strainer
MV	Motorized three port control valve
	Tundish to drain
AAV	Automatic air vent
CT =	Constant heating circuit
VT =	Variable temperature circuit

NOTE

For layout of the Boiler Room see drawing No. 23474-17-KBS-01-00-DR-M-6501.

Rev.	Details	Author & Date	Checked & Date	Approv'd & Date
P01	Tender Issue.	A.K. 13-05-19	A.K. 13-05-19	O.T. 13-05-19

KIER

Issuing Office: STEVENAGE
Tel. no.: 07557-182506
email: ioannis.kaminiaris@kier.co.uk
Internal Project Number: 23630
Client: Corby Council
Project name: Daneshome Centre
Drawing Title: Proposed Plant Room Schematic

Scale	Original Size	RIBA Stage	
N.T.S.	A1	A4	
Date of First Issue	Author	Checked	Approved
May 2019	A.K.	A.K.	O.T.

Drawing Number: 23630-KBS-XX-XX-DR-M-6601
Status: D2
Rev.: P01
Project | Originator | Volume | Type | Role | Number