


SCALE: 1 : 100




0 1 2 3 4 5 10

GRAPHIC SCALE 1:100

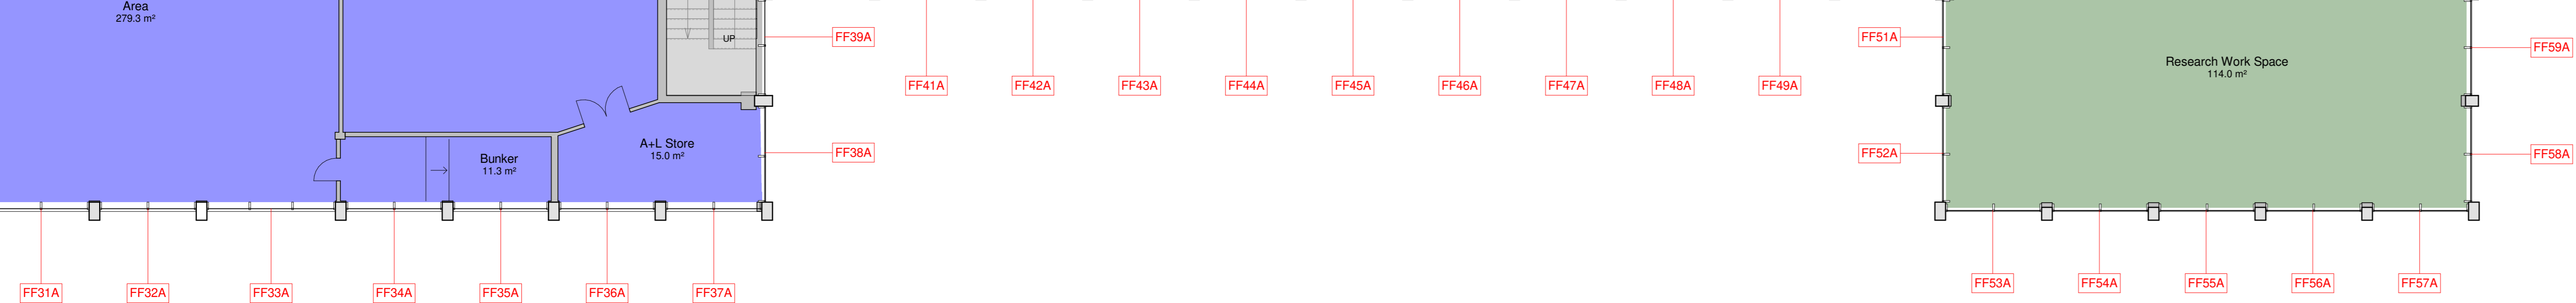













SCALE: 1 : 100



GRAPHIC SCALE: 1:100

Areas remaining as existing / not in scope of works

- | | |
|---|--|
|  | Conference and Multipurpose Space / Exhibition Space and Boardroom (Customer Hub 1 First Floor) |
|  | Dark Room and AV Studio / Storage (AV Suite) |
|  | Dual Function Space (Access and Learning / Commercial) |
|  | Historic Colonnade and Glazing |
|  | Immersive Learning Zone (Access and Learning) |
|  | Inspire Zone - VR and Experiences, Inspire & Explore Zone - Pay to Play and Commercial Space (Customer Hub 2 Ground Floor) |
|  | Inspiring Work Spaces (Office and Meeting Rooms - First and Second Floor) |
|  | Main Entrance Lobby / Exhibition Space (Customer Hub 1 Ground Floor) |
|  | Research Centre (Archive and Library), Art Collection and Photographic Collection |
|  | Research Zone (Formal + Informal) and Multipurpose Space (Customer Hub 2 First Floor) |
|  | Staff Rest Area (First Floor) |
|  | Toilet Block 2 (Visitor and ILZ facilities) and Central Wing hangar storage |

☐ Proposed curtain walling bays

- | | | |
|------------|---|---|
| <p>GF1</p> | <p>Proposed curtain walling bays with lower security requirement.
Recommended glazing requirements – 8mm Toughened glass
outer pane and 9.5mm Laminated glass inner pane. Glazing
and system design values for U value/G value solar transmittance
and light reflectance values are to be determined by glazing
sub-contractor/M.E designer</p> | <p>Proposed look-alike opaque
glazing insulated panes</p> |
| <p>GF1</p> | <p>Proposed curtain walling bays with lower security requirement.
Recommended glazing requirements – 8mm Toughened glass
outer pane and 9.5mm Laminated glass inner pane. Glazing
and system design values for U value/G value solar transmittance
and light reflectance values are to be determined by glazing
sub-contractor/M.E designer</p> | <p>Proposed look-alike opaque
glazing insulated panes</p> |

- All pro...


- Redecorate façade inclusive of scraping/sanding and x2 masonry paint coats to match existing - to areas of facade non-glazing elements
- Manifestation on glazing and glazed doors should be incorporated in accordance to Part K of the UK Building Regulations

Indicative spec for internal window blinds to be fixed in

glazing to include for fixing of new manually operated vertical blinds, after removal of existing. Blinds to be Waverley Blinds VL-M mono chain controlled vertical blind system or equal approved. Blinds to be track fixed to head of opening reveal and to incorporate cord retainer fixed minimum 1500mm above FFL to be compliant with child safety requirements. Vertical slats betascreen 90 fabric for reduction of solar glare. Slat width 89mm. Colour white or from standard colour range. Areas of high-level barrel-vaulted glazing to include curved head track. All fixed in accordance with manufacturers requirements.

[illegible]

100

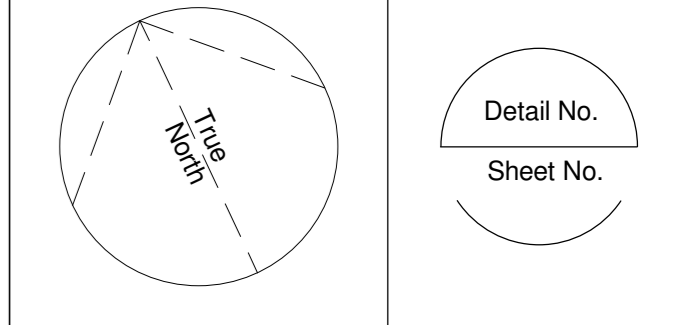

100



Drawn RP	Date 13.01.2022
Checked PA	Date 13.01.2022
Scale As indicated	
Client RAF MUSEUM, HENDON	
Project RAF MUSEUM HANGAR 3.4 + 5 REPLACEMENT GLAZING PROJECT	
Drawing Title LEVEL 01 - WEST WING PROPOSED GLAZING PLAN	
Sheet Status S4 - FOR APPROVAL	
Project No. IALN20-0048-02	
Drawing No. RAF-NOR-01-01-DR-A-21-0012	Rev. P02