



Notes:

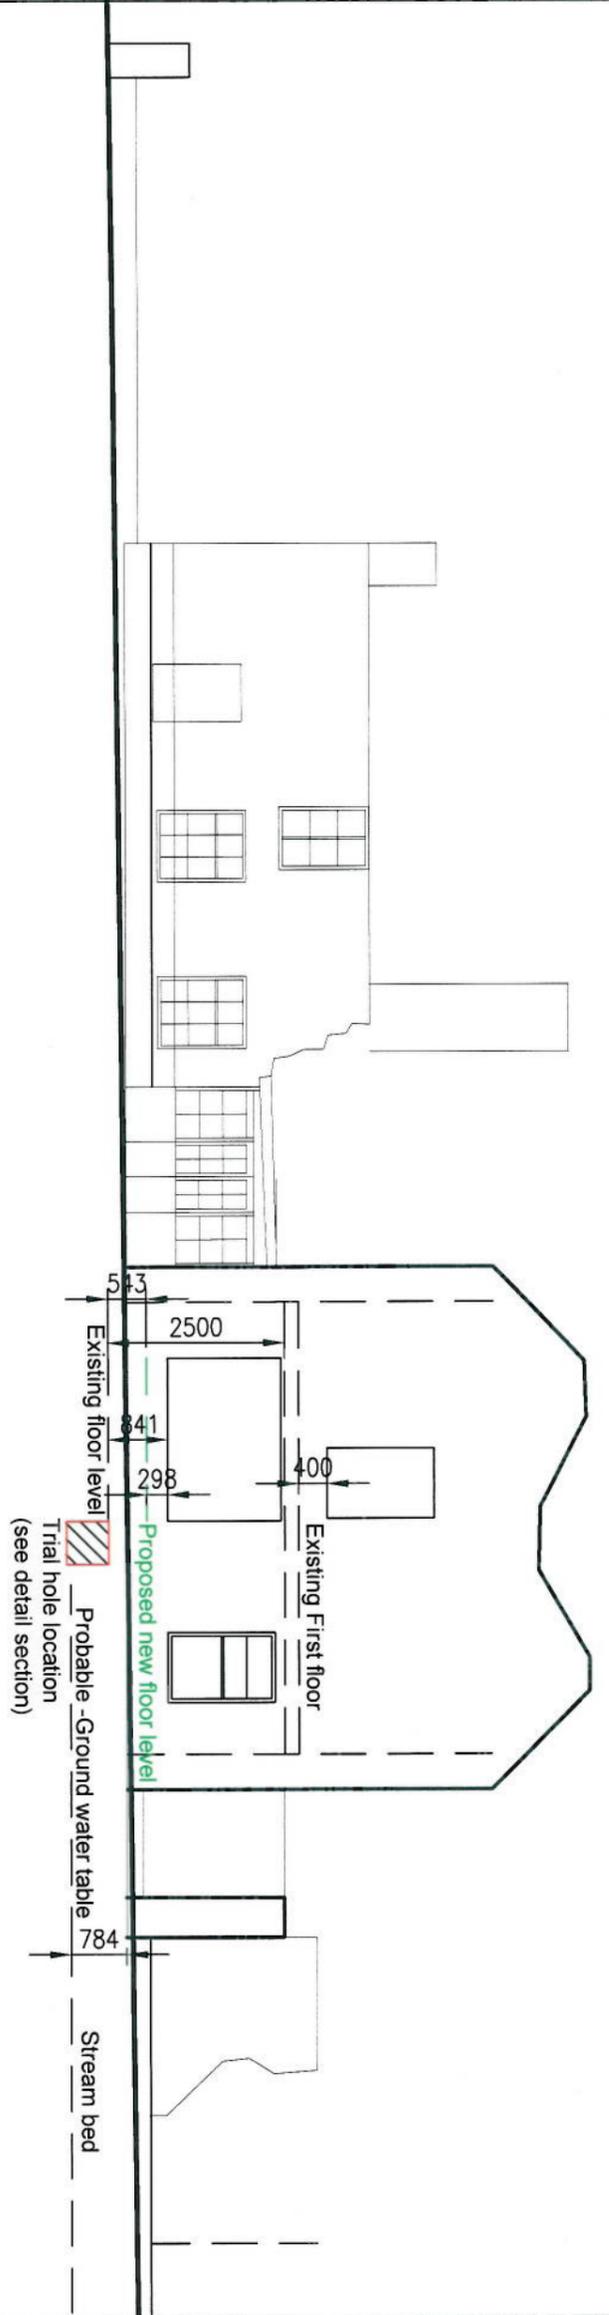

North Elevation (to Station Road)

Site Investigation Note:

A small trial pit was excavated in close proximity to the existing wall & foundation. Excavation was taken to a depth of 800mm to expose the base of the wall & determine foundation soil types.
Foundations are shallow at a depth of 250mm below internal floor level.
The Random rubble wall with lime mortar joints is not provided with a foundation plinth for re-distribution of the dead & imposed loads.
Ground water table is located at a depth of approximately 784 mm as shown.
The soil sample taken at a depth of 800mm, indicates a classification as 'moist' well graded mottled silty SAND. (BGS sheet 339 describes patches of SAND or Upper Green band for the Bovey Basin).

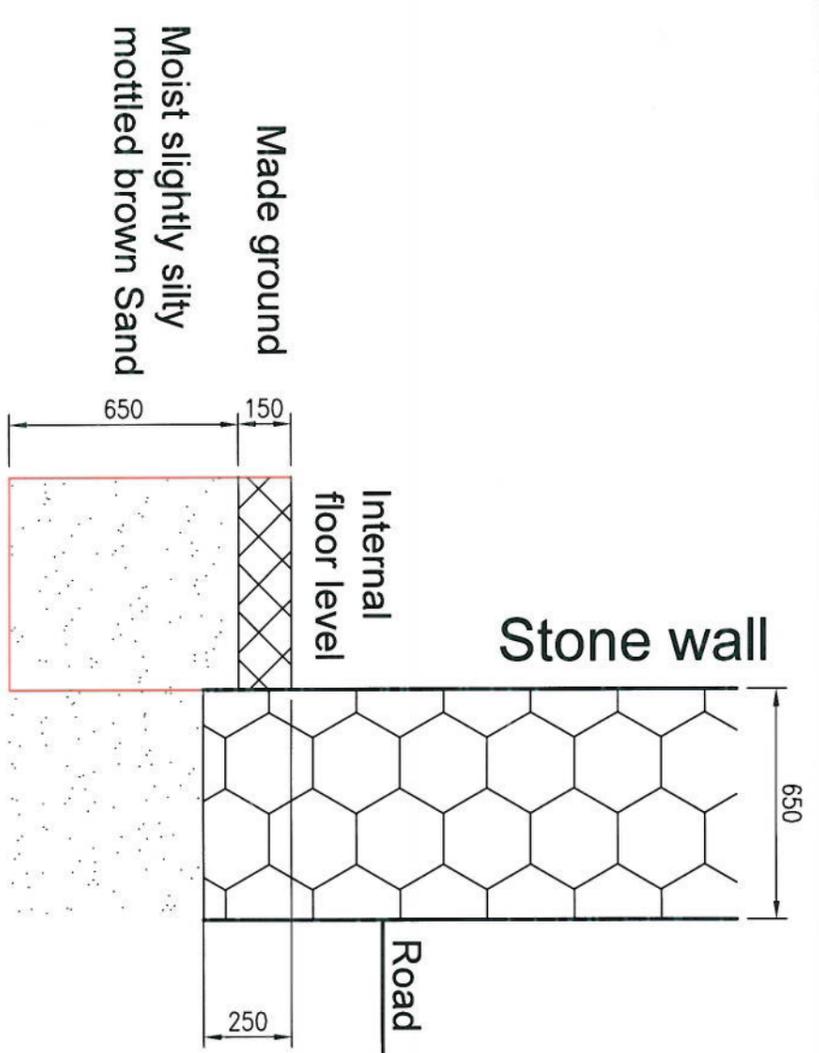

Section AA
Detail of Trial pit - scale 1:20

All dimensions are in millimetres unless stated otherwise and only figured dimensions are to be worked from. Discrepancies should be reported immediately to the relevant person before proceeding.
Copyright Teignbridge District Council 2006. Unauthorised reproduction infringes Copyright and may lead to prosecution or civil proceedings*.
This drawing may have information reproduced from Ordnance Survey material with the permission of Ordnance Survey on behalf of the controller of Her Majesty's Stationery Office (C) Crown Copyright. Unauthorised reproduction infringes Copyright and may lead to prosecution or civil proceedings. License No. 100024292 2006.

REVISIONS

Rev.	Date	By	Details

Scheme Title:
The Old Thatched Inn
Station Road
Bovey Tracey

Drq. Title:
Front Elevation
plus Trial pit detail
Existing - after fire

CAD File Ref:

SX No.	Scheme No.	Drq No.	Rev.
	1414	5	

SCALE
1:100 @ A3

Drawn by	Approved	Date
		Mar 12

