


NOTES

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE SCOPE OF WORKS DOCUMENT.
2. THIS DRAWING REPRESENTS DESIGN INTENT ONLY. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING FULLY CO-ORDINATED DETAILED DESIGN DRAWINGS AND ASSOCIATED CALCULATIONS FOR APPROVAL PRIOR TO COMMENCEMENT OF THE CONSTRUCTION WORKS.
3. THIS DRAWING MUST NOT BE SCALED AND ONLY MEASURED OR CALCULATED DIMENSIONS USED.
4. LOCATIONS OF ACCESSORIES ARE REPRESENTATIVE ONLY. EXACT LOCATIONS SHALL BE CO-ORDINATED WITHIN THE DETAILED DESIGN STAGE AND SHALL BE IN ACCORDANCE WITH THE ARCHITECTS SETTING OUT DRAWINGS.
5. THE SERVICES WORKS ARE TO BE CO-ORDINATED AND SEQUENCED TO MEET THE AGREED CONSTRUCTION PROGRAMME WHILST MAINTAINING SERVICES LIVE TO SURROUNDING AREAS.
6. INFORMATION DETAILED ON THIS DRAWING HAS BEEN TAKEN FROM VISUAL SURVEYS AND INFORMATION PROVIDED BY OTHERS. NO RESPONSIBILITY SHALL BE ACCEPTED ON THE ACCURACY OF INFORMATION PROVIDED BY OTHERS.

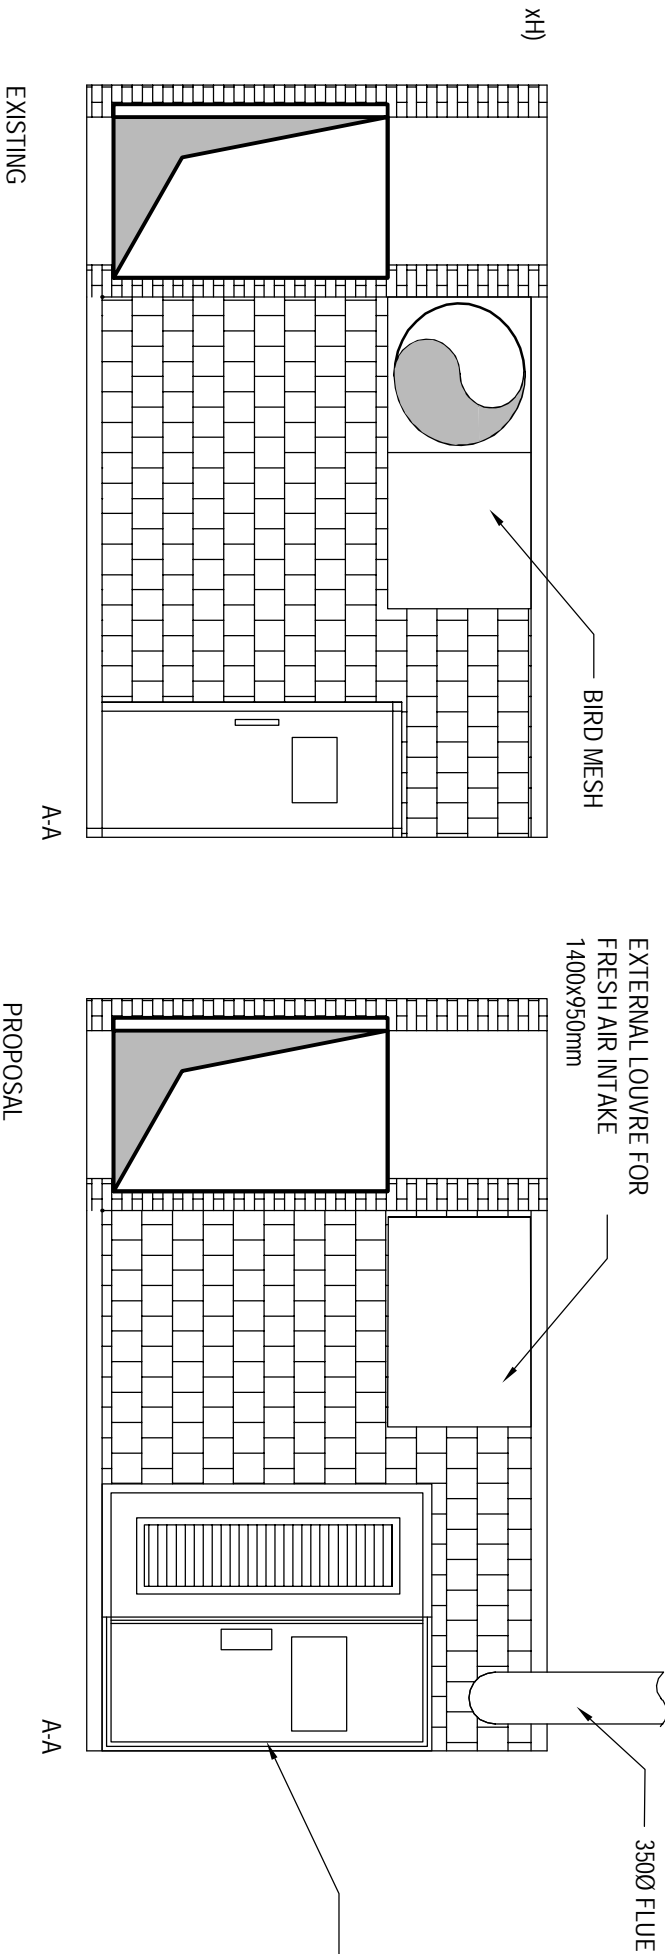

TOTAL AIR FLOW REQUIRED FOR COOLING: 46,800 m³/h

| | | | | | | |
|----------|-----|--------------|---------|---------|------|------------|
| T1 | | TENDER ISSUE | | MBE | | 12.05.2017 |
| Revision | Dcc | Description | Drwn By | Checked | Date | |

| | | | | | |
|------------|--|------------|--|---------|-------|
| SERVICES | | Project | IMO- GENERATOR REPLACEMENT | | |
| MANAGEMENT | | Title | GENERATOR VENTILATION, COOLING AND FLUE SERVICES | | |
| SOLUTIONS | | Drawn By | Date | Checked | Scale |
| | | MBE | MAY '17 | - | NTS |
| | | Project No | Drawing No. | | |
| | | 17970 | 17970-SK-003 | | |