


Electrical Key

- Low Spec strip light
- Flush fitting downlighters.
- Energy saving pendant light fitting
- Surface mounted downlight
- Outdoor lighting
- Double switch socket
- Double socket (unswitched)
- Double socket @ 900 above FFL
- Double Floor socket recessed in floor
- Double socket @ ceiling level
- 32 amp external fused spur outlet
- 30 amp fused spur outlet
- 16 amp fused spur outlet
- 3 amp fused spur outlet
- 13A FCU serving unswitched socket
- External waterproof socket
- Shaver socket
- Light switch
- Dimmer light switch
- Double data supply
- Double data @ 900mm from FFL (apx)
- Double Data in floor
- Double data @ ceiling level
- Single telephone
- Single data
- Double telephone/data point
- Projector ceiling power supply
- Vertical spur from floor service duct
- Consumer unit
- WiFi booster
- WiFi booster (data connection)
- Movement sensor
- Air source heat pump
- Room Thermostat (each requires 230V si)
- Boost switch for MVHR
- Door bell and intercom
- Push Pad Door Opener
- Bathroom pull cord
- Room thermostat



Existing Electrical Plan, Ground Floor

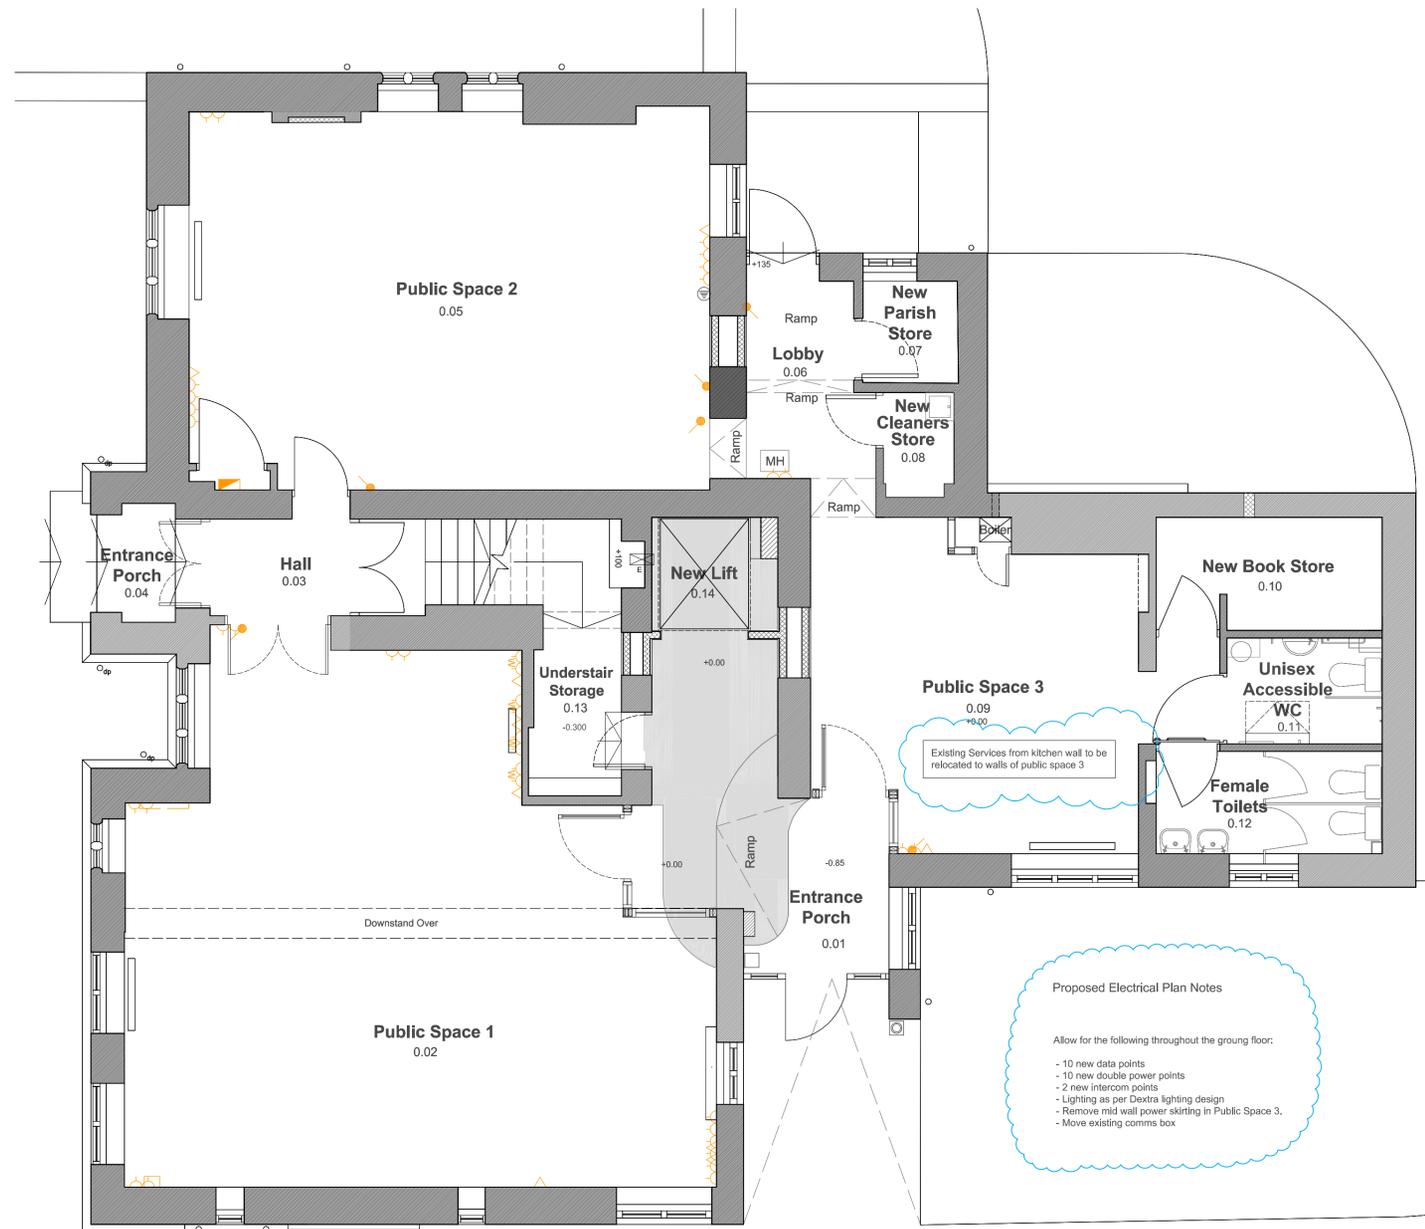

Proposed Electrical Plan, Ground Floor



The title, copyright and confidential information in this document belongs to Orme Limited, all rights reserved. This drawing is to be read in conjunction with other documents issued by the Architect. Only figured dimensions to be used. Contractors not to scale from this drawing and must check all dimensions before proceeding. Any discrepancies reported to the Architect immediately.