


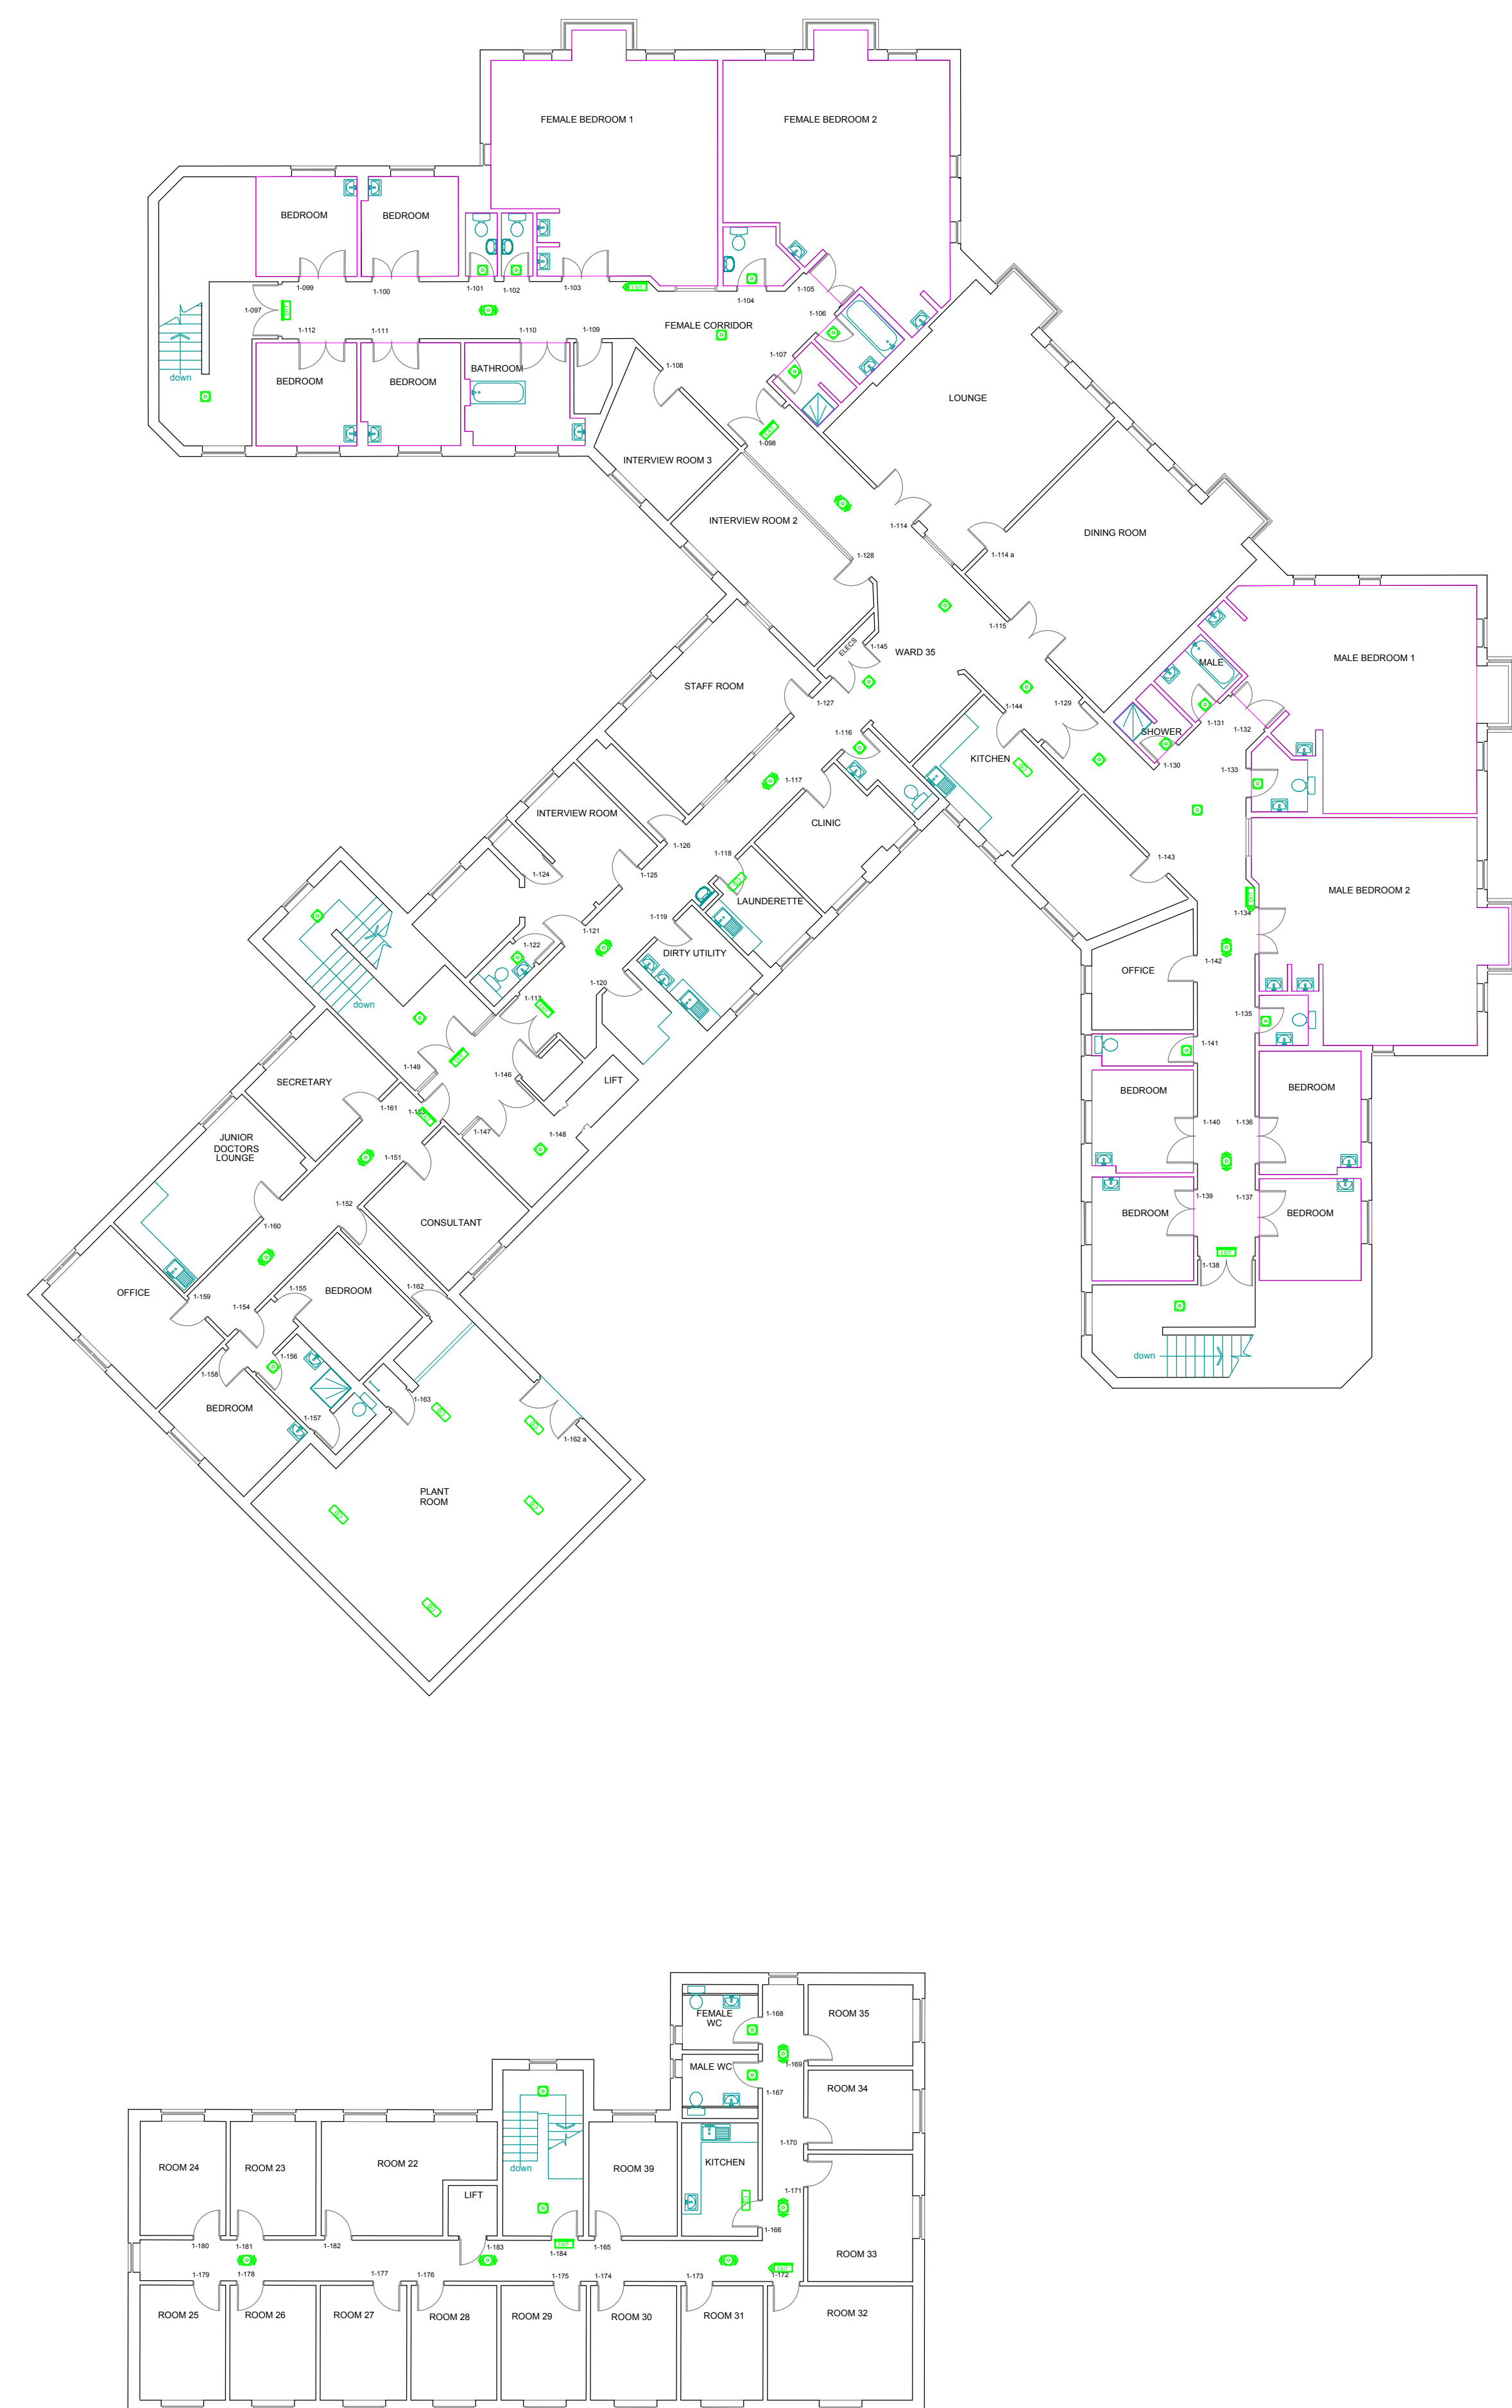

General Symbols	
	3-hour non-maintained self-contained LED Emergency luminaire with open area (aplic) - recessed or surface to be determined
	3-hour non-maintained self-contained LED Emergency luminaire with control (aplic) - recessed or surface to be determined
	3-hour maintained self-contained LED Emergency Exit luminaire - wall or ceiling mounted to be determined
	3-hour maintained self-contained LED Emergency Exit luminaire dual or single sided - wall or ceiling mounted to be determined
	3-hour maintained self-contained IPES LED Emergency luminaire wall or ceiling mounted to be determined

All luminaires to be supplied as Advanced Electronic for use with their Lux Intelligent system

Explain Anti-Signature Area

Revisions

--	--	--	--



Electrical, Mechanical, Heating Consulting Engineers
Alpine House, Alpine Street, Old Basford, Nottingham NG6 0HS
Tel. 0115 924 4433 Fax. 0115 924 4438
E-mail: enquiries@epiconsulting.co.uk

Client

Derbyshire Healthcare 
NHS Foundation Trust

Job Title	
-----------	--

The Radbourn Unit
Royal Derby Hospital
Derby

Drawing Title

First Floor Proposed Emergency Lighting

Scale	1 : 150	A0	Drawn by	ST
-------	---------	----	----------	----

Date	November 2018	Checked
------	---------------	---------

Status	TENDER
--------	--------

Org. No. 1890/E/02

Rev