


- NOTES
- REFER TO PAVEMENT DEFECTS AND CORE LOCATION PLAN M5 J9 NB MP76-8-69.5 SHEET 2 OF 6 FOR NORTHBOUND CORES OVER 132KV HV UNDERGROUND CABLES.
 - LOCATION OF HV UNDERGROUND CABLES TO BE IDENTIFIED PRIOR TO TAKING CORES. MIDDLE LINE OF CORES WILL BE TAKEN ABOVE THE HV CABLE ON THE RAISED PART OF THE HUMPS.

KEY



Southbound Cores

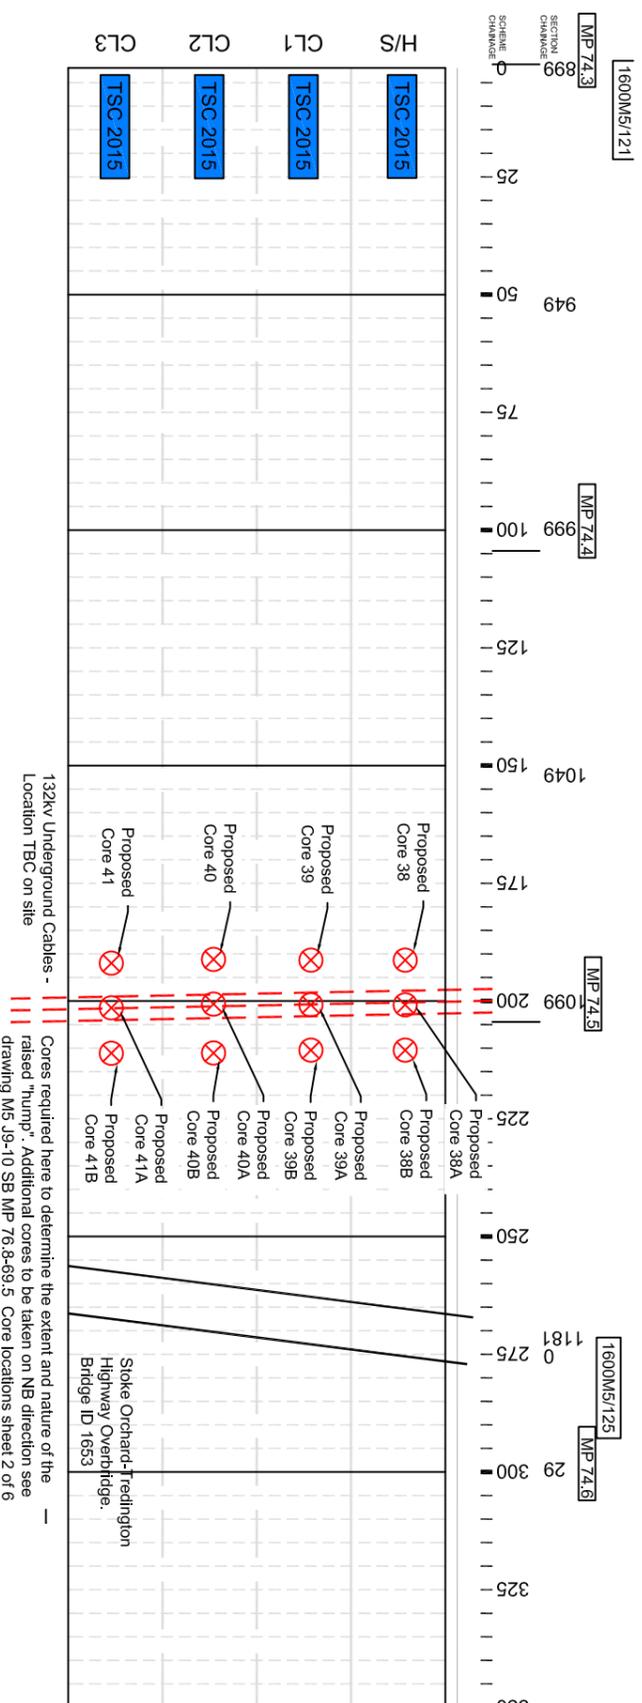

PROJECT
M5 J9-10 SB MP
74.4-74.6 - RS

STATUS
Pavement Core
Location Plan

DRAWING NUMBER
006
Sheet 6 of 6

Rev	By	Date	Notes
A	JCM	10/02/2020	Final Issue - VM