

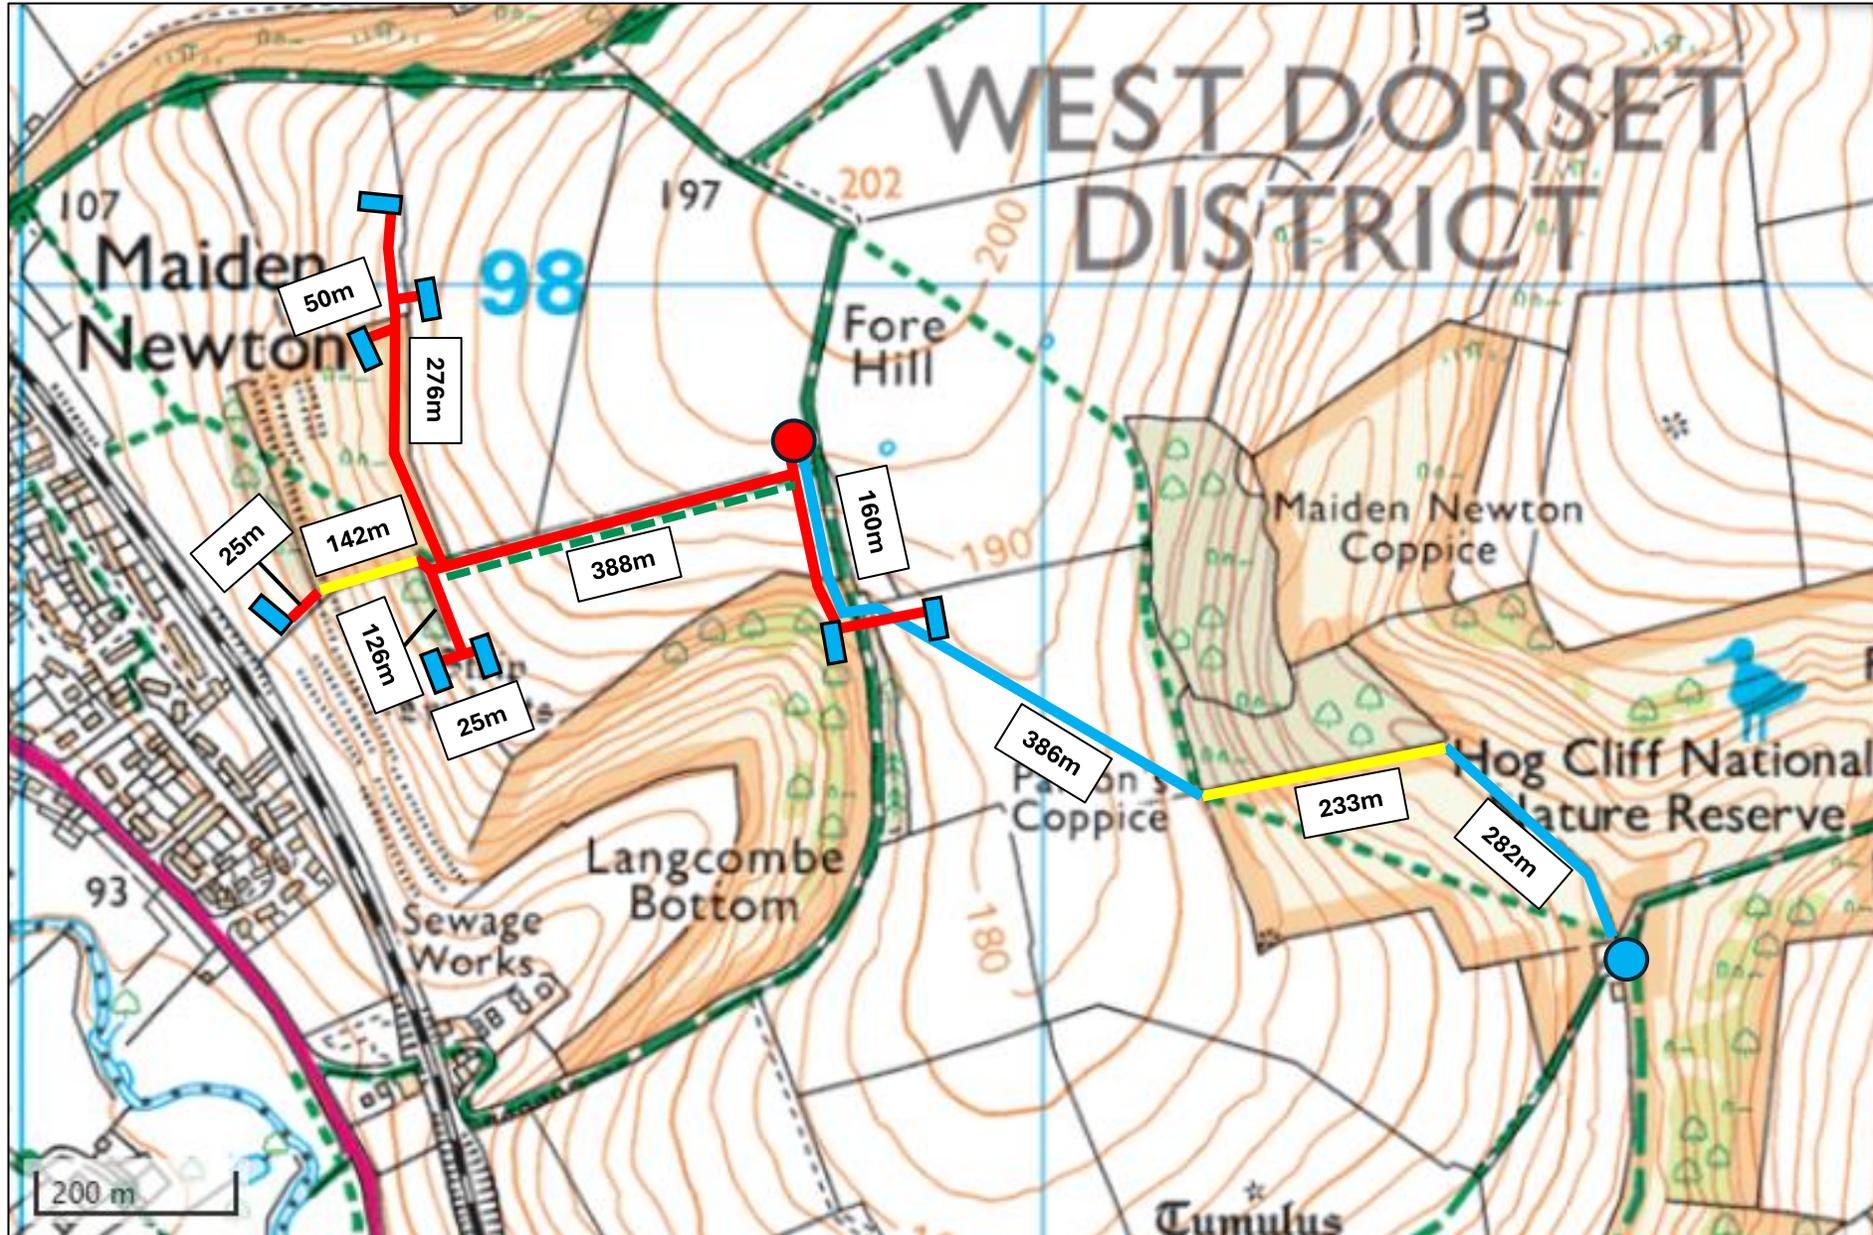


Hog Cliff NNR Glebe Farm water supply pipe trenching and troughs specification

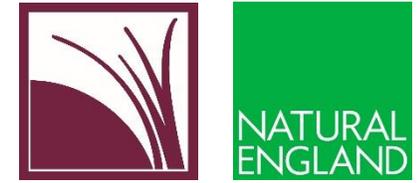


-  8 x water trough.
Concrete or galvanised steel
100 gallons.
-  1 x header tank.
10,000 litres.
-  Existing borehole
-  Above ground pipe.
Approx. total 375m.
-  Buried/trenched pipe
supply to header tank.
Approx. total 668m.
-  Buried/trenched pipe
supply from header
tank to troughs.
Approx. total 900m.

Hog Cliff NNR Glebe Farm water supply – location of works

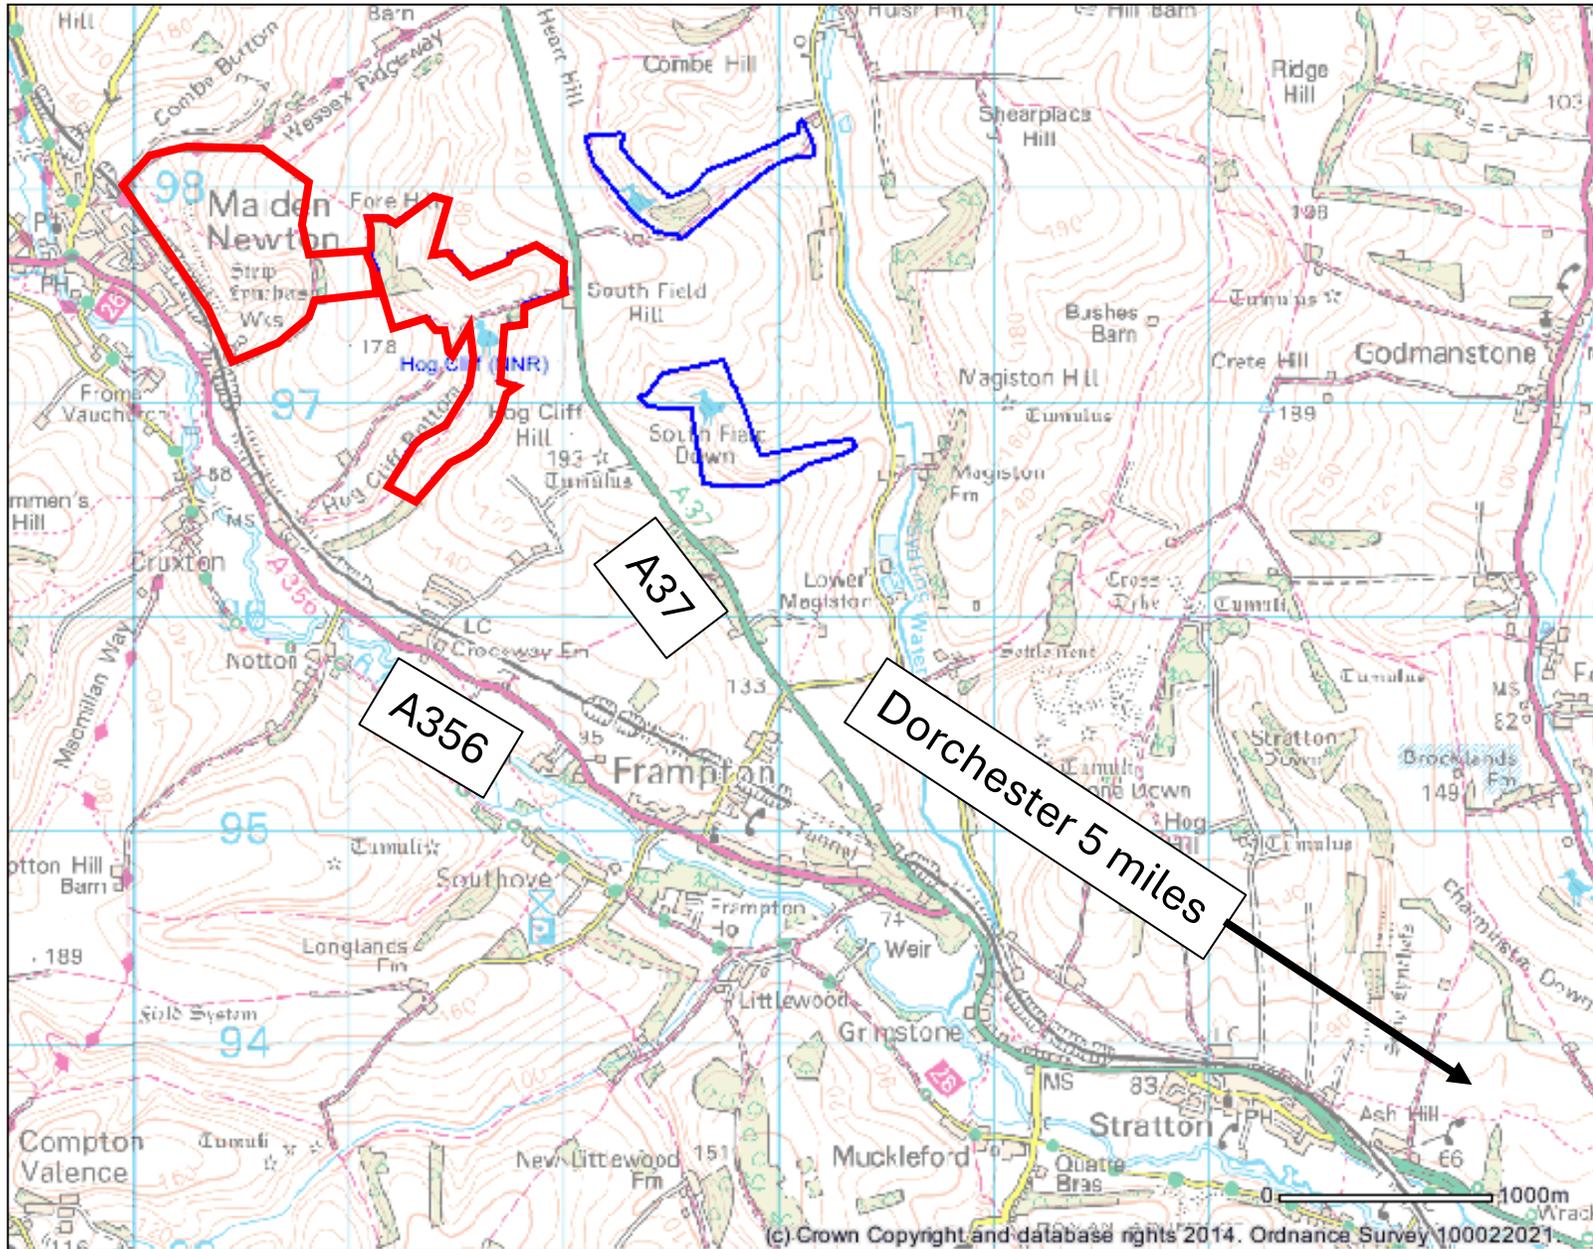

-  Glebe Farm & Hog Cliff Bottom (location of works)
-  Hog Cliff NNR

Hog Cliff NNR Glebe Farm water supply works – access to worksite

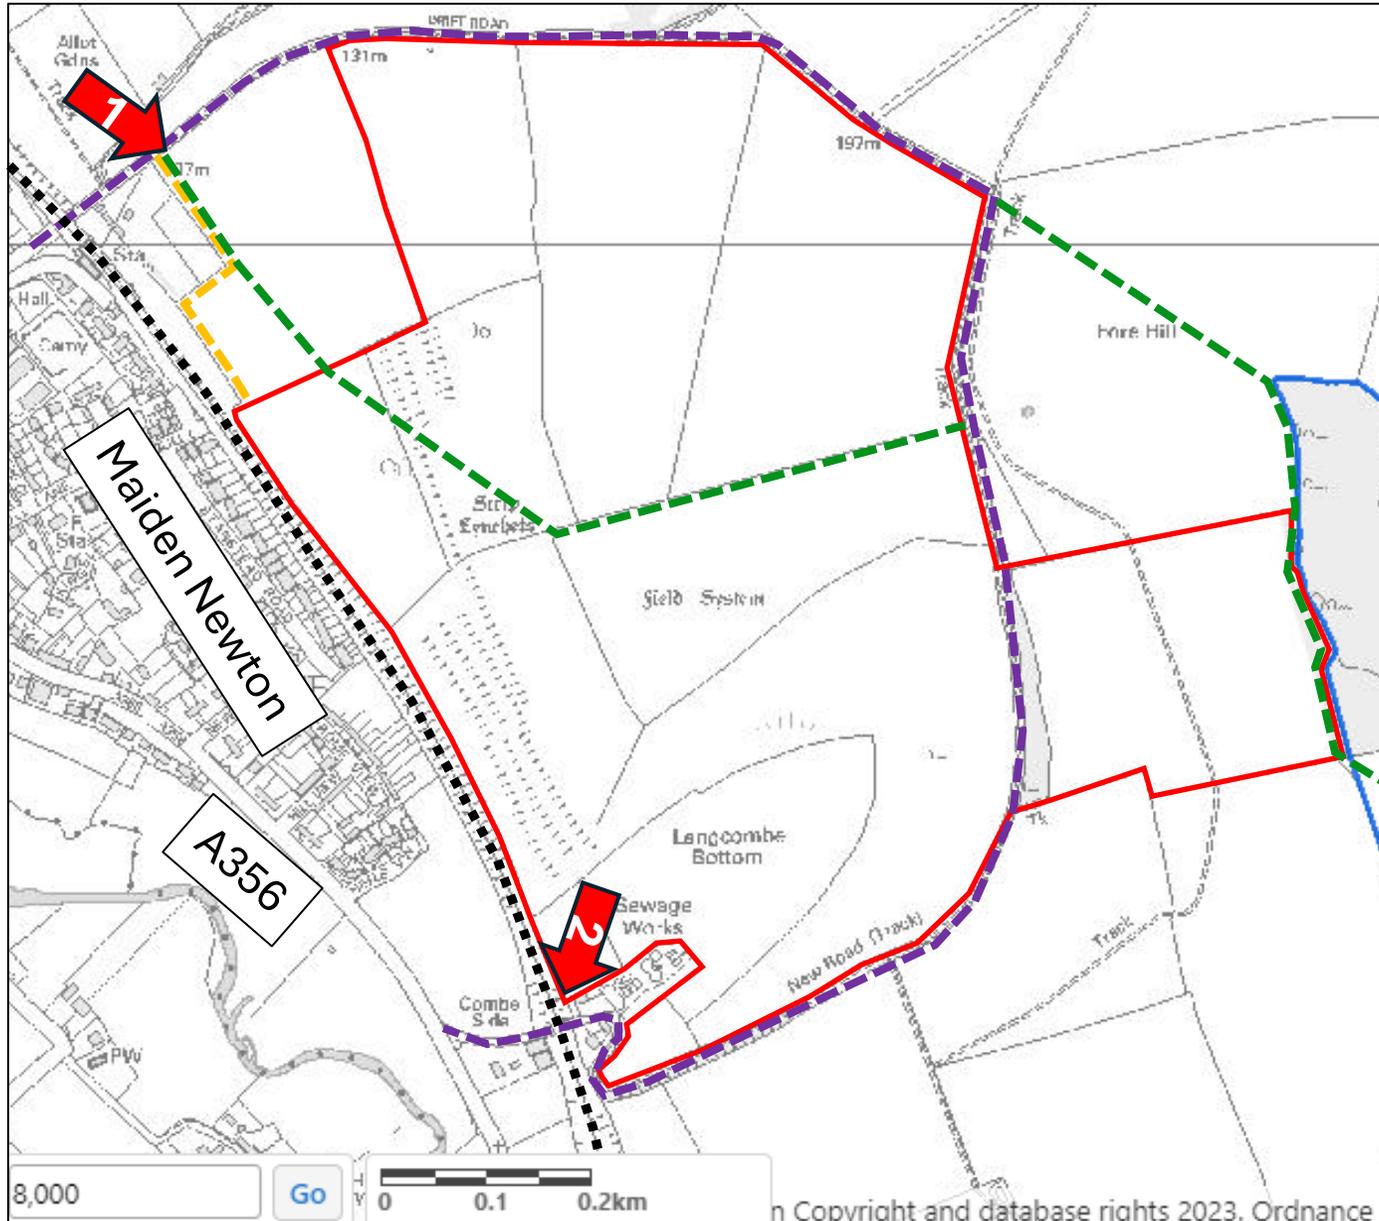

- 1** **Allotment access**
What3Words
firmer.receive.listen
- 2** **Sewage works access**
What3Words
squirts.reflect.goodbyes
- Glebe Farm
- Hog Cliff NNR
- Footpath
- Bridleway
- NE right of access
- Trainline

Hog Cliff NNR Glebe Farm water supply works – access to worksite

