

BUILDING OUTLINE INFORMATION


ARCHITECT'S DRAWING No.	DATE
-------------------------	------

NOTES

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ELECTRICAL SPECIFICATION AND ALL ASSOCIATED ARCHITECTS AND ENGINEERS DRAWINGS.
2. ALL WORKS TO BE CARRIED OUT IN STRICT ACCORDANCE WITH ALL RELEVANT SAFETY REGULATIONS.
3. THIS DRAWING IS FOR TENDER PURPOSES ONLY. FULLY DETAILED INSTALLATION, CO-ORDINATION AND BUILDERS WORK DRAWINGS SHALL BE PROVIDED BY THE ELECTRICAL SUB-CONTRACTOR IN ACCORDANCE WITH THE SPECIFICATION.
4. FINAL POSITION AND QUANTITY OF POWER AND ANCILLARY POWER IS SUBJECT TO COMMENT AND APPROVAL BY CLIENT. EXACT LOCATIONS OF ALL ITEMS OF EQUIPMENT TO BE VERIFIED ON SITE ON SITE WITH THE ARCHITECT AND SPECIALIST INSTALLER.
5. ALL DATA CABLING AND CONTAINMENT SHALL BE CAT 6 COMPLIANT AND IS TO BE FULLY CERTIFIED ON COMPLETION.
5. THE CONTAINMENT SYSTEM SHALL BE CABLE BASKETS AND GALVANISED CONDUIT.
6. ALL ACCESSORIES TO MEET CRITERIA LAID OUT IN THE BUILDING REGULATIONS PART M. ALL SOCKETS AND SWITCHES TO HAVE CONTRASTING COLOURS. I.E. GREY ROCKERS WITH WHITE FACE PLATES.
7. DADO TRUNKING SHALL BE INSTALLED AT 800mm FROM THE UNDERSIDE OF THE TRUNKING TO FFL.
8. ELECTRICAL CONTRACTOR SHALL ALLOW FOR WIRING IN ALL MECHANICAL CONTROLLERS AS SUPPLIED BY THE MECHANICAL CONTRACTOR
9. ELECTRICAL CONTRACTOR SHALL ALLOW FOR WIRING IN MECHANICAL PLANT AND CONTROLLERS. CONTROLLERS ARE TO BE FREE ISSUED BY THE MECHANICAL CONTRACTOR FOR THE ELECTRICAL CONTRACTOR TO CARRY OUT THE FINAL CONNECTIONS.
10. ALL FIRE ALARM WORKS AND COMMISSIONING IS TO BE CARRIED OUT BY ISE FIRE, 16 ORLINGBURY ROAD, WELLINGBOROUGH NN9 5BH - 01933 677125

LEGEND

-  13A 2 GANG SWITCHED SOCKET OUTLET
-  13A 1 GANG SWITCHED SOCKET OUTLET
-  13A FUSED CONNECTION UNIT * DENOTES APPLIANCE
- AC – AIR CONDITIONING UNIT
WI – WIRELESS HUB
-  TWIN TELEPHONE POINT
-  CAT 6 TWIN DATA POINT
-  MK 3 COMPARTMENT DADO TRUNKING
-  MK 3 COMPARTMENT DADO TRUNKING RISER
-  EXISTING DISTRIBUTION BOARD – ALL NEW CIRCUITS ARE TO BE CABLED BACK TO THIS POINT.
-  FIRE ALARM ADDRESSABLE BREAK GLASS UNIT
-  FIRE ALARM ADDRESSABLE OPTICAL SMOKE DETECTOR
-  FIRE ALARM ADDRESSABLE CEILING VOID DETECTOR c/w ROOM INDICATOR
-  FIRE ALARM ELECTRONIC SOUNDER
-  DATA HUB CAT 6 COMPLIANT – ALL DATA POINTS ARE TO BE CABLED BACK TO THIS POSITION
-  32A SINGLE PHASE ROTARY ISOLATOR FOR EXTERNAL A/C CONDENSER.
-  CEILING MOUNTED WIFI UNIT.
-  RELOCATED CEILING MOUNTED CCTV CAMERA

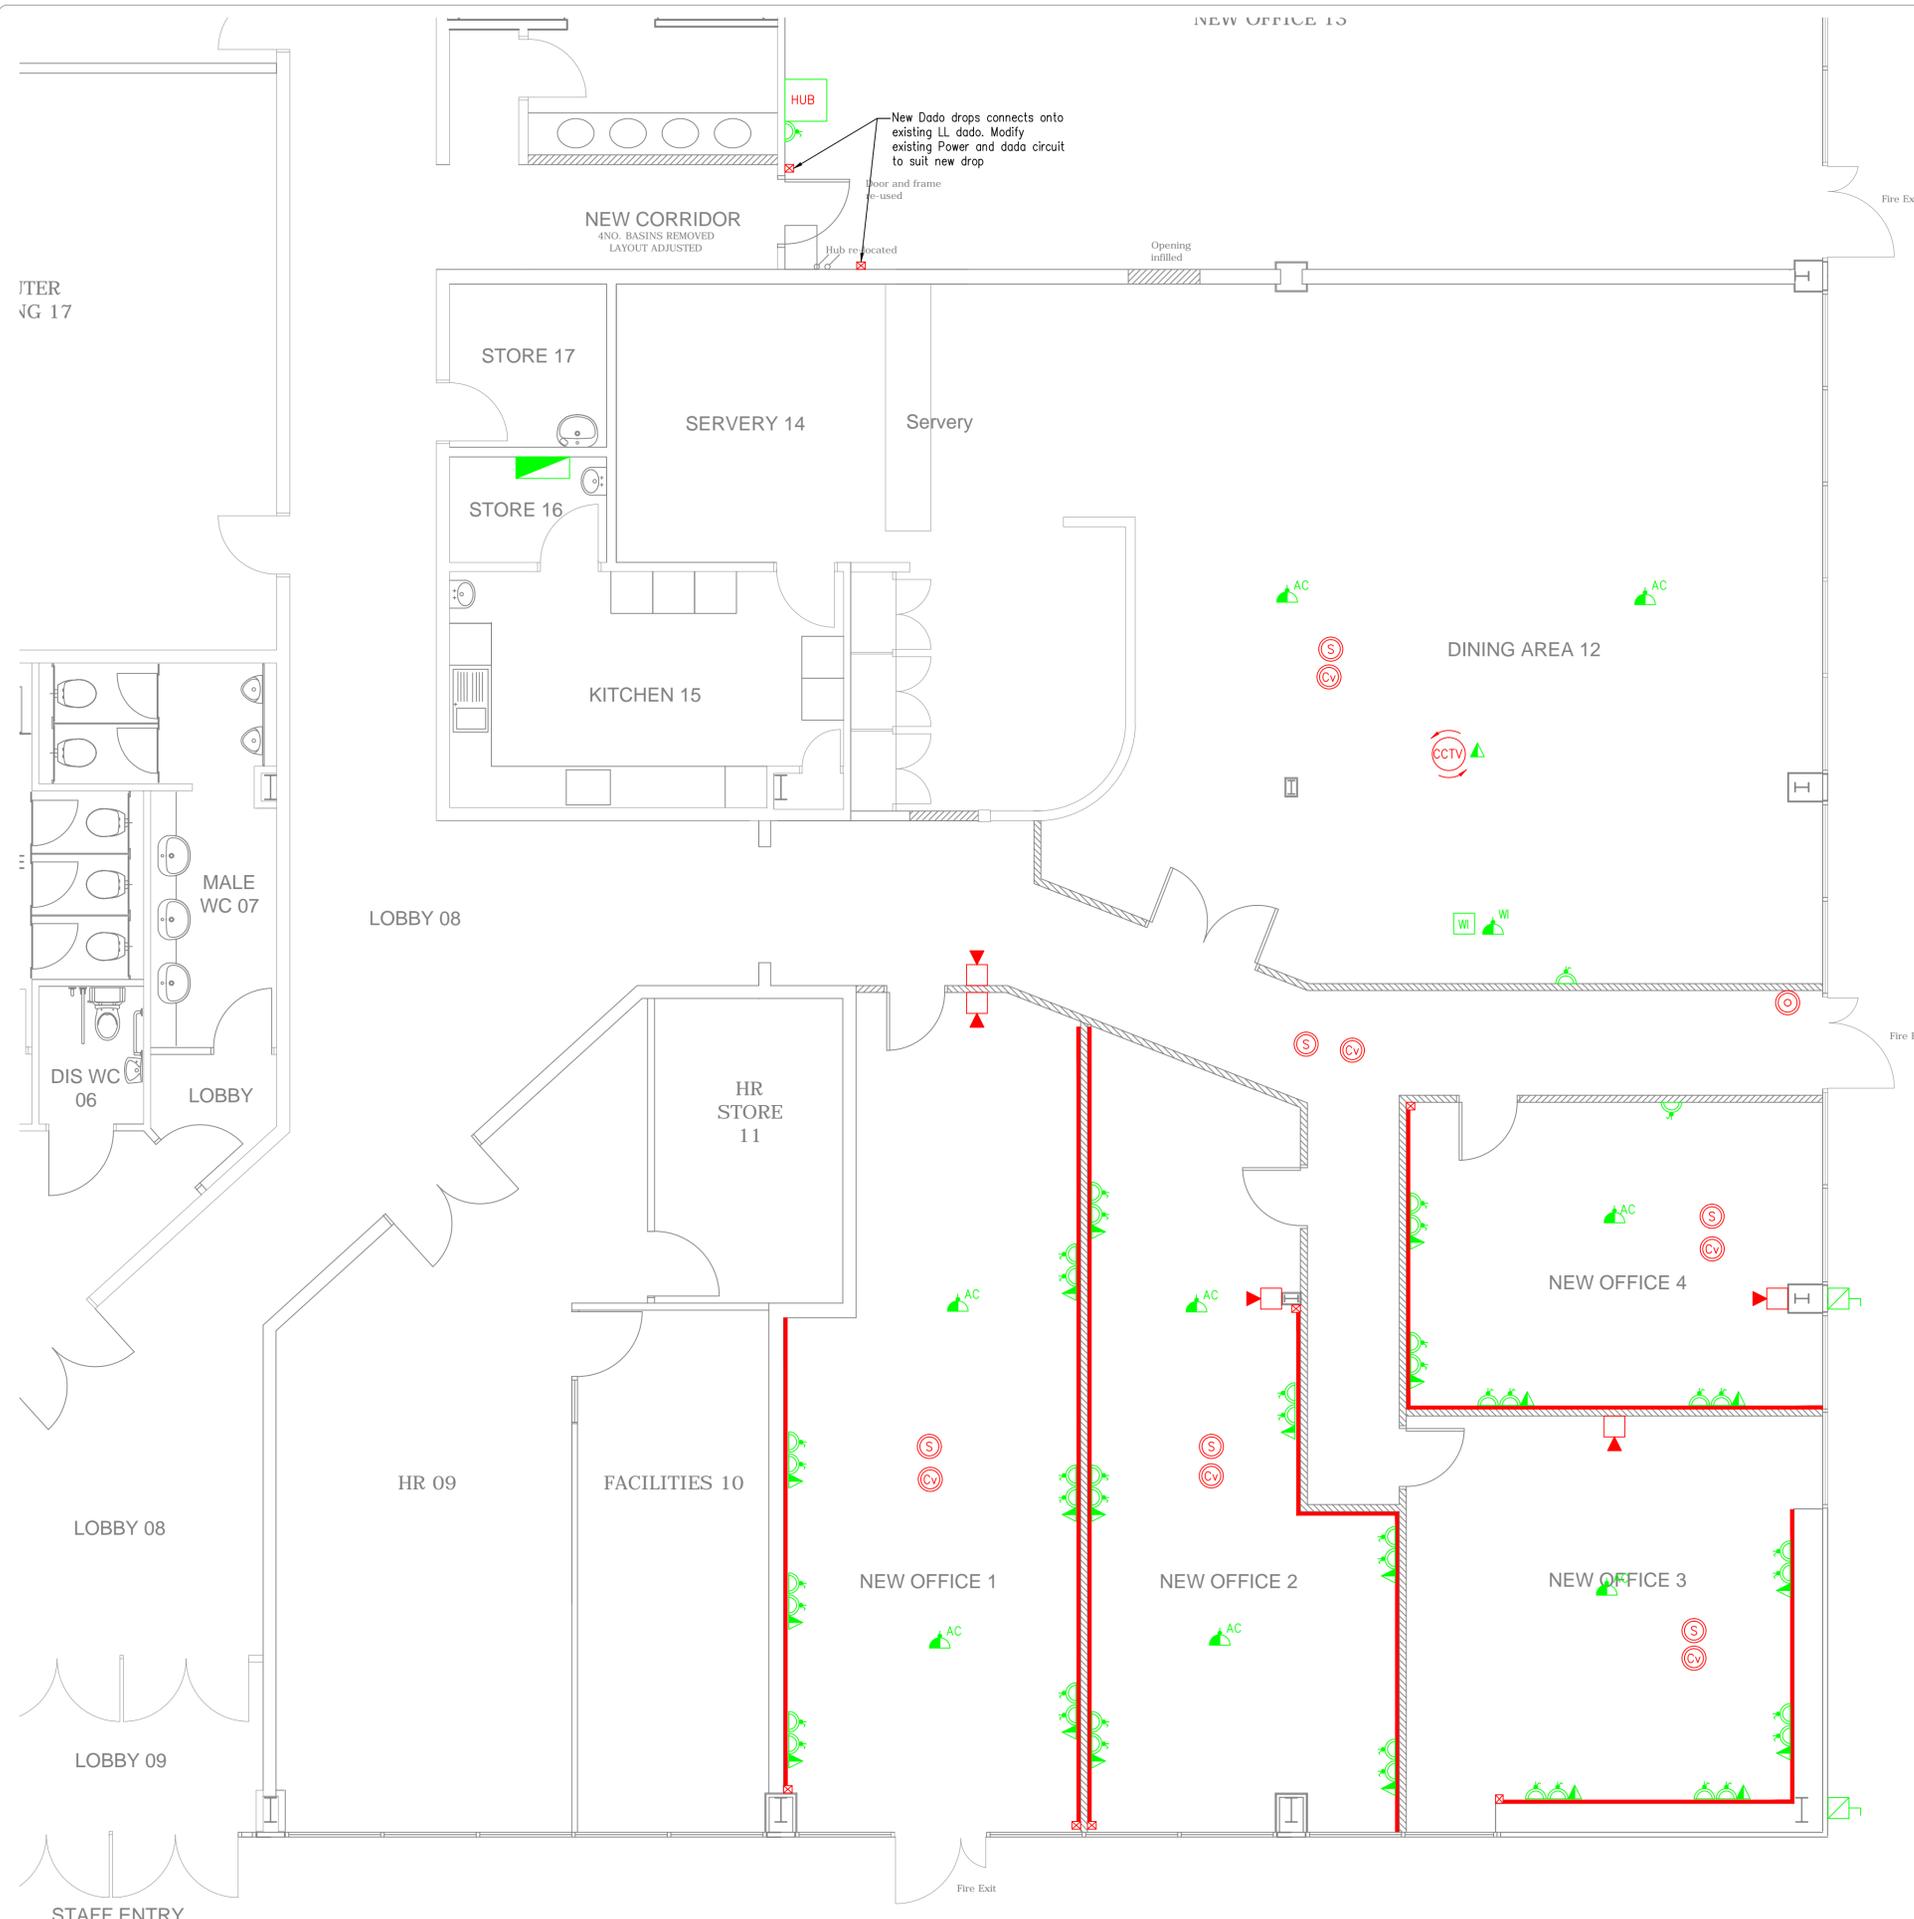

REV	DATE	DESCRIPTION	BY	VE



River View, Great Addington Road, Little Addington, Kettering, Northamptonshire, NN14 4BA
 Tel. (01933) 652764 | Mobile. 07788 546550
 Email. enquiries@parsons-consulting.co.uk

ISSUE STATUS: **TENDER ISSUE**

CLIENT: CORBY ENTERPRISE CENTRE, BANGRAVE ROAD, CORBY

PROJECT: NEW OFFICES

DRAWING TITLE: **SMALL POWER AND FIRE ALARM LAYOUT**

SCALE: 1:50 @ A1	DATE: JULY 2017	BY: VE
DRAWING NUMBER: E002	REV: T1	

This drawing is copyright and may not be reproduced either in part or full without written permission from Parsons Associates.
DO NOT SCALE OFF THIS DRAWING