



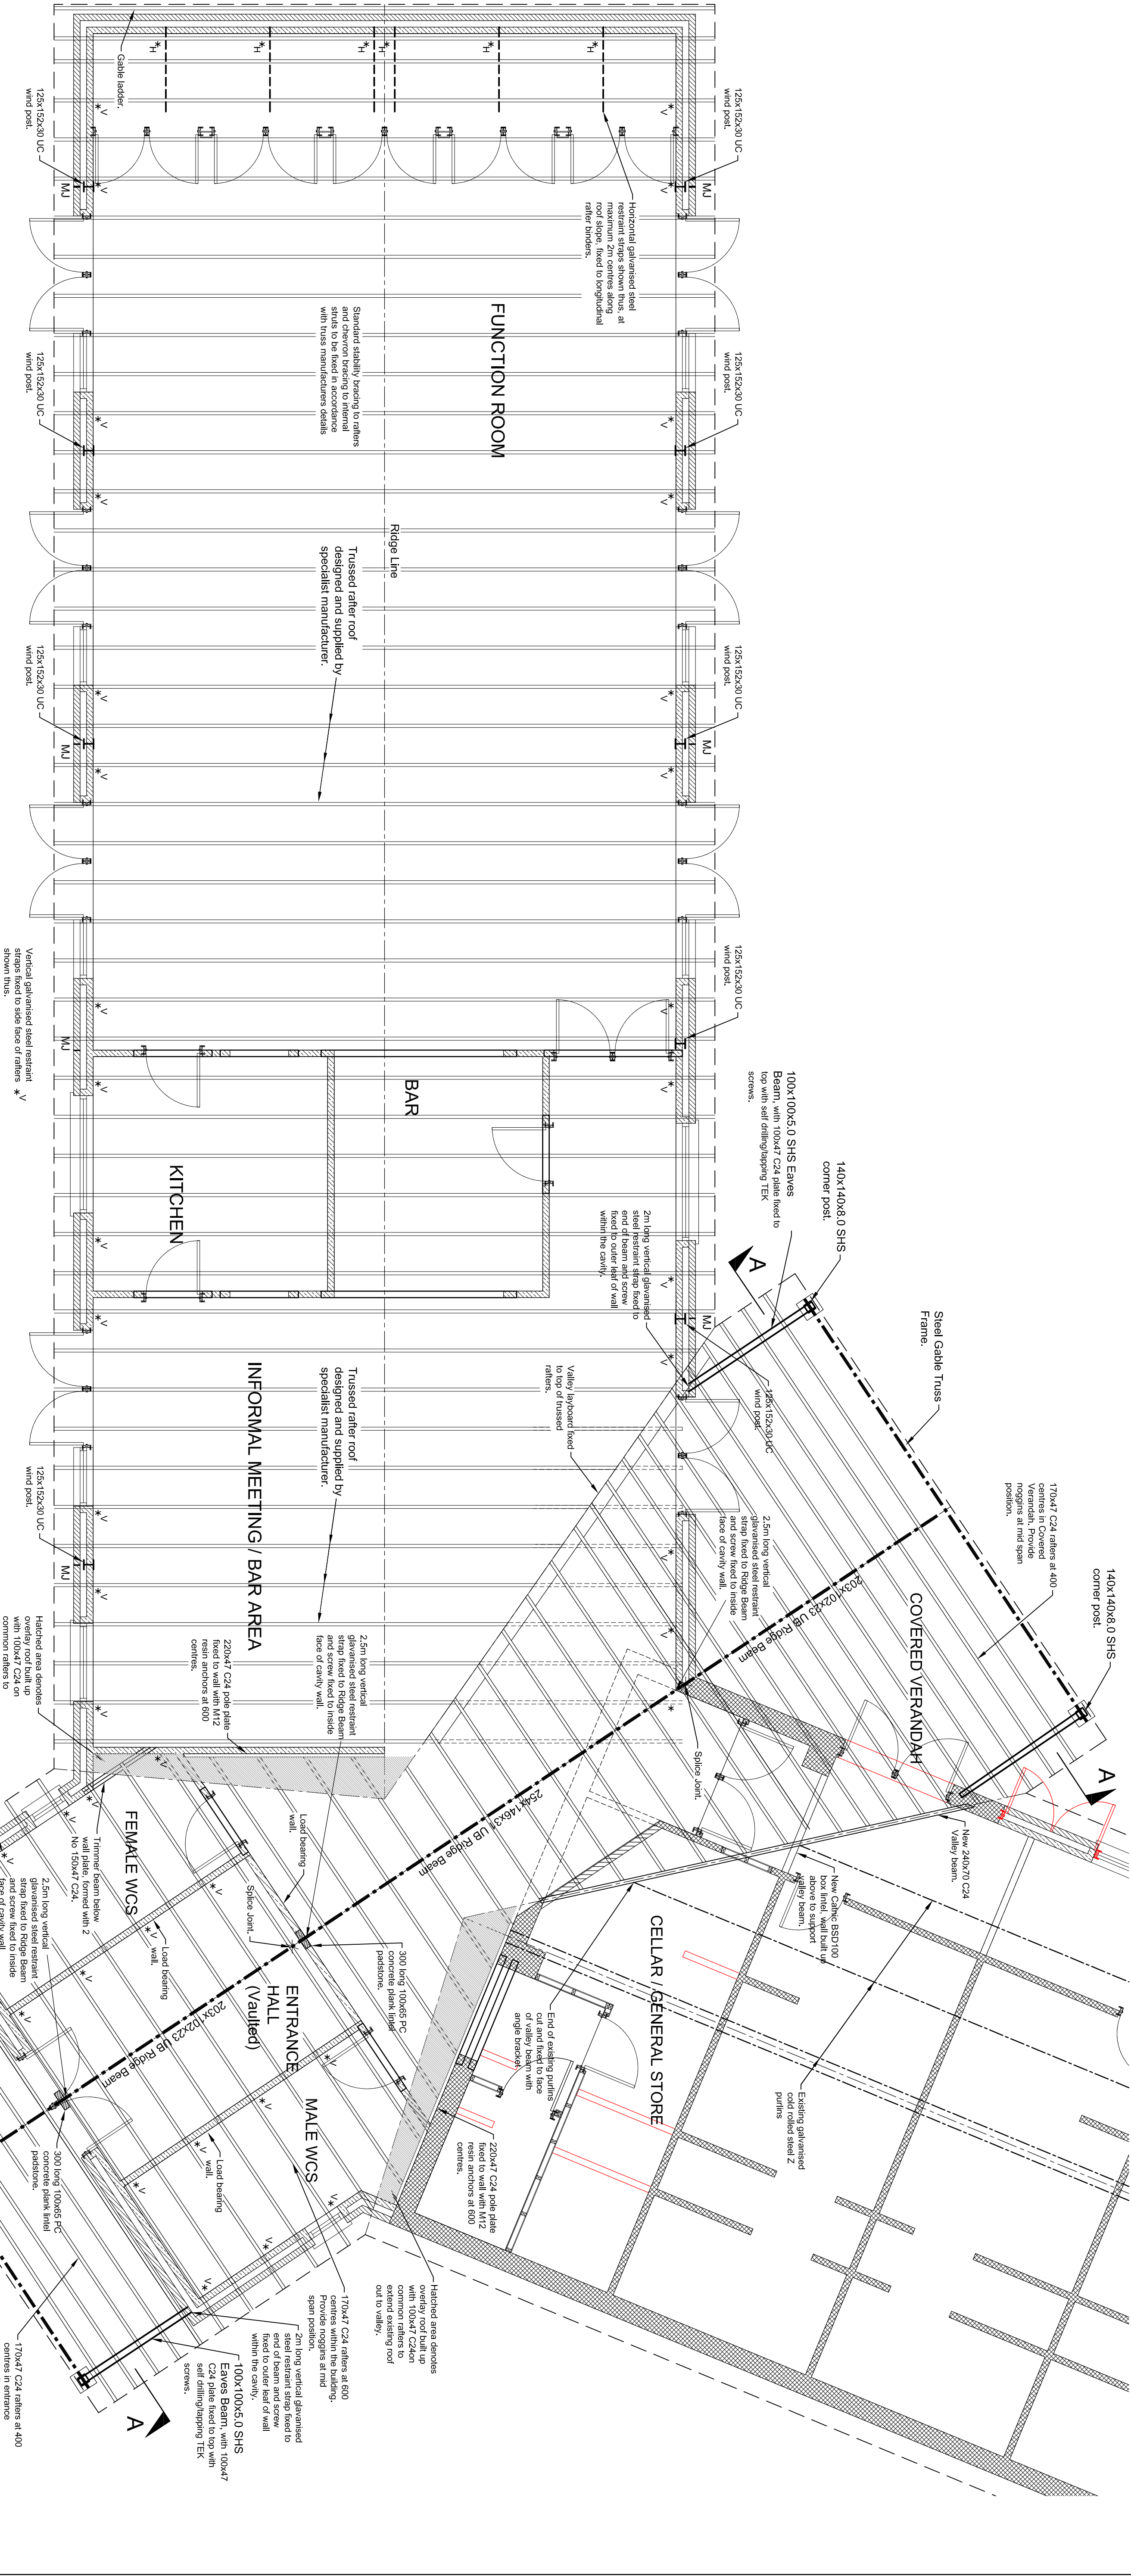

PROPOSED ROOF PLAN Scale 1:50

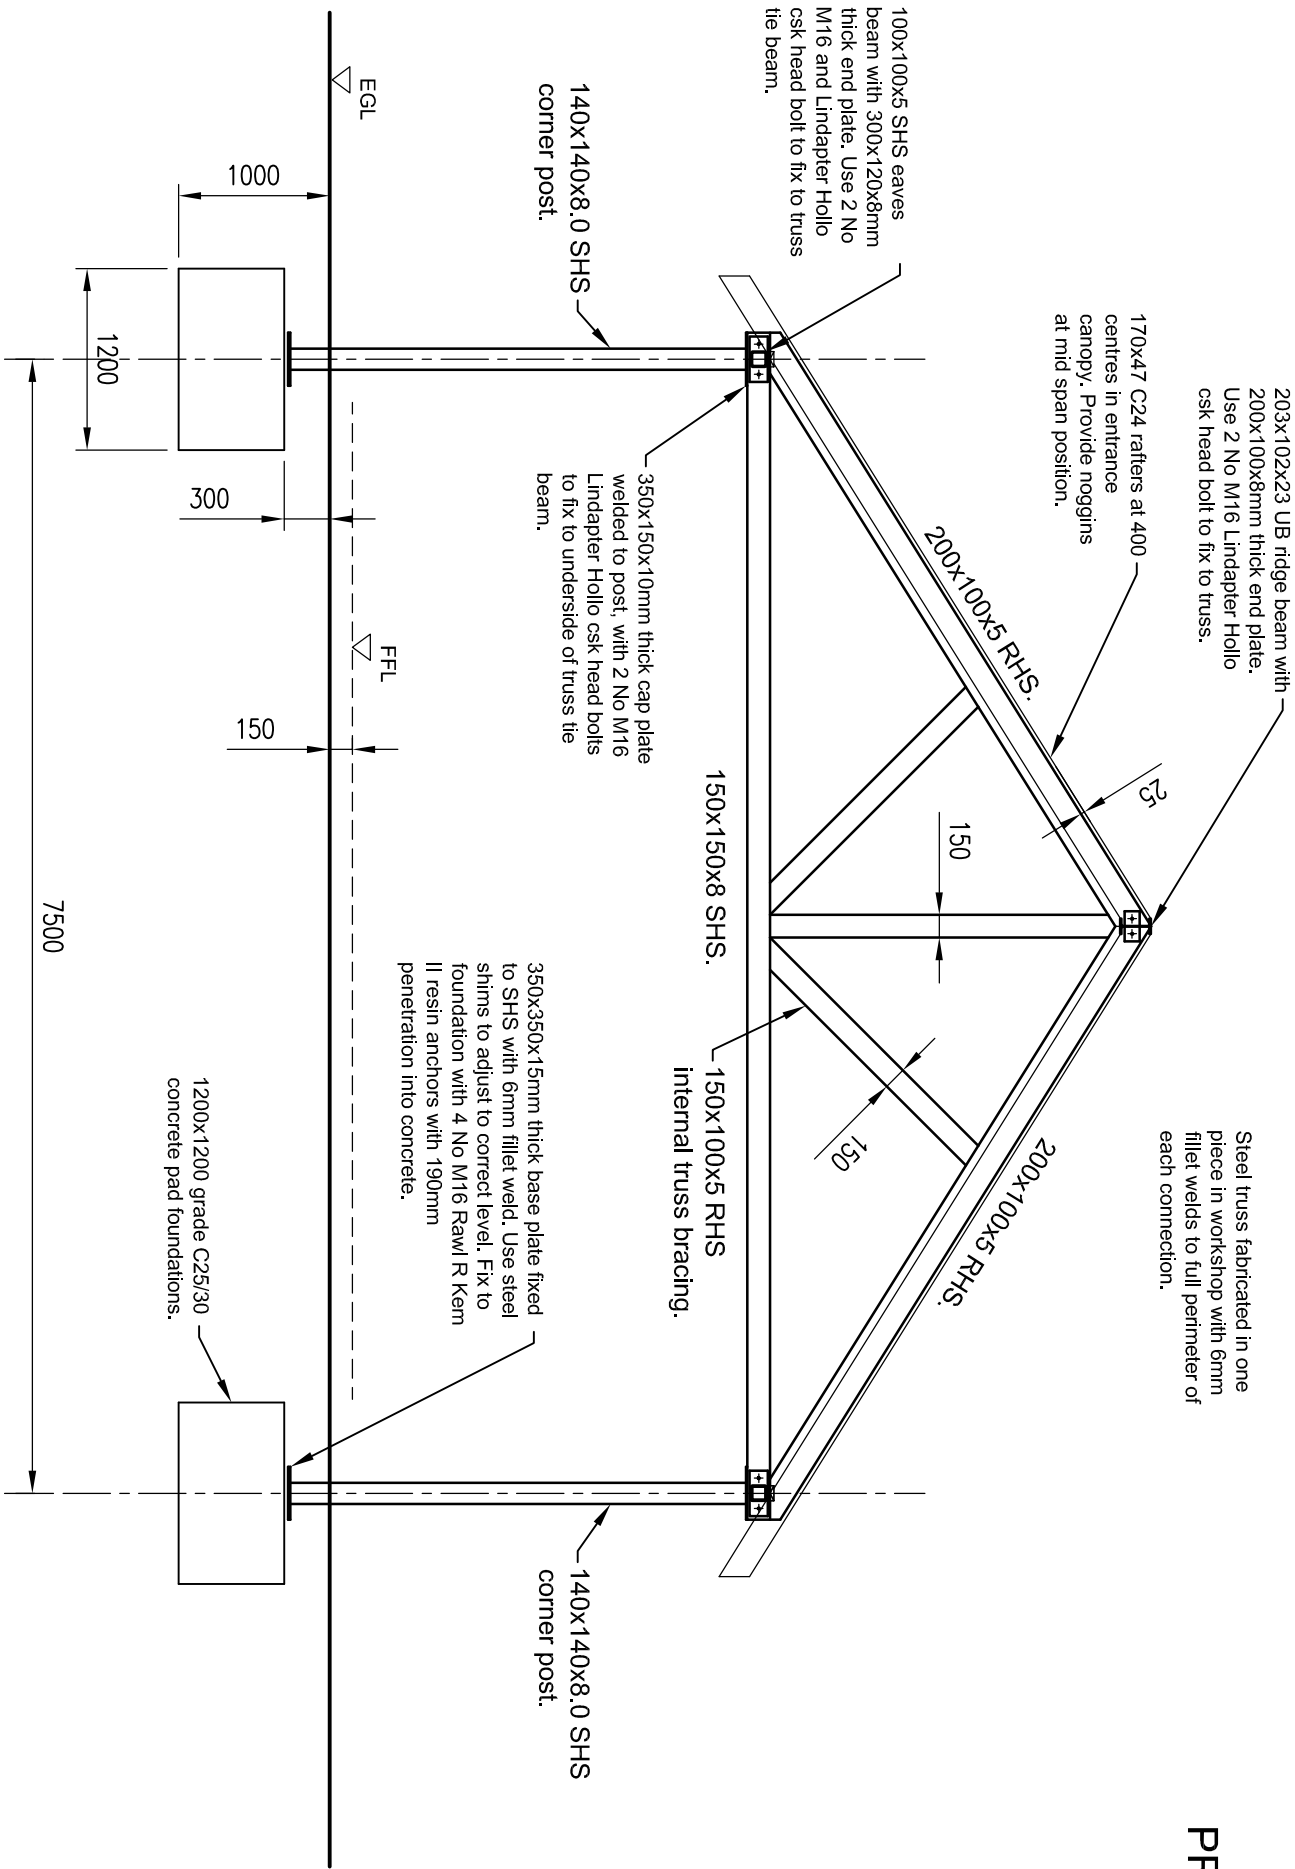

PORCH SECTION A-A
Scale 1:50

STEELWORK NOTES

1. All existing dimensions to be checked on site prior to fabrication of steelwork.
2. Do not scale from this drawing work to stated dimensions only.
3. Steelwork to be fabricated in accordance with BCSEA National Structural Steelwork Specification for Building Construction, 5th Edition.
4. CE Marking is mandatory for all fabricated steelwork. CE Marking to be in accordance with BS EN 1090-1 to meet European Class EXC2.
5. All steelwork to be to BS EN 10025 Grade S275 JR or J0 dependent upon thickness, unless noted otherwise.
6. All bolts to be Grade 8.8.
7. All steelwork to be shot blast cleaned to a minimum standard Sa 2.5. Internal steelwork is to be spray painted in the workshop with zinc phosphate epoxy primer with minimum coating thickness of 80 micron dft. External steel elements to be spray painted in the workshop with 40 microns of zinc rich epoxy primer, and 2 further 100 micron coats of high build epoxy W/O.
8. The finishing coat of 80 microns of high solid aliphatic polyurethane finish can be applied on site. Top coat paint colour to Architect's specification.
9. Steelwork in cavity walls to be painted with 2 coats of steelwork below DPC to be surrounded in concrete.

STRUCTURAL
ARRANGEMENTS
PLAN AT ROOF LEVEL

Sand Engineering Consultants
Beggs, Roost Wadmore
Somerset BS28 4XJ
Tel 01934 712427
david@sandengineering.co.uk
www.sandengineering.co.uk

STATUS	BY	DATE
AS SHOWN	AKB	Aug 19
CHECKED	DCB	Aug 19
APPROVED		

REF.	REVISIONS	DATE
-	ISSUE FOR COMMENT	22/08/19