


LEGEND

FD FIRE DAMPER - SUPPLY

FD FIRE DAMPER - EXTRACT

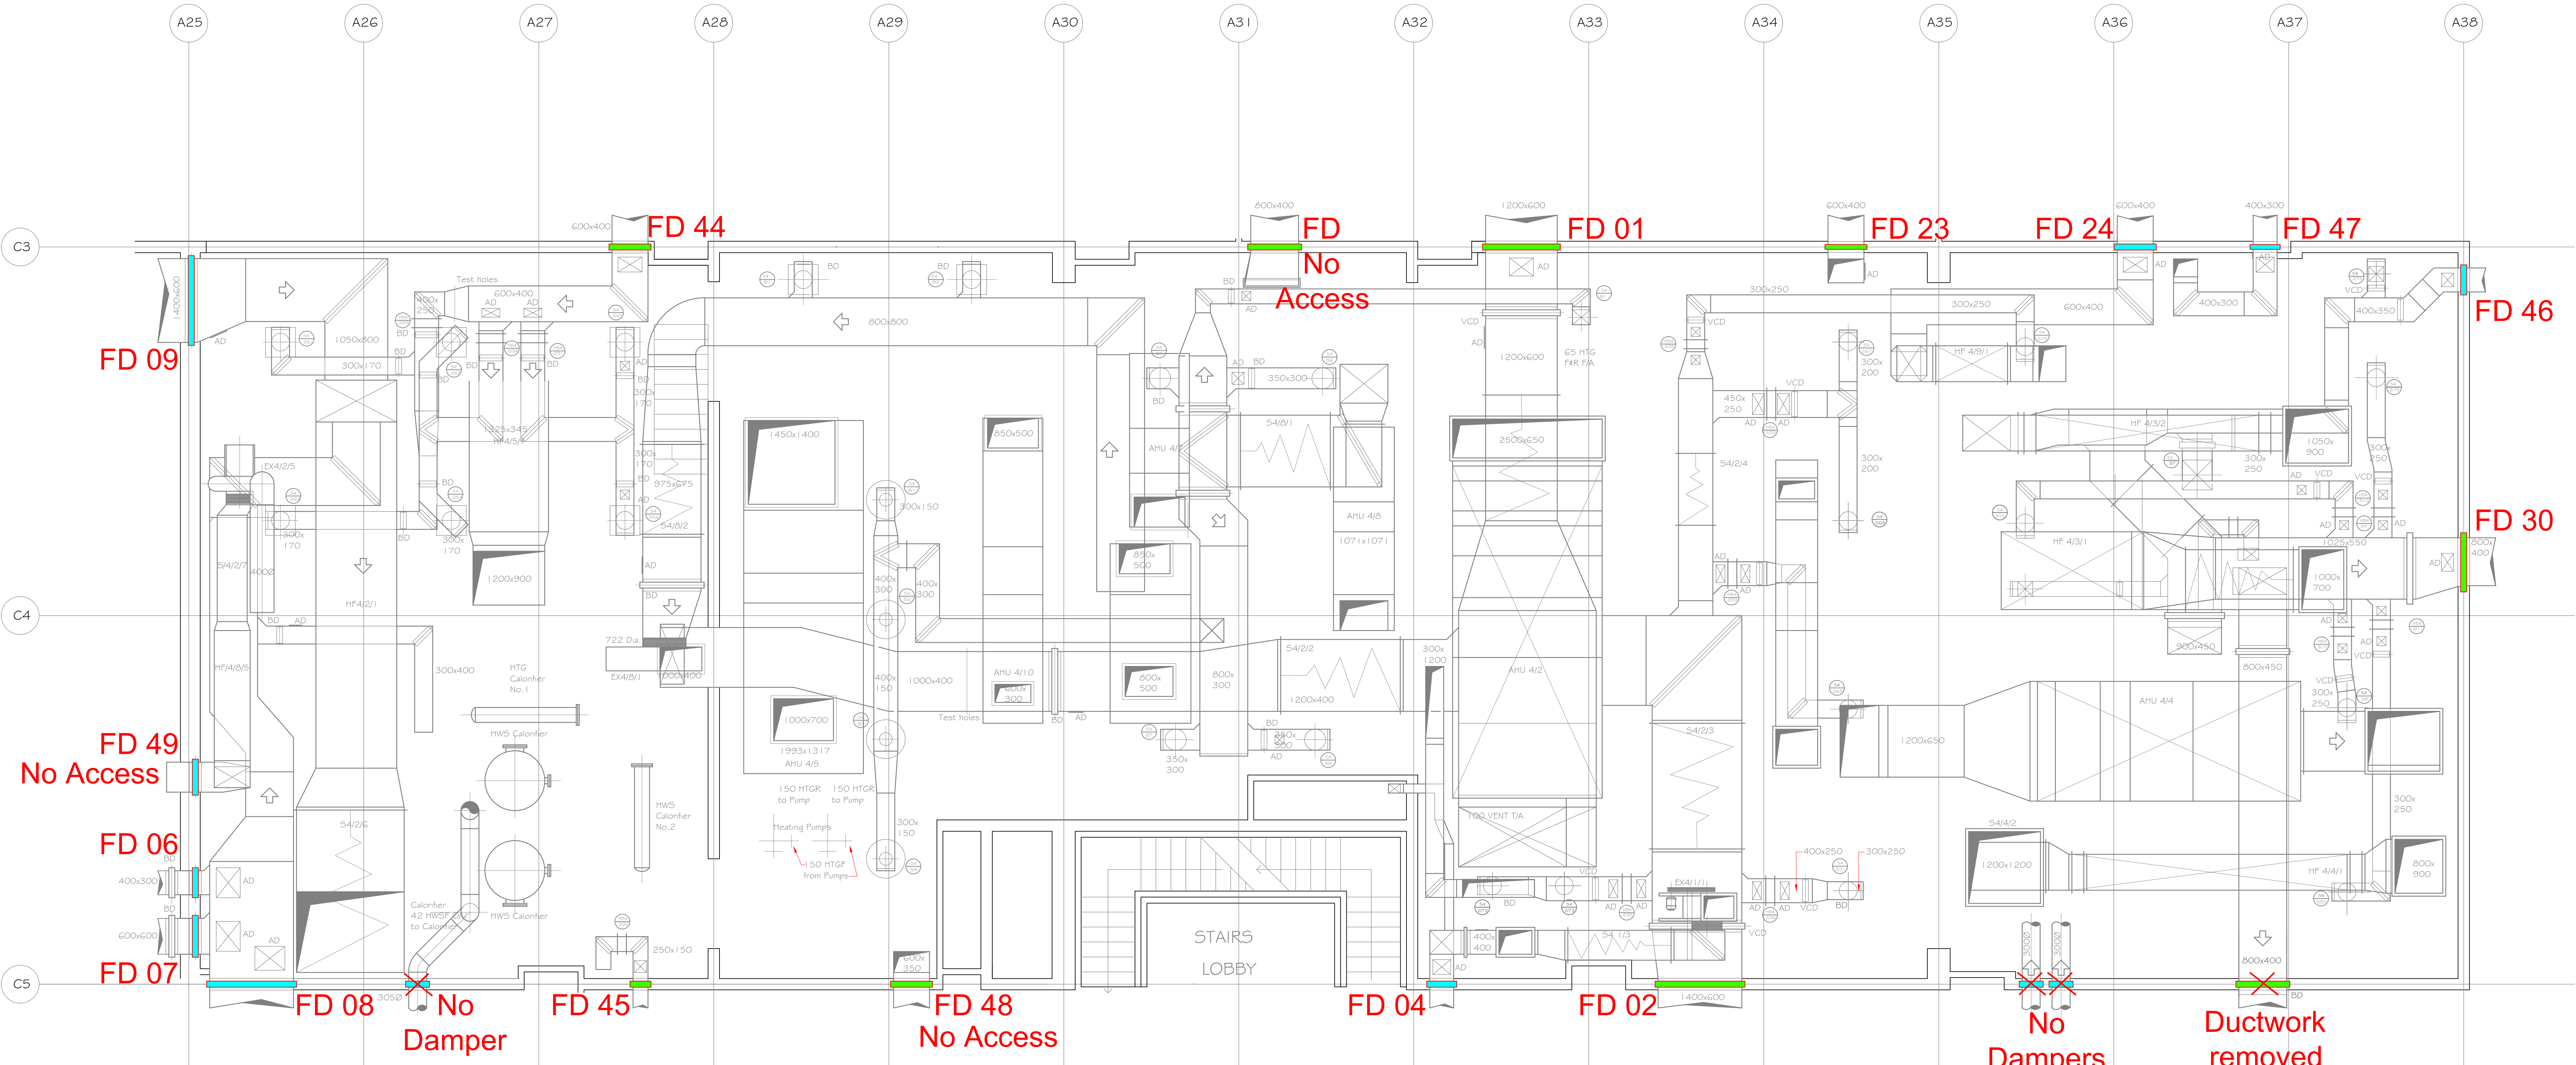

PLANTROOM LEVEL

B	Fire damper ref numbers added from 2014 Sys Hygienics survey	AGB	21-06-16
A	For information	AGB	17-07-14
REV:	DESCRIPTION:	BY:	DATE:

STATUS: MASTER

NIBSC

Confidence in Biological Medicines

National Institute for Biological Standards and Control

Blanche Lane, South Mimms, Potters Bar, Hertfordshire, EN6 3QG

Tel: +44 (0)1707 641000 Fax: +44 (0)1707 641050 Website: www.nibsc.org

PROJECT: Main Intake Grilles, Ductwork and Fire Damper Survey

TITLE: Building 4
Plantroom Level
Fire Damper Locations

DRAWN: AGB	DATE: 17-07-14
CHECKED:	DATE:
SCALE: NTS	SHEET: A1
DRAWING No: P14-016-13	REV: B