

**GENERAL NOTES:**


1. This drawing is not an Architects drawing and must not be interpreted as such.
2. Do not scale off this drawing.
3. This drawing must not be used for construction or installation purposed unless stated.
4. All dimensions must be verified on site before completing shop drawings or setting out the work.
5. This drawing to be read in conjunction with the relevant technical specifications.
6. This drawing is to be read in conjunction with Architectural and Structural Engineers drawings.

- |                            |                               |
|----------------------------|-------------------------------|
| HW - Hot Water             | NRV - Non Return Valve        |
| HL - High Level            | S/C - Stop Cock               |
| LL - Low Level             | C/V - Control Valve           |
| TA - To Above              | DRV - Double Regulating Valve |
| TB - To Below              | LSV - Lock Shield Valve       |
| FA - From Above            | IV - Isolation Valve          |
| FB - From Below            | STR - Strainer                |
| SS - Stub Stack            | HTG - Heating                 |
| AAV - Air Admittance Valve | CW - Cold Water               |
| SVP - Soil Vent Pipe       | TD - Tundish                  |
| DCV - Double Check Valve   | F - Flow                      |
| SV - Solenoid Valve        | R - Return                    |
| NRV - Non Return Valve     |                               |

- |                   |       |
|-------------------|-------|
| Pipes Hidden H/L  | ----- |
| Pipes Hidden L/L  | ----- |
| Pipes Exposed H/L | ----- |
| Pipes Solid L/L   | ----- |

**Fire Protection Notes:**

- **Ductwork:** Where ductwork crossed a protected escape route or passes through a fire rated floor. Ducts shall be provided with fire dampers or for PVC flat duct, approved fire wrap.
- **Soil Pipework:** Where passing through fire rated floors shall be fitting with approved fire collars.
- **Small Services:** ie. Small bore pipework and cabling. All penetrations passing through fire rated structure shall be suitably fire stopped in accordance with approved details.

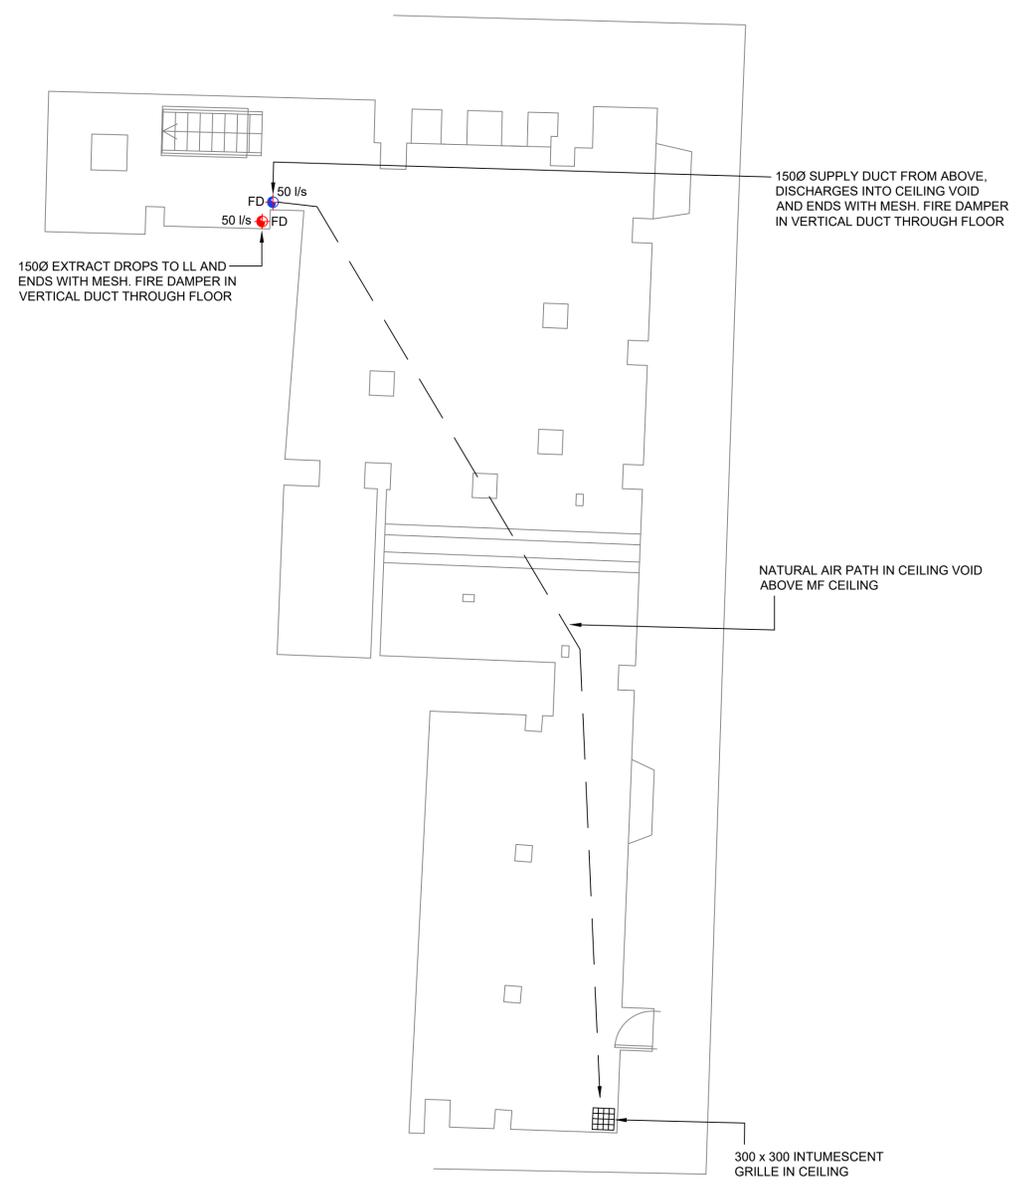

TO PO	TENDER ISSUE INFORMATION	15/01/2020 17/12/2019
REV	MODIFICATIONS	DATE

# CARNELL WARREN

**ASSOCIATES**  
DUKE HOUSE, DUKE STREET, WOKING, GU215BA  
PROJECTS@CARNELLWARREN.CO.UK 01483 730995

PROJECT  
**The Almonry Battle**

TITLE  
**Basement  
Ventilation Services**

CLIENT  
**Battle Town Council**

SCALE @ A1 <b>1:50</b>	DATE <b>Nov '19</b>	DRN <b>SLC</b>
---------------------------	------------------------	-------------------

DRAWING NO. <b>1509/M/301</b>	REV. <b>T0</b>
----------------------------------	-------------------