

DO NOT SCALE THIS DRAWING.

Notes


1. FLOOR LOADS DERIVED FROM BS6399-1: 1996 UNLESS OTHERWISE AGREED WITH THE CLIENT; NATIONAL MUSEUMS LIVERPOOL.
2. ROOF LOADS DERIVED FROM BS6399-3: 1988 UNLESS OTHERWISE AGREED WITH CLIENT; NATIONAL MUSEUMS LIVERPOOL.
- 3 REFER TO BS6399-1: 1996 1.5.1.2 & 5.1.3 FOR DEFINITIONS OF UNIFORMLY DISTRIBUTED LOADS AND CONCENTRATED LOADS RESPECTIVELY.
4. ALL COMPOSITE BEAMS HAVE BEEN DESIGNED FOR A REDUCED CONSTRUCTION LOAD CASE OF 0.5kN/m2.

02	ISSUED FOR CONSTRUCTION	30/05/07	WH	GRH
T2	ISSUED FOR TENDER ADDENDUM	28/07/06	GMG	RJB
01	ISSUED FOR INFORMATION	07/04/06	GMG	RJB
00	ISSUED FOR INFORMATION	06/03/06	JBM	RDG
Rev	Description	Date	Drm	Ch'd

CONSTRUCTION

Status of drawing

Four Winds
Pacific Quay
Glasgow G51 1DY
Tel: +44 (0)141 419 3000
Fax: +44 (0)870 787 4146
Email: 009428@burohappold.com
Web: www.burohappold.com

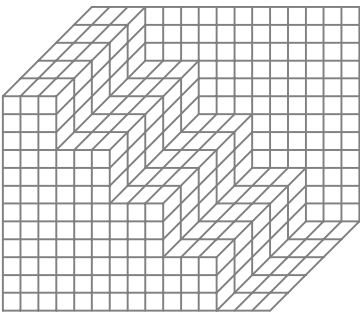


Buro Happold
Consulting Engineers

3XN
National Museums Liverpool
Second Floor Imposed
Loading Plan (Upper)

Scales@A2 1:250
Drawn by WH
Checked by GRH
Date 28/06/05

Job No. 009428
Drawing No. LP006
Rev 02

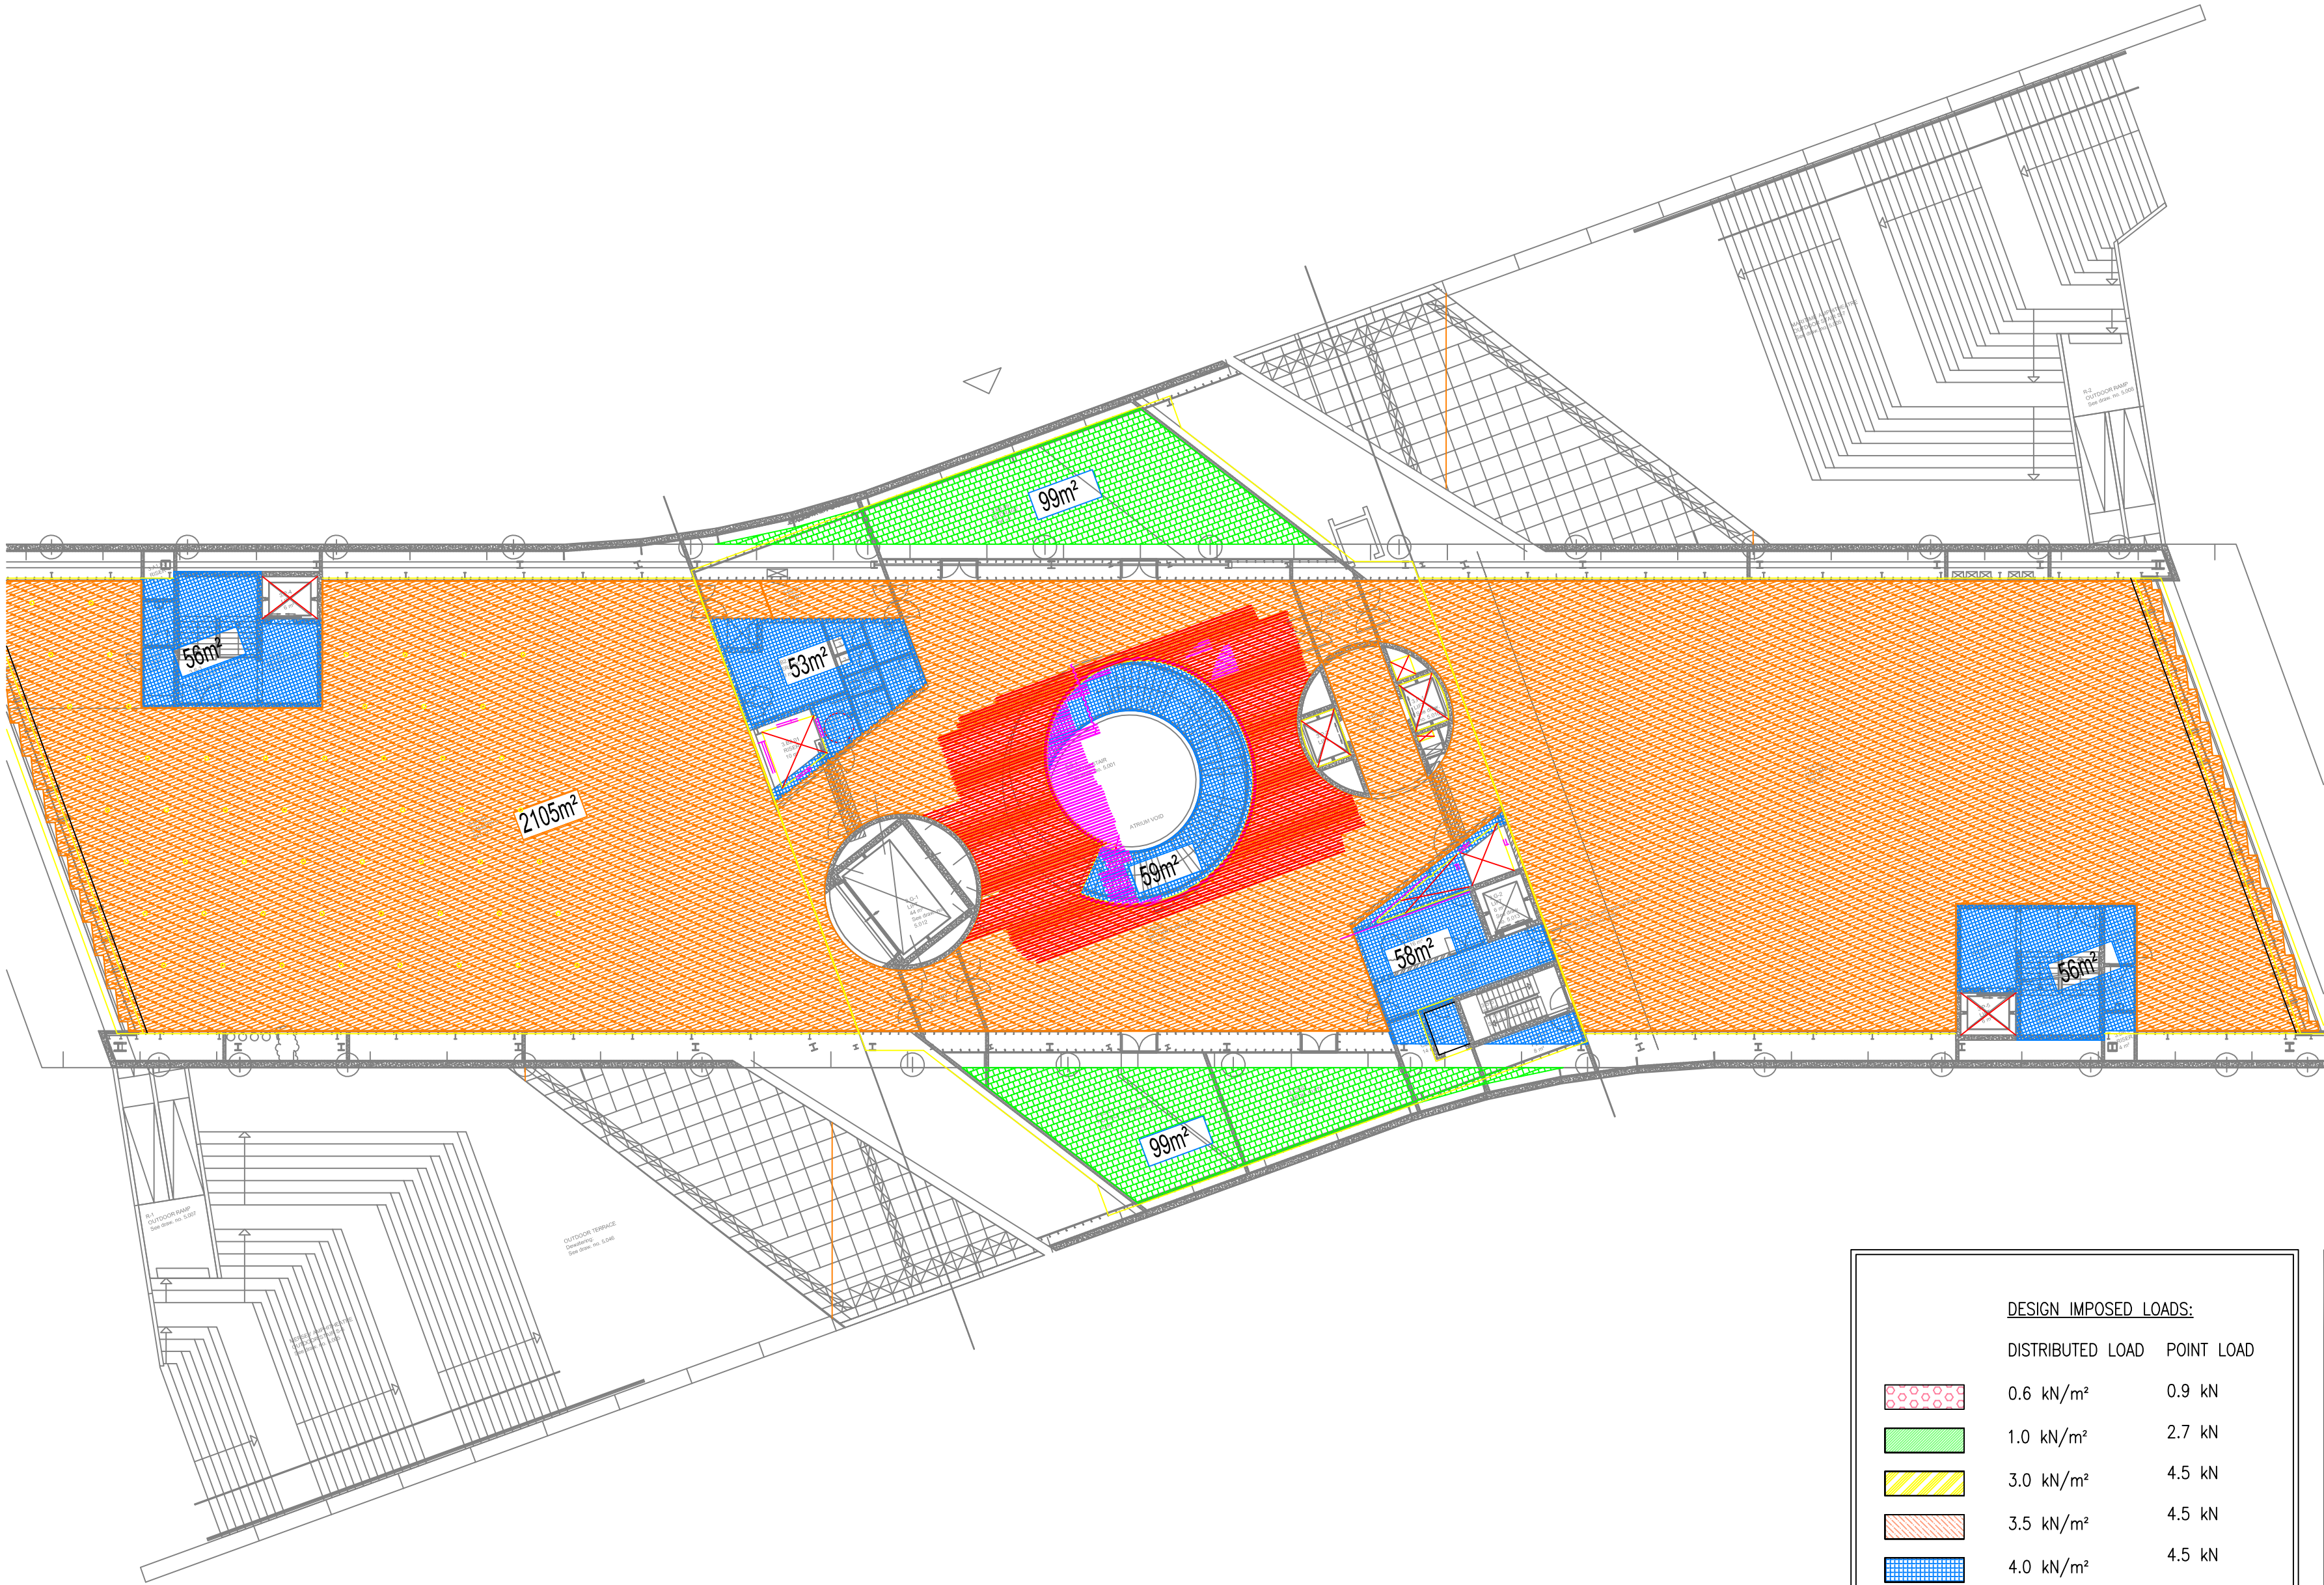

DESIGN IMPOSED LOADS:

DISTRIBUTED LOAD POINT LOAD

	0.6 kN/m²	0.9 kN
	1.0 kN/m²	2.7 kN
	3.0 kN/m²	4.5 kN
	3.5 kN/m²	4.5 kN
	4.0 kN/m²	4.5 kN
	5.0 kN/m²	4.5 kN
	7.5 kN/m²	4.5 kN
	10.0 kN/m²	—
	15.0kN/m²	—