


- GENERAL NOTES:
1. READ IN CONJUNCTION WITH ALL OTHER MFLP DRAWINGS, SCHEMATICS, SCHEDULES AND SPECIFICATION.
 2. WHERE DUCTS CROSS A FIRE COMPARTMENT LINE, FIRE&SMOKE DAMPERS ARE TO BE FITTED.
 3. IF NOT OTHERWISE SPECIFIED, ALL FIRE, FIRE&SMOKE AND VOLUME DAMPER ARE TO BE DUCT LINE SIZE.
 4. ALL DUCTWORK ELBOWS ARE TO BE ROUND SHAPE WITH $R/W > 0.75$, OR IN CASE OF SPACE CONSTRAINTS, SQUARE ELBOWS WITH TURNING VANES.
 5. IN CASE OF INFORMATION DISCREPANCY WITH OTHER DOCUMENTS, THIS SCHEMATIC TAKES PRECEDENCE.

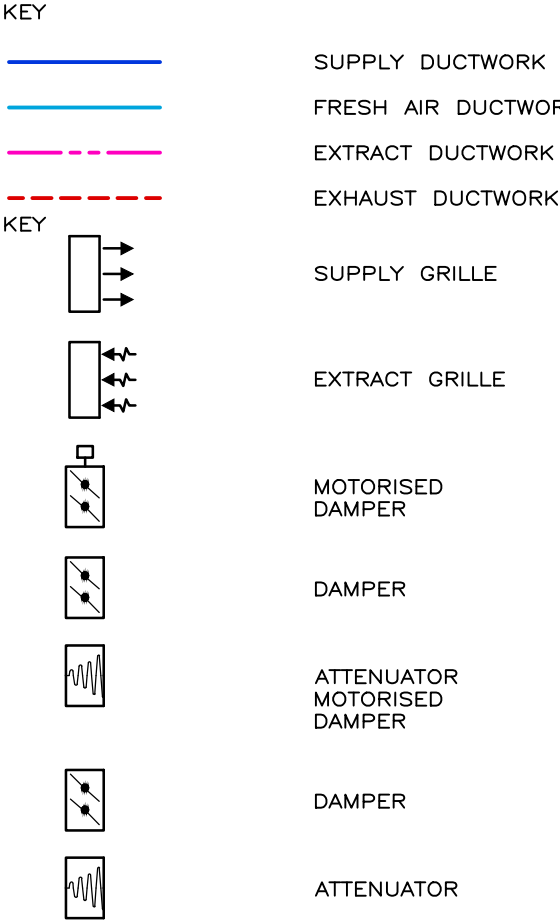

P02	06/11/20	D2 TENDER	EC
P01	16/10/20	D2 TENDER	SH
*	30/09/20	STAGE 4	SH
*	03/06/20	STAGE 3	SH
rev	date	description	eng

MAX FORDHAM

Max Fordham LLP
Carver's Warehouse
77 Dale Street
Manchester
M1 3HG
T. +44 (0) 161 312 8071
F. +44 (0) 20 7482 0329
maxfordham.com

Registered Office 42-43 Gloucester Crescent London NW1 7PE

Registered in England No. OC300026

architect

DONALD INSALL ASSOCIATES

job title

Walker Art Gallery

LIVERPOOL

project leader

MD

date

SEPT20

scale (at A1)

NTS

drawing title

VENTILATION SCHEMATIC

job no

dwg no

rev

6683

6683-MXF-XX-XX-DR-M-20102/ P02

© Copyright Max Fordham LLP