

POSITION OF WDH
DEPENDENT ON
CHAMBER DIMENSIONS
BELOW GROUND -
OPTIONS -

- Add lintels to bridge over
drain run and
stop footings
either side

FOR DURABILITY / LONG TERM
ROBUSTNESS IF ELECTRIC
WHEEL CHAIRS USED / EXPECTED
RAMP / STAIRS SHOULD BE
150mm CONC WITH 1 LAYER
A142 MESH ON MIN
150mm TYPE I ON GROUND
WITH NO SOFT SPOTS.


This wall can
move slightly this
way if necessary to
avoid chamber foot)


200 mm
CONC BLOCK
W/DH

450mm WIDE
300mm (MIN)
THICK STRIP
FOOTING TAKEN
DOWN TO GOOD
UNDISTURBED
GROUND.
EXPECTED GOOD
GROUND @
1.2m BELOW
GROUND LEVEL

KONA COMMENTS 11/2/2025.

224317 / SK02

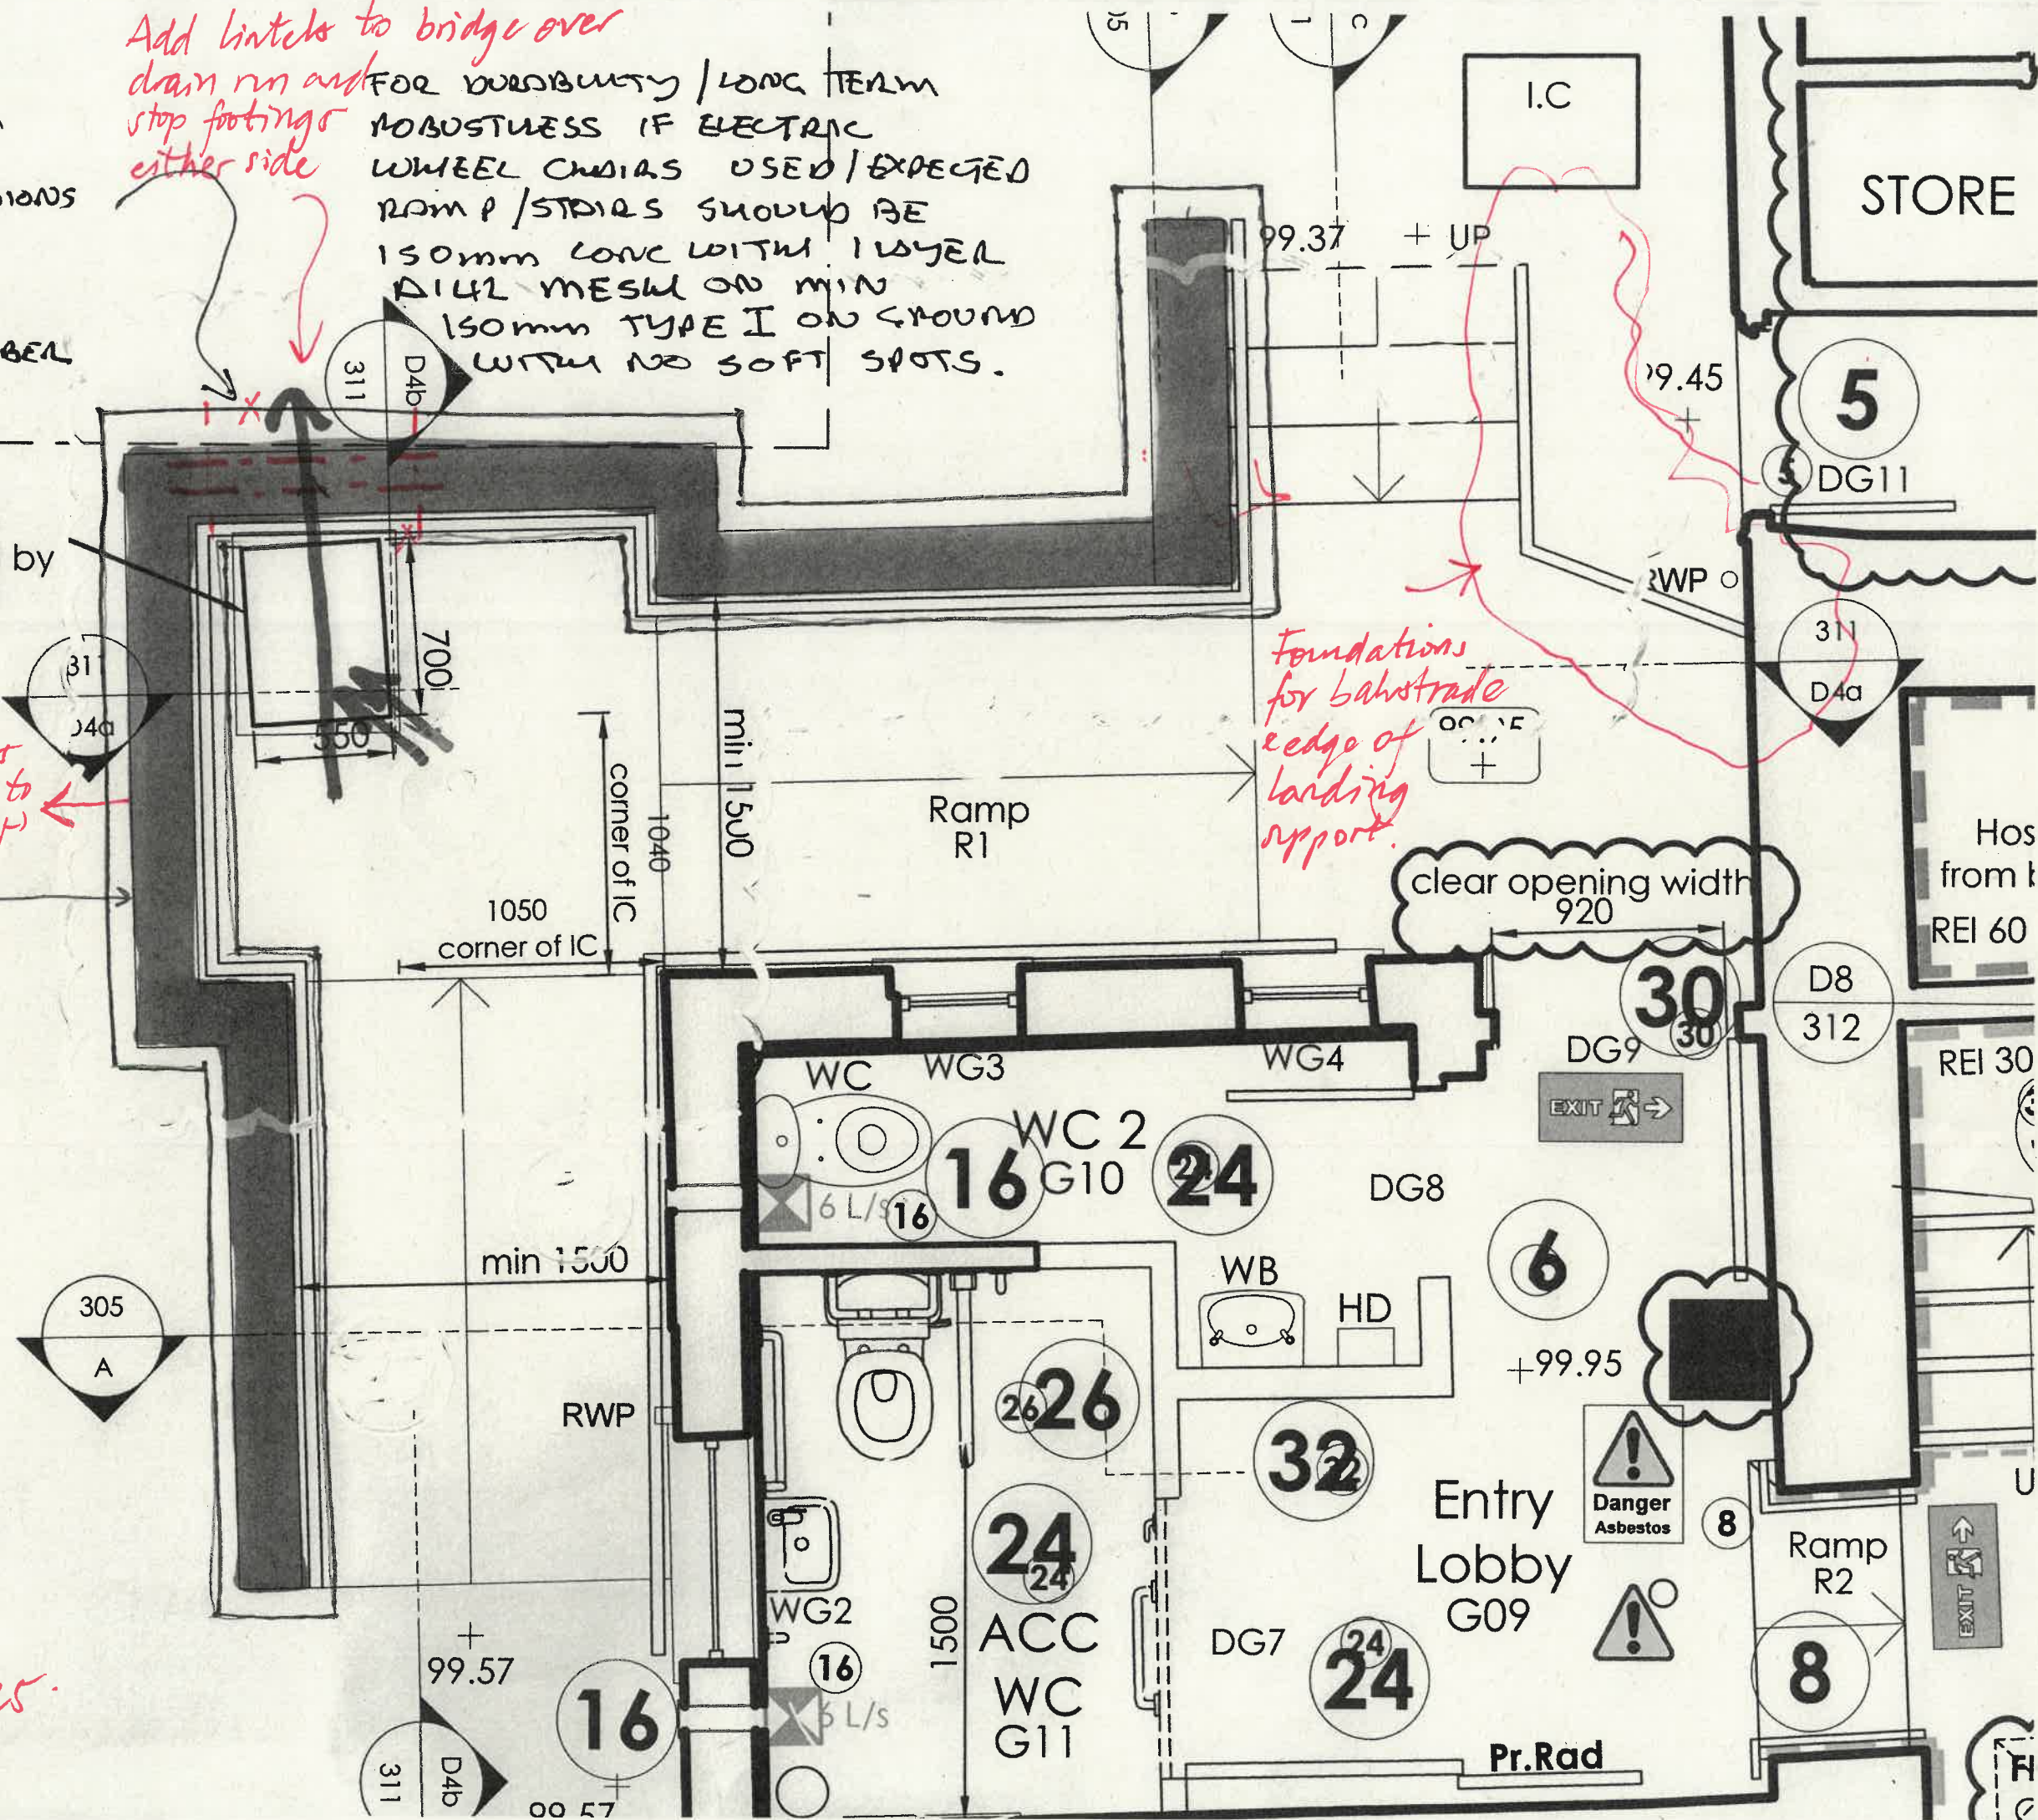

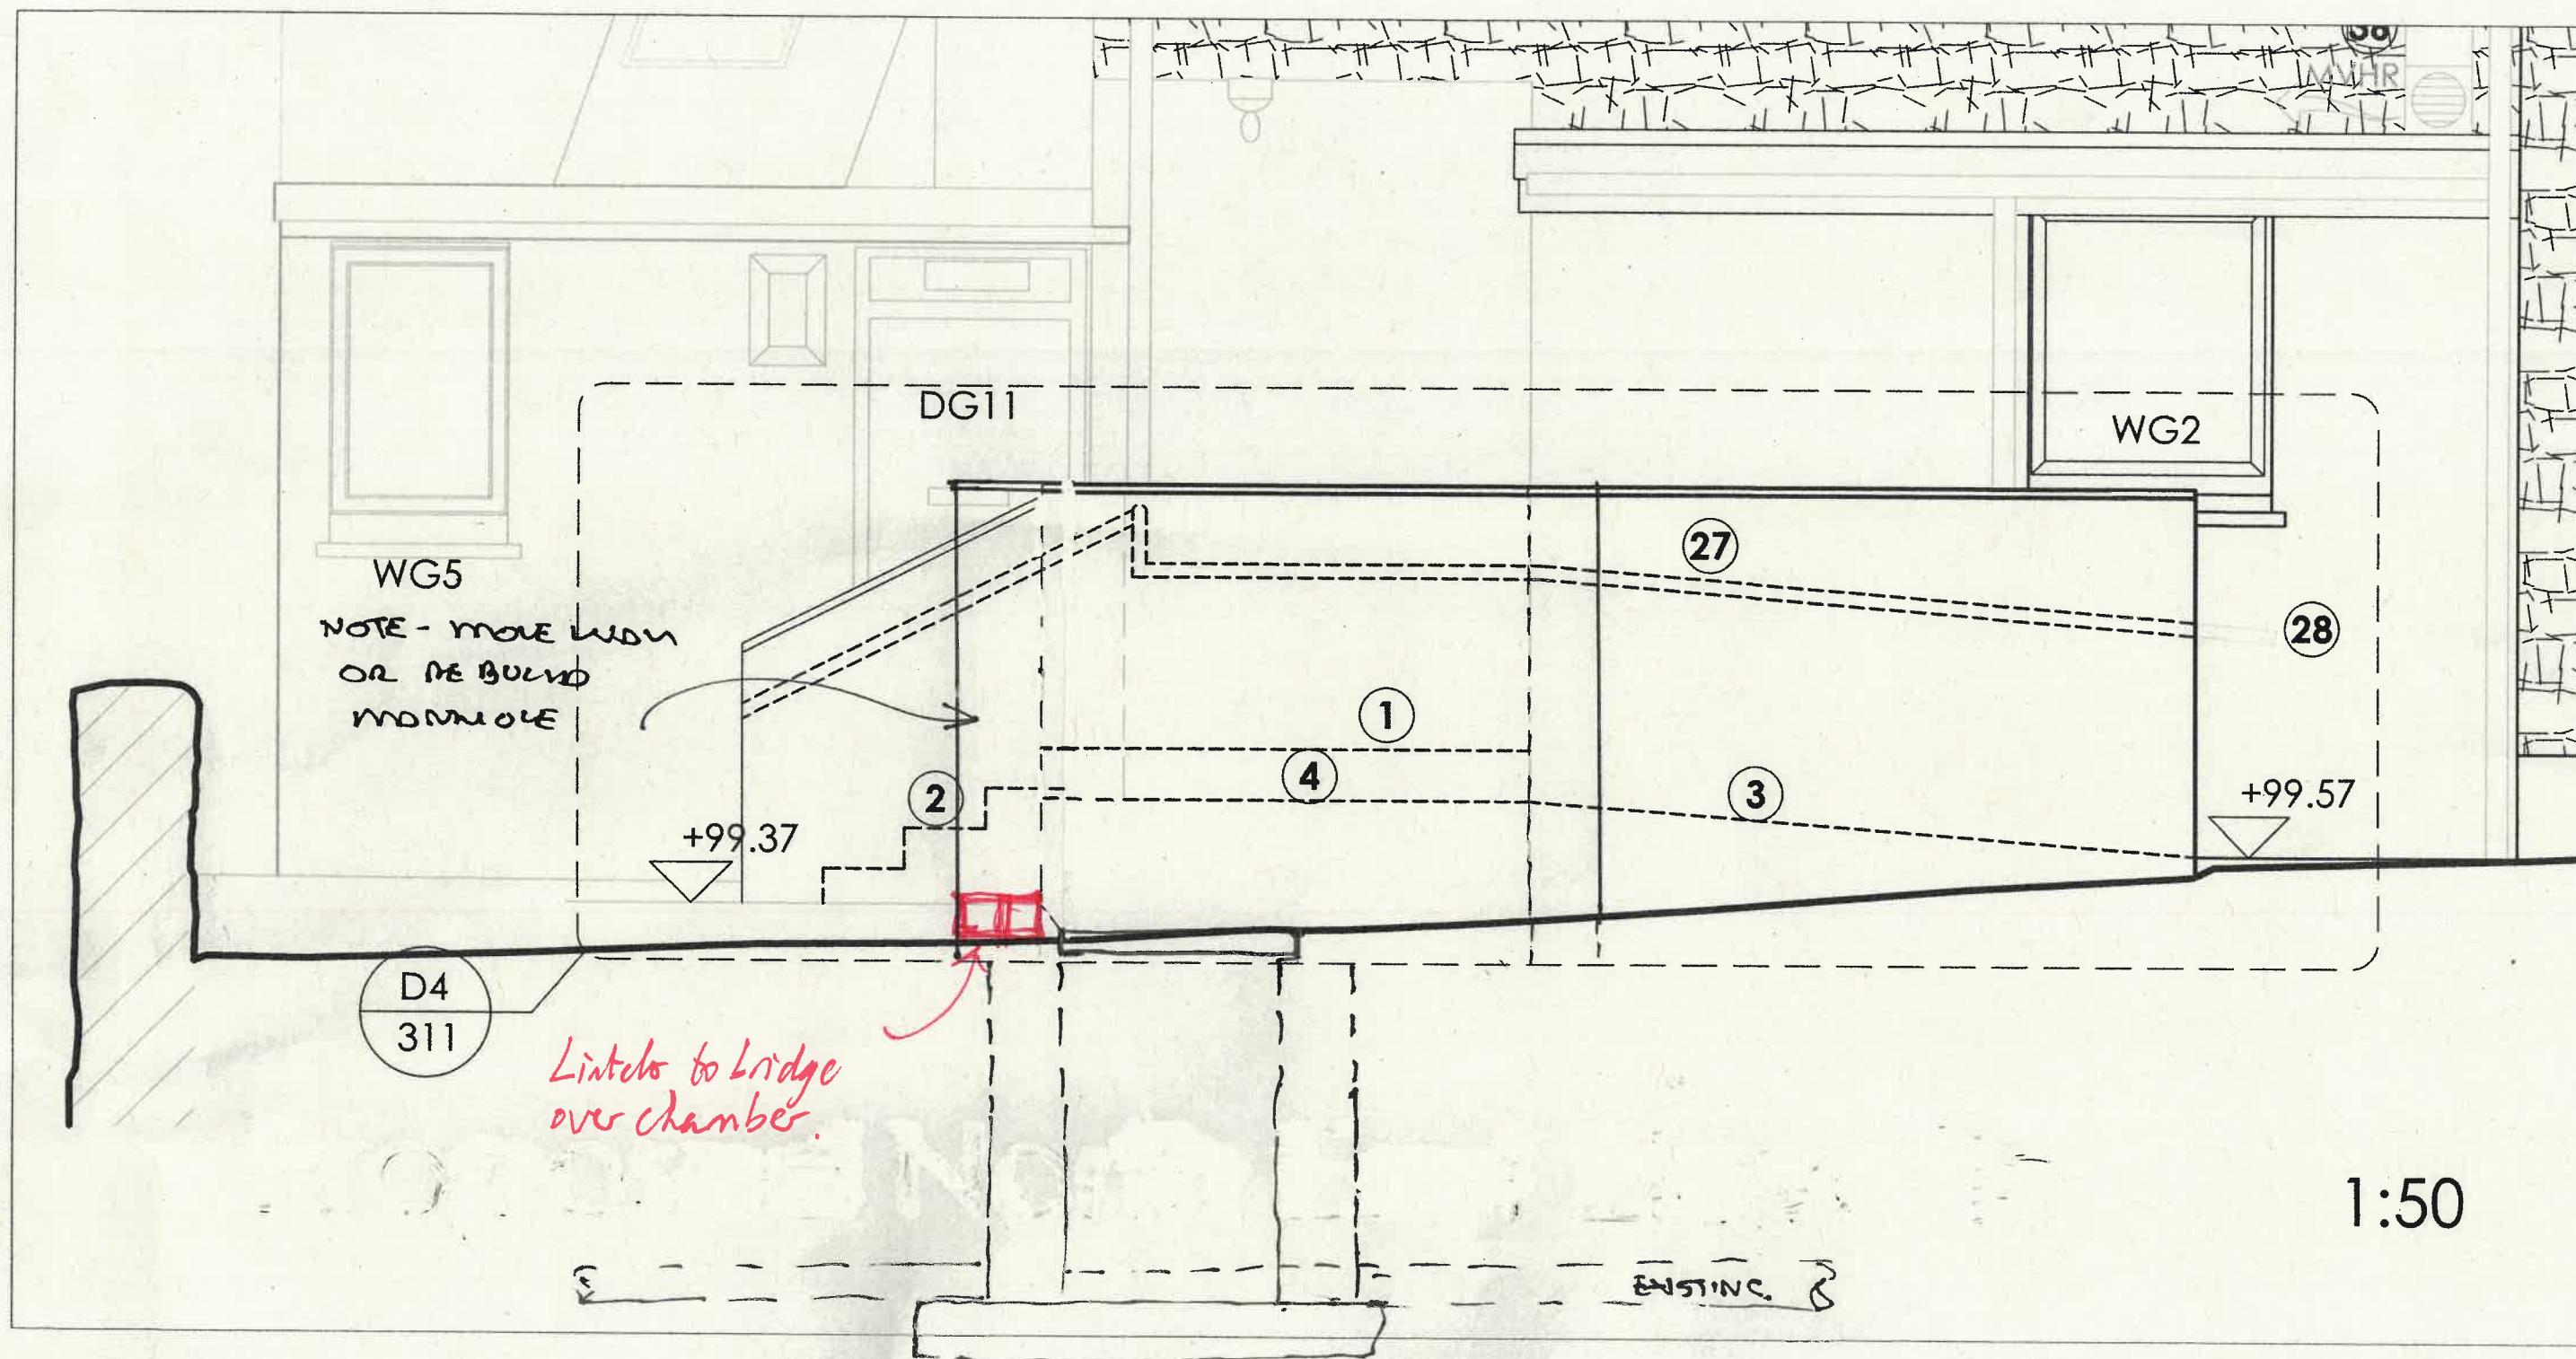

KOHA COMMENTS
11/2/2025.
224319 SK03