


SHRUB END CLINIC, COLCHESTER



1 PROPOSED WORKSHOP/GARAGE FIRE ALARM AND DETECTION LAYOUT  
Scale : 1:25

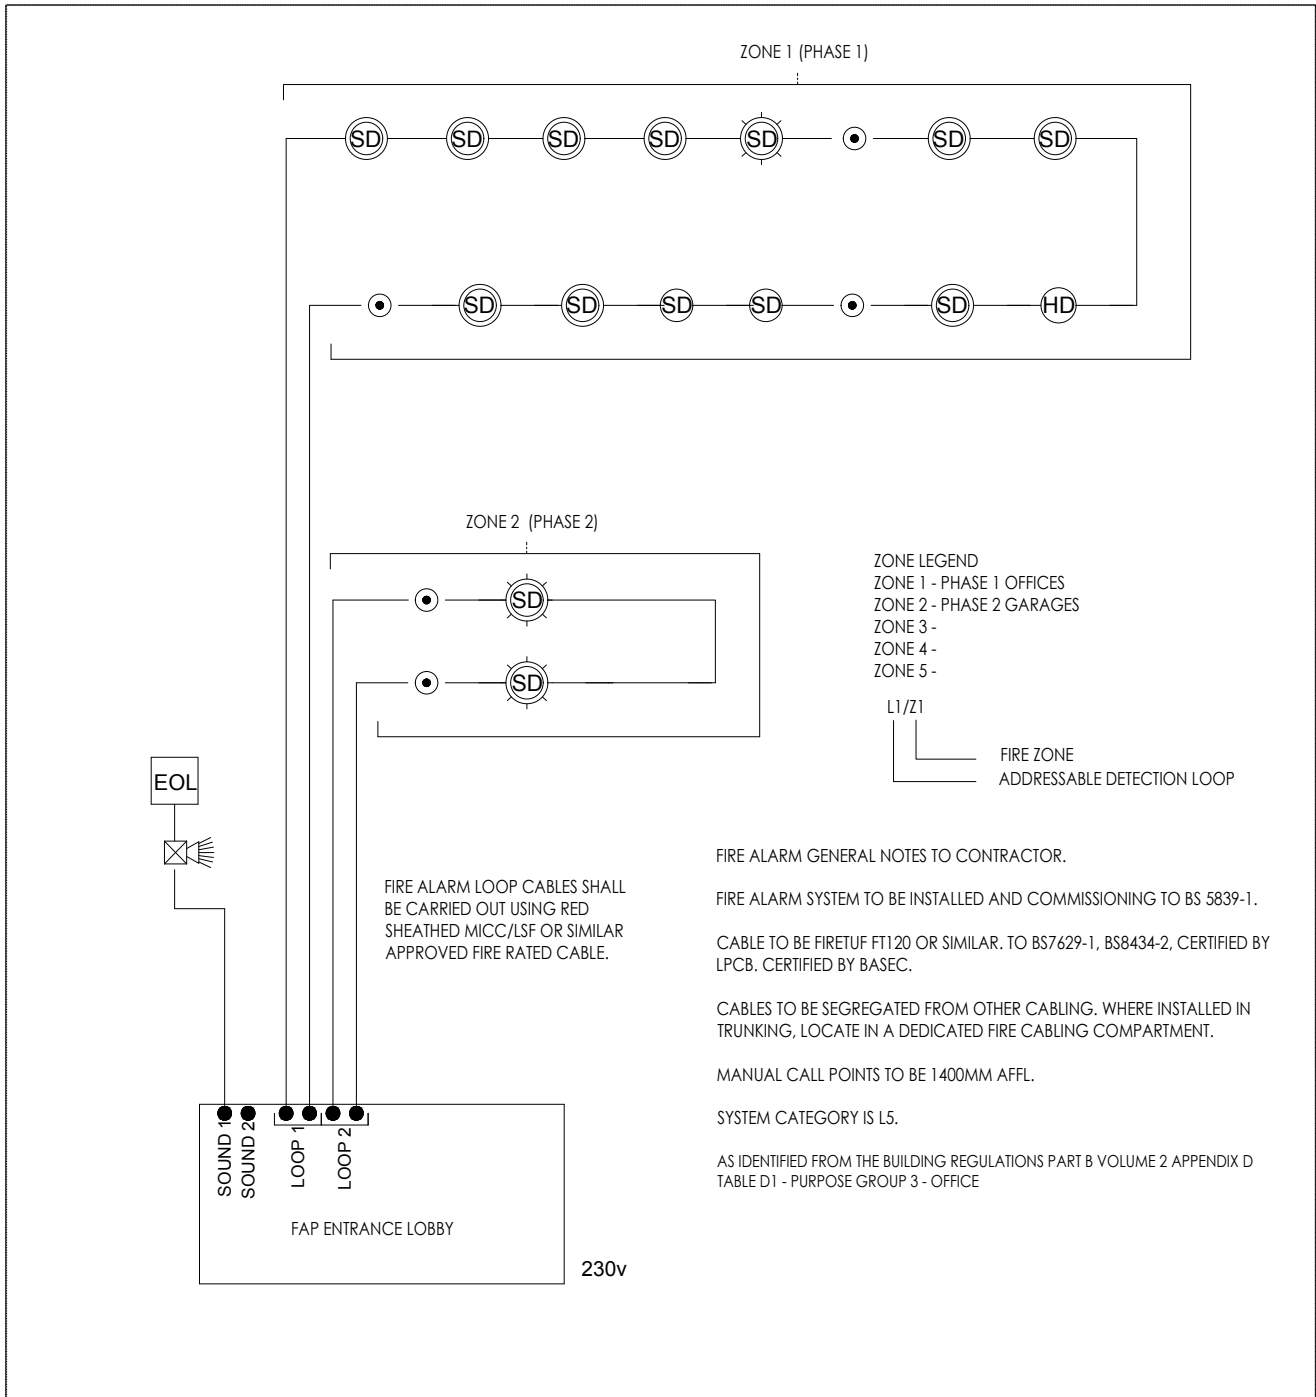

2 PROPOSED WORKSHOP/GARAGE FIRE ALARM & DETECTION SCHEMATIC  
Scale : NTS

PROPOSED WORKSHOP/GARAGE FIRE ALARM AND DETECTION LAYOUT

THE DETAILS DEPICTED ON THIS DRAWING ARE THE COPYRIGHT TO CREATE CONSULTING ENGINEERS LTD AND MAY NOT BE REPRODUCED WITHOUT PERMISSION. THIS DRAWING MUST NOT BE RE-ISSUED, LOANED OR COPIED WITHOUT THE CONSENT. ERRORS OMISSIONS AND DISCREPANCIES SHOULD BE REPORTED TO THE ORIGINATOR IMMEDIATELY.

ALL DIMENSIONS TO BE CHECKED BEFORE SITE OR OFF-SITE FABRICATION BY THE CONTRACTOR, HIS SUB-CONTRACTOR OR SUPPLIER.

DO NOT SCALE PLANS - USE FIGURE OR GRID DIMENSIONS WHERE GIVEN. ANY DEVIATION FROM THE DRAWING IS TO BE REPORTED TO THE ORIGINATOR IMMEDIATELY.

STRUCTURE, STRUCTURAL MEMBERS & GEOTECHNICAL INVESTIGATIONS ARE TO BE CARRIED OUT & APPROVED BY THE APPOINTED STRUCTURAL ENGINEER. ANY DEVIATIONS TO THESE ELEMENTS ARE TO BE REPORTED TO THE APPOINTED CONSULTANT IMMEDIATELY.

IF IN DOUBT ASK !

NOTES:

FIRE ALARM SYMBOLS KEY

121	FIRE ALARM INTERFACE UNIT
122	FIRE ALARM MAIN PANEL
123	FIRE ALARM SMOKE DETECTOR
124	FIRE ALARM HEAT DETECTOR
125	FIRE ALARM SMOKE DETECTOR/BEACON
126	FIRE ALARM HEAT DETECTOR/BEACON
127	FIRE ALARM CALL POINT MOUNTED 1400MM (+/- 200MM) FROM AFFL.
128	FIRE ALARM COMBINED SMOKE DETECTOR WITH SOUNDER BASE
129	FIRE ALARM BEACON
130	FIRE ALARM HEAT DETECTOR / SOUNDER
131	FIRE ALARM HEAT DETECTOR / SOUNDER / BEACON
132	FIRE ALARM SMOKE DETECTOR / SOUNDER / BEACON
133	COMBINED FIRE ALARM ELECTRONIC SOUNDER AND BEACON

DESIGNERS RESIDUAL HAZARDS MECHANICAL, ELECTRICAL & PUBLIC HEALTH			
IN ADDITION TO THE HAZARDS / RISKS NORMALLY ASSOCIATED WITH THE TYPES OF WORK DETAILED ON THIS DRAWING, THE FOLLOWING DESIGNERS RESIDUAL HAZARDS HAVE BEEN IDENTIFIED AND SHOULD BE ADDRESSED/MANAGED BY THE CONTRACTOR. ANY HAZARDS THAT CANNOT BE ADDRESSED AND REMOVED SHALL BE CARRIED FORWARD AS PART OF THE HEALTH AND SAFETY HANDOVER DOCUMENTATION.			
	<u>HAZARD</u>	<u>DESCRIPTION</u>	
1	N/A	N/A	
2			
IT IS ASSUMED THAT ALL WORKS WILL BE CARRIED OUT BY A COMPETENT CONTRACTOR WORKING, WHERE APPROPRIATE, TO AN APPROVED RISK ASSESSMENT AND METHOD STATEMENT.			

C02	31/11/2017	ISSUED FOR TENDER. DRYING ROOM FIRE ALARM DETECTOR RELOCATED	NGS	JDB
REV	DATE	DESCRIPTION	DRAWN	CHECKED

CLIENT  
MARITIME & COASTGUARD AGENCY

PROJECT  
SHRUB END CLINIC  
ICENI WAY  
COLCHESTER

DRAWING TITLE  
PROPOSED WORKSHOP/GARAGE  
FIRE ALARM AND DETECTION LAYOUT  
SHEET 01 OF 01

DATE	DESIGNED	DRAWN	CHECKED	SCALE(S)
17/11/2017	NGS	NGS	JDB	1:25 @A1

**create** NORWICH LONDON CHELMSFORD GLASGOW  
15 PRINCES STREET,  
NORWICH,  
NORFOLK, NR3 1AF,  
TEL: 01603 877010  
CONSULTING ENGINEERS LTD

DRAWING STATUS											
FOR TENDER											
PROJ	ORIG	ZONE	LEVEL	TYPE	ROLE	CLASS	PRESENT	NUMBER	STATUS	REVISION	
1321	CCE	00	GF	DR	E	75	P	0702	D2	C02	