


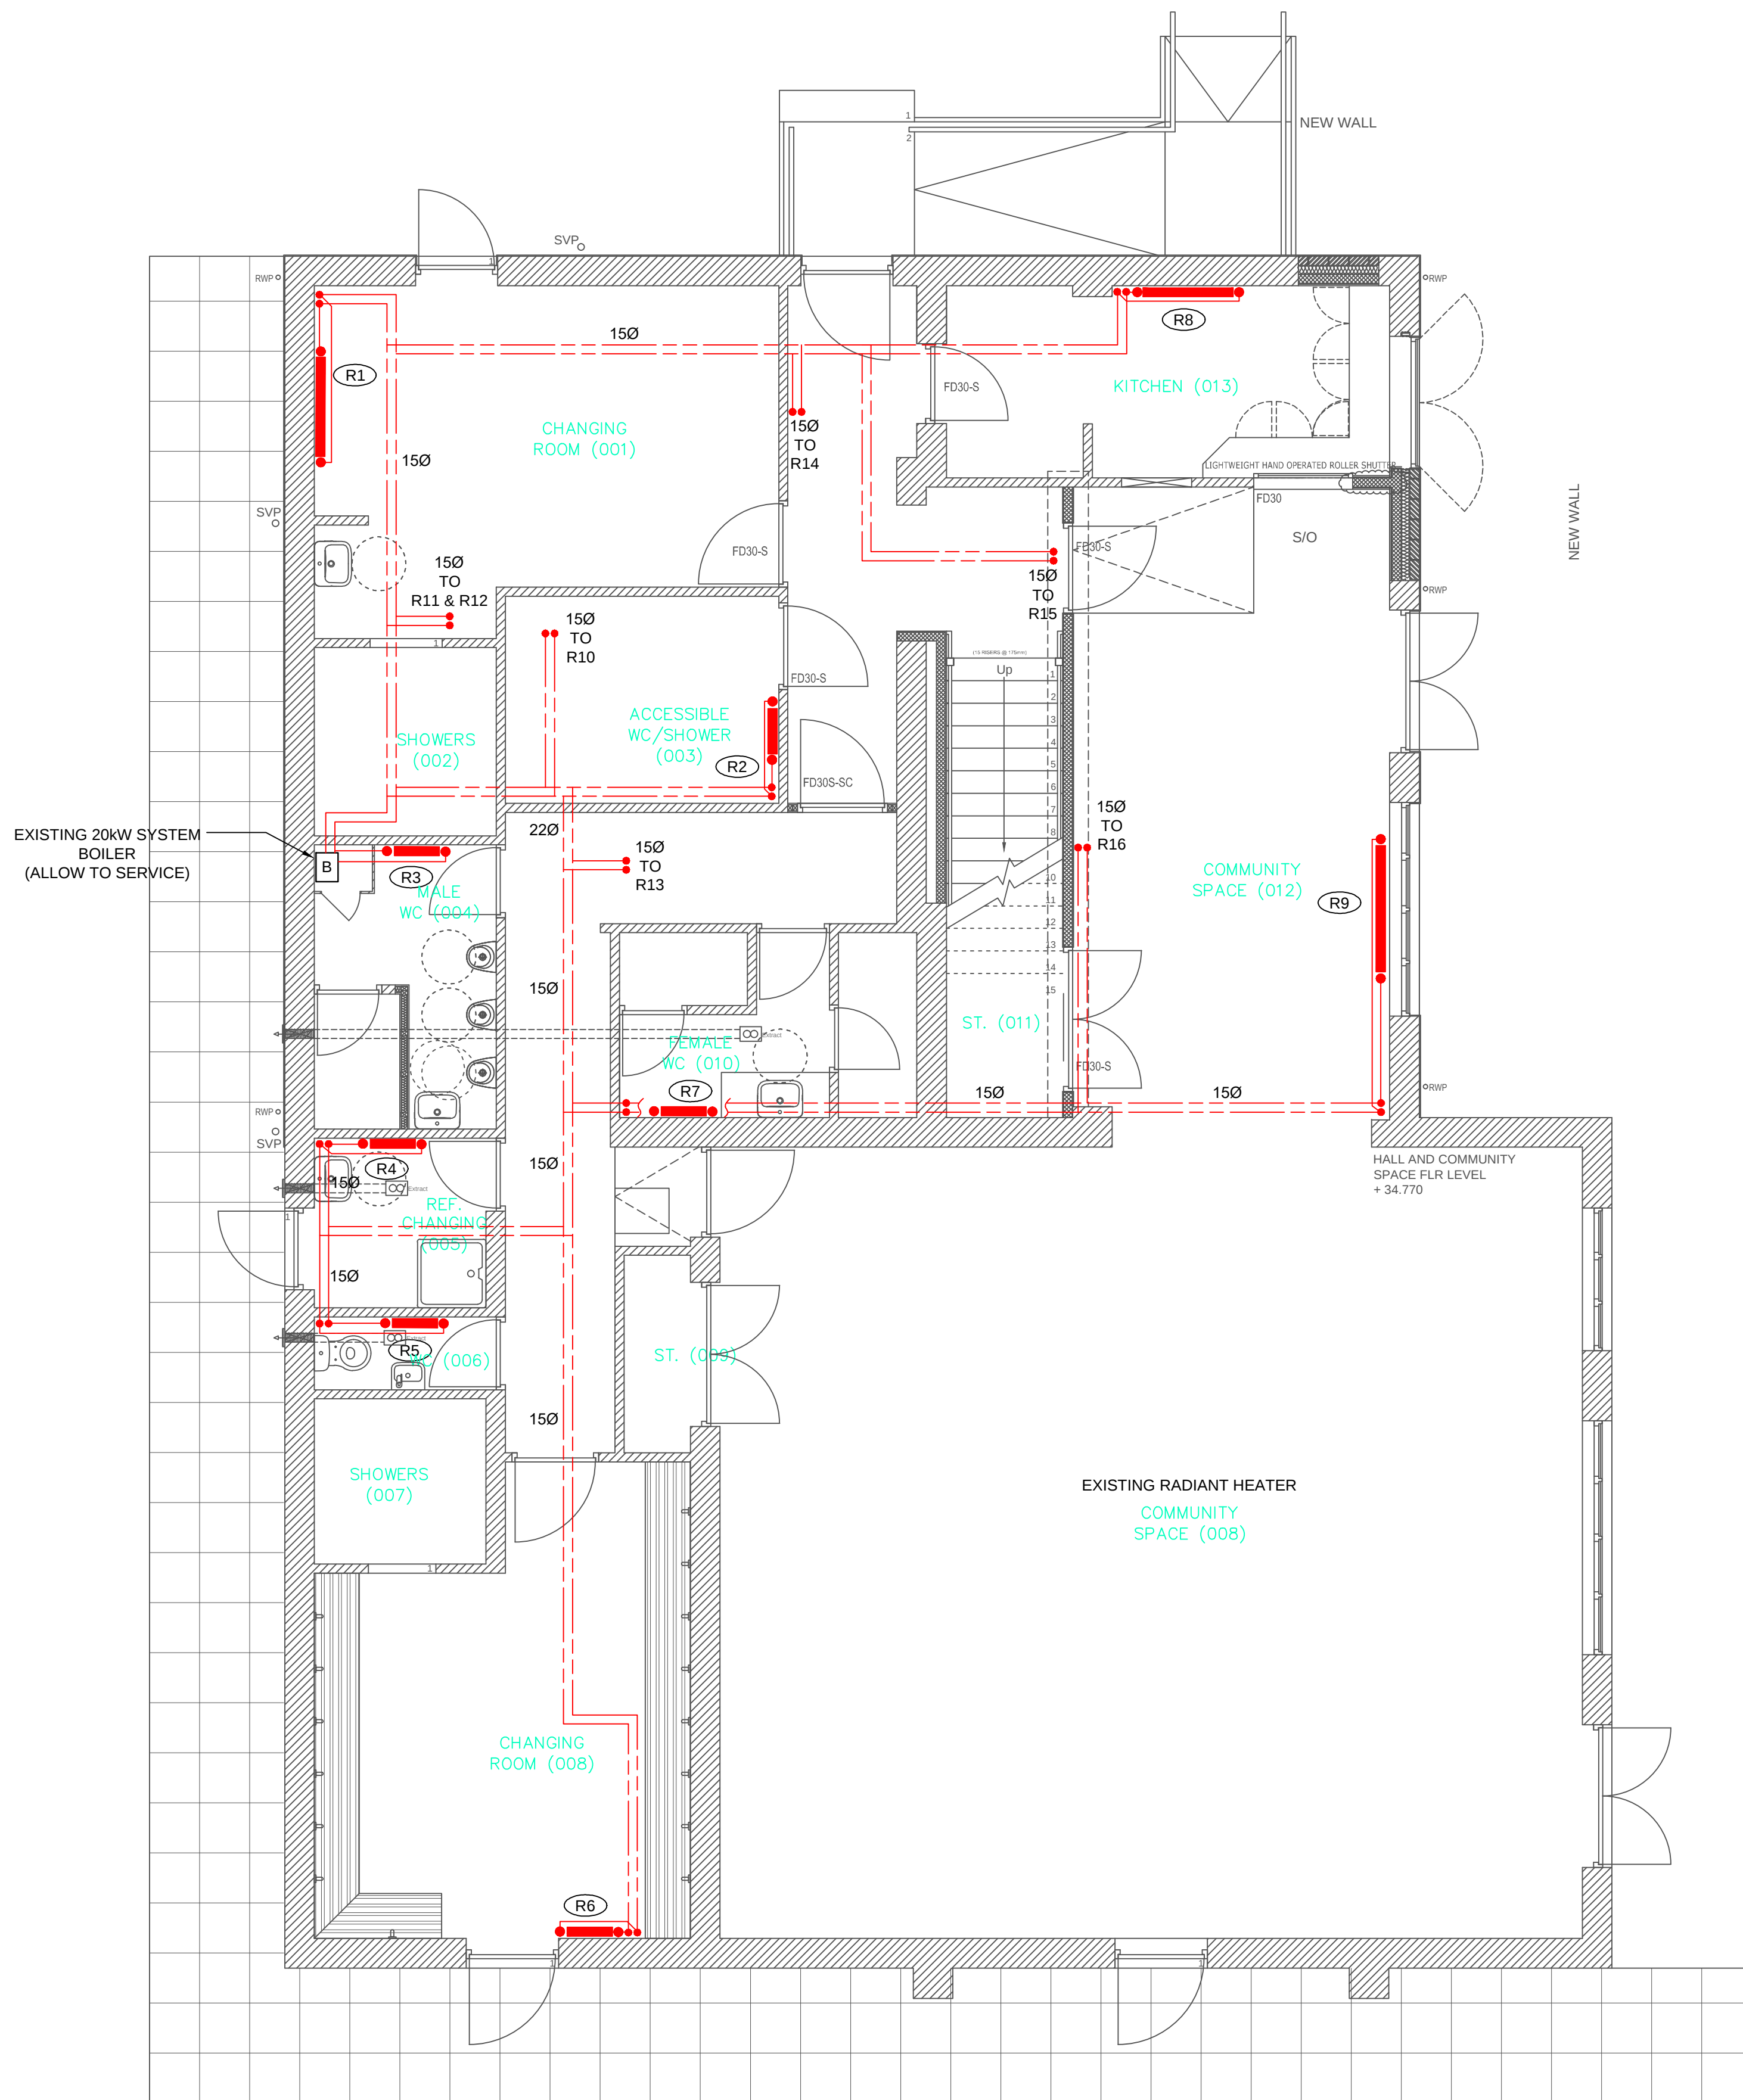

- NOTES
- 1. ALL PIPEWORK TO BE TABLE X COPPER TUBE
 - 2. GAS EXTENDED FROM EXTERNAL METER LOCATION
 - 3. ALL CONCEALED PIPEWORK TO BE INSULATED

KEY

RADIATOR

RADIATOR SCHEDULE	
REF	SIZE / TYPE
R1	600(H) - 1100(L) (K2)
R2	600(H) - 400(L) (K1)
R3	600(H) - 500(L) (K1)
R4	600(H) - 500(L) (K1)
R5	300(H) - 500(L) (K1)
R6	1800(H) - 500(L) (K2)
R7	600(H) - 400(L) (K1)
R8	600(H) - 1000(L) (K1)
R9	600(H) - 1400(L) (K2)

A	REVISED TO COMMENTS.	19.05.17
Revision	Description	Date
Mechanical and Electrical Ltd Unit 28, Royal Scot Road, Pride Park, Derby, DE24 8AJ. tel: 01332 293790 e-mail: info@arcmande.co.uk		
Client -		
Project ASTON ON TRENT PAVILION EXTENSION		
Title GROUND FLOOR HEATING		
Status PRELIMINARY.		
Drawn by N.D.S	Checked N.E.	File M-001.DWG.
Drawing Number M-001.		Revision A
		Scale 1:50 at A1. Date 25.04.2017